

# FITTINGS

**ENY/EYS SERIES**


## SEALING FITTINGS



**ENY-3**  
(For Vertical or Horizontal Conduit)



**ENY-3-T with Nipple**  
(For Vertical or Horizontal Conduit)



**EYS-3**  
(For Vertical or Horizontal Conduit)



**EYS-3-T with Nipple**  
(For Vertical or Horizontal Conduit)

**ENY-1, 2, 3, 4, 5, 6**  
Class I, Div. 1 & 2, Groups A, B, C, D  
Class I, Zone 1, Groups IIC, IIB, IIA  
Class II, Div. 1 & 2, Groups E, F, G  
Class III

**EYS Series**  
Class I, Div. 1 & 2, Groups C, D  
Class I, Zone 1, Groups IIB, IIA  
Class II, Div. 1 & 2, Groups E, F, G  
Class III

Listed File No. E10514

Certified File No. LR11716

See files for details or call Killark.

### FEATURES-SPECIFICATIONS

#### Material/Finish

#### Copper-free Aluminum



(less than 4/10 of 1%)

- Electrostatically applied powder coating

#### Duraloy Iron

- Tri-Coat Finish of electrozinc, chromate sealant, and electrostatically applied powder coating

#### Dimensions



| ENY SEALING FITTINGS |                  |              |               |               |                | ENY WITH NIPPLE  |              |
|----------------------|------------------|--------------|---------------|---------------|----------------|------------------|--------------|
| HUB SIZE             | CATALOG NUMBER   |              | DIMENSIONS    |               | TURNING RADIUS | CATALOG NUMBER   |              |
|                      | KILLARK ALUMINUM | DURALOY IRON | A             | B             |                | KILLARK ALUMINUM | DURALOY IRON |
| 1/2"                 | ENY-1            | ENY-1M       | 3-15/16"(100) | 1-13/16"(46)  | 1-3/16"(30)    | ENY-1-T          | ENY-1TM      |
| 3/4"                 | ENY-2            | ENY-2M       | 4-1/16"(103)  | 2-1/16"(52)   | 1-9/32"(33)    | ENY-2-T          | ENY-2TM      |
| 1"                   | ENY-3            | ENY-3M       | 4-25/32"(121) | 2-11/32"(60)  | 1-13/32"(36)   | ENY-3-T          | ENY-3TM      |
| 1-1/4"               | ENY-4            | ENY-4M       | 5-3/8"(137)   | 3"(76)        | 1-25/32"(45)   | ENY-4-T          | ENY-4TM      |
| 1-1/2"               | ENY-5            | ENY-5M       | 5-11/16"(144) | 3-1/4"(83)    | 1-29/32"(48)   | ENY-5-T          | ENY-5TM      |
| 2"                   | ENY-6            | ENY-6M       | 6-3/8"(162)   | 3-15/16"(100) | 2-5/16"(59)    | ENY-6-T          | ENY-6TM      |

| EYS SEALING FITTINGS |                  |              |               |               |                | EYS WITH NIPPLE  |              |
|----------------------|------------------|--------------|---------------|---------------|----------------|------------------|--------------|
| HUB SIZE             | CATALOG NUMBER   |              | DIMENSIONS    |               | TURNING RADIUS | CATALOG NUMBER   |              |
|                      | KILLARK ALUMINUM | DURALOY IRON | A             | B             |                | KILLARK ALUMINUM | DURALOY IRON |
| 1/2"                 | EYS-1            | —            | 2-15/16"(75)  | 1-13/16"(46)  | 1-3/16"(30)    | EYS-1-T          | —            |
| 3/4"                 | EYS-2            | —            | 4-1/16"(103)  | 2-1/16"(52)   | 1-9/32"(33)    | EYS-2-T          | —            |
| 1"                   | EYS-3            | —            | 4-25/32"(121) | 2-11/32"(60)  | 1-13/32"(36)   | EYS-3-T          | —            |
| 1-1/4"               | EYS-4            | —            | 5-3/8"(137)   | 3"(76)        | 1-25/32"(45)   | EYS-4-T          | —            |
| 1-1/2"               | EYS-5            | —            | 5-11/16"(144) | 3-1/4"(83)    | 1-29/32"(48)   | EYS-5-T          | —            |
| 2"                   | EYS-6            | —            | 6-3/8"(162)   | 3-15/16"(100) | 2-5/16"(59)    | EYS-6-T          | —            |
| 2-1/2"               | EYS-7            | EYS-7M       | 7-5/8"(194)   | 4-1/2"(114)   | 4-1/8"(105)    | EYS-7-T          | EYS-7TM      |
| 3"                   | EYS-8            | EYS-8M       | 7-5/8"(194)   | 4-1/2"(114)   | 4-3/8"(111)    | EYS-8-T          | EYS-8TM      |
| 3-1/2"               | EYS-9            | EYS-9M       | 7-1/8"(181)   | 5-3/16"(132)  | 4-3/4"(121)    | EYS-9-T          | EYS-9TM      |
| 4"                   | EYS-0            | EYS-0M       | 7-1/8"(181)   | 5-3/16"(132)  | 4-3/4"(121)    | EYS-0-T          | EYS-0TM      |



Stock held in the UK by Scattergood & Johnson Ltd. Available for next day delivery.




## EY SERIES

## SEALING FITTINGS



ENY  
(For Vertical or Horizontal Conduit)

ENY with Nipple  
(For Vertical or Horizontal Conduit)

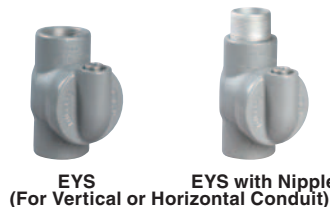

EYS  
(For Vertical or Horizontal Conduit)

EYS with Nipple  
(For Vertical or Horizontal Conduit)



EY  
(For Vertical Conduit)

EY with Nipple  
(For Vertical Conduit)



EYD  
(Drain/Seal for Vertical Conduit)

EYD with Nipple  
(Drain/Seal for Vertical Conduit)



ENY-2  
(Fixture Hanger)  
(See Page L146)

Class I, Div. 1 & 2, Groups A, B, C, D  
Class I, Zone 1, Groups IIC, IIB, IIA  
Class II, Div. 1 & 2, Groups E, F, G  
Class III

## FEATURES-SPECIFICATIONS

Application & Installation  
Class I, Divisions 1 and 2

The purpose of seals in a Class I hazardous location is to minimize the passage of gases and vapors and prevent the passage of flames from one electrical installation to another through the conduit system. Seals are required to be installed within 18 inches on any conduit run entering an enclosure which contains devices that may produce arcs, sparks, or high temperature. Where two enclosures are connected by a run of conduit not over 3 ft. long, a single seal located at the center of the run is considered satisfactory. Only explosionproof unions, couplings, elbows, and conduit bodies similar to "L", "T", and "X" type shall be permitted between the sealing fitting and the enclosure.

Seals shall be located within 18 inches of the enclosure or fitting on each conduit run of 2 inch size or larger entering an enclosure or fitting that contains terminals, splices, or taps.

Each run of conduit from a hazardous location to a nonhazardous location should be sealed to minimize the amount of gases and vapors communicated beyond the seal.

## Class II, Divisions 1 and 2

Where a raceway provides communication between an enclosure which is required to be dust-ignitionproof and one which is not, suitable means shall be provided to prevent the entrance of dust into the dust-ignitionproof enclosure through the raceway.

## Consideration for selection seals:

Select the proper sealing fitting for the hazardous gas/vapor involved; i.e., Class I Groups A, B, C, or D. Zone 1, Groups IIC, IIB, IIA, IIC.

Select a sealing fitting for the proper use in respect to mounting position. This is particularly critical when the conduit runs between hazardous and nonhazardous areas. Some seals are designed to be mounted in any position; others are restricted to vertical mounting.

## Drains


Where there is a probability that liquid or other condensed vapor may be trapped within enclosures for control equipment or at any point in the raceway system, approved means – such as installation of drain seals – shall be provided to prevent moisture accumulation.

For more complete data or special applications, consult the code or your local inspector.


Sealing compounds shall be approved for the purpose and shall not be affected by the surrounding atmosphere or liquids, and shall not have a melting point of less than 93°C. (200°F.).

In the complete seal, the minimum thickness of the sealing compound shall not be less than the trade size of the conduit, and in no case less than 5/8 inch.

**Note:** The amount of Killark sealing compound and packing fiber required for any seal is determined by volume hub size and mounting position of the seal. Refer to installation data table on page F50 for specific amounts required.

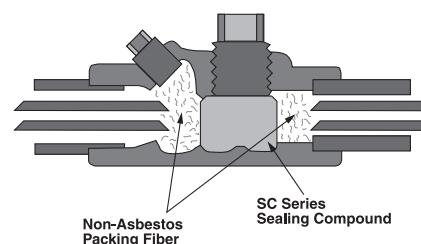

Schematic drawings illustrate the application of sealing compound, fiber dams, and installed seal with drain.

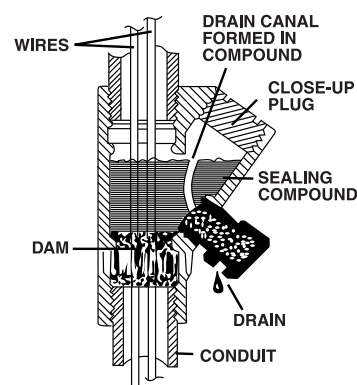

Splices and taps shall not be made in fittings intended only for sealing with compound, nor shall other fittings in which splices or taps are made be filled with compound.

Killark sealing fittings are produced with utmost care to insure a substantial margin of safety. Threads are clean, deep, and snug. When properly installed with Killark sealing compound (SC Type) and Killark non-asbestos fiber (PF Type) for the dams, you can be sure your installation will provide more than adequate safety.



Stock held in the UK by Scattergood & Johnson Ltd. Available for next day delivery.



# SCATTERGOOD & JOHNSON LTD

ELECTRICAL ENGINEERING & FLUID CONTROL DISTRIBUTORS

At Scattergood & Johnson Ltd, we pride ourselves on being a technical distributor to specialist industries.

Working with a range of quality product suppliers across a number of specialist markets, we are not your average 'box shifter' - we are your technical and supply chain partner.

We fully support every product we sell - for free! Our internal team and external sales engineers can answer any product or application question, no matter the complexity.

Backing up this technical ability is a range of 50,000+ products available from stock for nationwide next day delivery (same day if required!), or you can collect what you need from any of our trade counters around the UK.

Select your specialist interest below to learn more about how we can help.



Online, In Branch and On the Road - Scattergood & Johnson Ltd, there when you need us.

# [www.scatts.co.uk](http://www.scatts.co.uk)