

RAD-PT100-4-IFS



Ex n



I/O extension module, 4 temperature inputs (Pt 100)

Data sheet
105366_en_02

© PHOENIX CONTACT 2016-08-31

1 Description

The **RAD-PT100-4-IFS** I/O extension module can be used in conjunction with Radioline wireless modules and other Interface system (IFS) master devices. In a station structure, you can connect up to 32 I/O extension modules to a wireless module via the DIN rail connector.

The **RAD-PT100-4-IFS** I/O extension module is used for processing four Pt 100 input signals.

Features

- Easy and tool-free I/O mapping via thumb wheel on the front
- Modular design via DIN rail connector (hot-swap capable)
- Channel-to-channel electrical isolation
- Four Pt 100 inputs (-50°C ... +250°C)
- International approvals
- Installation in Ex zone 2



WARNING: Explosion hazard when used in potentially explosive areas

The device is a category 3 item of electrical equipment. Follow the instructions provided here during installation and observe the safety notes.



Make sure you always use the latest documentation.
It can be downloaded from the product at phoenixcontact.net/products.


| | | |
|----------|------------------------------------------------------------|----|
| 2 | Table of contents | |
| 1 | Description | 1 |
| 2 | Table of contents | 2 |
| 3 | Ordering data | 3 |
| 4 | Technical data | 4 |
| 5 | Safety regulations and installation notes..... | 7 |
| | 5.1 Installation notes | 7 |
| | 5.2 Installation in Zone 2..... | 8 |
| | 5.3 UL Notes | 8 |
| 6 | Installation | 9 |
| | 6.1 Structure | 9 |
| | 6.2 Basic circuit diagram | 9 |
| | 6.3 I/O MAP address in the Radioline wireless system | 10 |
| | 6.4 Network applications (operating mode) | 10 |
| | 6.5 Display and diagnostic elements | 11 |
| | 6.6 Temperature input (Pt 100) | 11 |
| | 6.7 Mounting and removing..... | 12 |
| | 6.8 Connecting cables | 13 |
| | 6.9 Connecting the sensors..... | 14 |
| 7 | Process data..... | 17 |
| 8 | Error codes and formats for Pt 100 values..... | 17 |

3 Ordering data

| Description | Type | Order No. | Pcs./Pkt. |
|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------------|-----------|-----------|
| Temperature I/O extension module with 4 PT 100 inputs (-50...+250 °C), with screw connection, including DIN rail connector | RAD-PT100-4-IFS | 2904035 | 1 |
| Accessories | Type | Order No. | Pcs./Pkt. |
| 2400 MHz wireless transceiver with RS-232, RS-485 2-wire interface, expandable with I/O extension modules, with screw connection, antenna connection: RSMA (female), including DIN rail connector, without antenna | RAD-2400-IFS | 2901541 | 1 |
| 868 MHz wireless transceiver with RS-232, RS-485 2-wire interface, expandable with I/O extension modules, with screw connection, antenna connection: RSMA (female), including DIN rail connector, without antenna | RAD-868-IFS | 2904909 | 1 |
| Bidirectional, Radioline 900 MHz transceiver for wireless transmission of serial and I/O data | RAD-900-IFS | 2901540 | 1 |
| DIN rail connector for DIN rail mounting. Universal for TBUS housing. Gold-plated contacts, 5-pos. Header, Nominal current: 8 A, Number of positions: 5, Pitch: 3.81 mm, Articles with gold-plated contacts, bus connectors for connecting with electronic housings | ME 17,5 TBUS 1,5/ 5-ST-3,81 GN | 2709561 | 10 |
| Analog I/O extension module with 4 analog current/voltage outputs (0/4 mA ... 20 mA, 0...10 V), with screw connection, incl. DIN rail connector | RAD-AO4-IFS | 2901538 | 1 |
| Multipoint multiplexer for RS-485 bus system, can be extended with I/O extension modules. Can be used as Modbus RTU bus coupler or combined with Radioline wireless system, screw connection. Up to 99 stations, including DIN rail connector | RAD-RS485-IFS | 2702184 | 1 |

4 Technical data

Dimensions

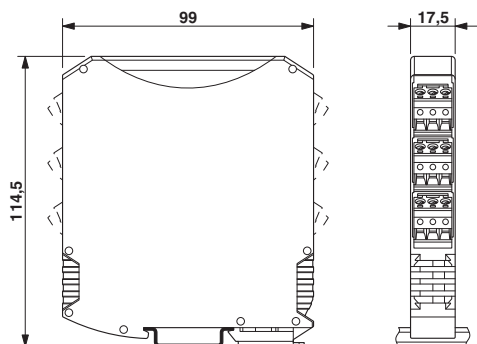

| | |
|------------------|----------------------------|
| Dimensions W/H/D | 17.5 mm / 99 mm / 114.5 mm |
|------------------|----------------------------|

General data

| | |
|--------------------------------------------------------------------------------------------------------------------------|-------------------------------------------------------------|
| Overvoltage category | II |
| Mounting position | any, on standard DIN rail NS 35 in accordance with EN 60715 |
| Degree of protection | IP20 |
| Degree of pollution | 2 |
| Type of housing | PA 6.6-FR, green |
| Flammability rating according to UL 94 | V0 |
| MTTF (mean time to failure) Telcordia standard, 25°C temperature, 21% operating cycle (5 days a week, 8 hours a day) | 1249 Years |
| MTTF (mean time to failure) Telcordia standard, 40°C temperature, 34.25% operating cycle (5 days a week, 12 hours a day) | 506 Years |
| MTTF (mean time to failure) Telcordia standard, temperature 40°C, operating cycle 100% (7 days a week, 24 hours a day) | 194 Years |

Supply

| | |
|----------------------------|----------------------------------------------|
| Supply voltage range | 19.2 V DC ... 30.5 V DC (DIN rail connector) |
| Max. current consumption | ≤ 38 mA (At 24 V DC, at 25°C) |
| Transient surge protection | Yes |

| Pt 100 input | |
|-----------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------|
| Number of inputs | 4 |
| Sensor input current | 1 mA (constant) |
| Temperature measuring range | -50 °C ... 250 °C |
| Connection method | 2, 3-wire |
| Max. permissible overall conductor resistance | 25 Ω |
| Process data channel | 16 Bit (per channel) |
| Electrical isolation | |
| Pt 100 inputs | 50 V (Rated insulation voltage (in each case between the Pt 100 inputs / TBUS supply, reinforced insulation in accordance with EN 61010)) |
| Neighboring devices | 300 V (Rated insulation voltage (to adjacent devices, basic insulation in accordance with EN 61010)) |
| Test voltage | |
| Pt 100 | 1.5 kV AC (50 Hz, 1 min.) |
| Connection data | |
| Connection method | Screw connection |
| Conductor cross section, solid | 0.2 mm ² ... 2.5 mm ² |
| Conductor cross section, flexible | 0.2 mm ² ... 2.5 mm ² |
| Conductor cross section AWG/kcmil | 24 ... 14 |
| Stripping length | 7 mm |
| Tightening torque | 0.6 Nm |
| Status indication | |
| Status display | Green LED (supply voltage, PWR) Green LED (bus communication, DAT) Red LED (periphery error, ERR) |
| Ambient conditions | |
| Ambient temperature (operation) | -40 °C ... 70 °C -40 °F ... 158 °F |
| Ambient temperature (storage/transport) | -40 °C ... 85 °C -40 °F ... 185 °F |
| Permissible humidity (operation) | 20 % ... 85 % |
| Permissible humidity (storage/transport) | 20 % ... 85 % |
| Altitude | 2000 m |
| Vibration (operation) | in accordance with IEC 60068-2-6: 5g, 10 Hz ... 150 Hz |
| Shock | 16g, 11 ms |

| Certification | |
|-----------------------------------------------------------------------------------|------------------------------------------------------------------------------------|
| Conformance | CE-compliant |
| ATEX Please follow the special installation instructions in the documentation! | Ⓜ II 3 G Ex nA IIC T4 Gc (IBExU 15 ATEX B008 X) |
| IECEX | Ex nA IIC T4 Gc (IECEX IBE 13.0019X) |
| UL, USA/Canada | UL 508 Listed Class I, Div. 2, Groups A, B, C, D T4A Class I, Zone 2, IIC T4 |

| Conformance | |
|--------------------------|----------------------------|
| EMC directive 2014/30/EU | EN 61000-6-2; EN 61000-6-4 |
| Ex directive (ATEX) | EN 60079-0; EN 60079-15 |

| Tolerances influenced by electromagnetic interference | | |
|---------------------------------------------------------------------|----------------------------------------------------------------------|----------|
| Type of electromagnetic interference | Typical deviation of the measuring range final value (current input) | |
| | Relative | Absolute |
| - | | |
| Electromagnetic fields according to EN 61000-4-3/ IEC 61000-4-3 | < ±0.35 % | ±0.6 °C |
| Conducted interference according to EN 61000-4-6/ IEC 61000-4-6 | < ±0.1 % | ±0.3 °C |
| Fast transients (burst) according to EN 61000-4-4/ IEC 61000-4-4 | < ±0.1 % | ±0.3 °C |

5 Safety regulations and installation notes



WARNING: Risk of electric shock

- Provide a switch/circuit breaker close to the device, which is labeled as the disconnect device for this device or the entire control cabinet.
- Disconnect the device from all power sources during maintenance work and configuration (the device can remain connected to SELV or PELV circuits).
- The housing of the device provides a basic insulation against the neighboring devices, for 300 V eff. If several devices are installed next to each other, this has to be taken into account, and additional insulation has to be installed if necessary. If the neighboring device is equipped with basic insulation, no additional insulation is necessary.

5.1 Installation notes



WARNING:

Observe the following safety notes when using the device.

- The category 3 device is designed for installation in zone 2 potentially explosive areas. It meets the requirements of EN 60079-0:2012+A11:2013 and EN 60079-15:2010.
- Installation, operation, and maintenance may only be carried out by qualified electricians. Follow the installation instructions as described.
- When installing and operating the device, the applicable regulations and safety directives (including national safety directives), as well as general technical regulations, must be observed. The technical data is provided in the package slip and on the certificates (conformity assessment, additional approvals where applicable).
- The device must not be opened or modified. Do not repair the device yourself, replace it with an equivalent device. Repairs may only be carried out by the manufacturer. The manufacturer is not liable for damage resulting from violation.
- The IP20 protection (IEC 60529/EN 60529) of the device is intended for use in a clean and dry environment. The device must not be subject to mechanical strain and/or thermal loads, which exceed the limits described.
- To protect the device against mechanical or electrical damage, install it in a suitable housing with appropriate degree of protection as per IEC 60529.
- The device complies with the EMC regulations for industrial areas (EMC class A). When using the device in residential areas, it may cause radio interference.
- The device is not designed for use in atmospheres with a danger of dust explosions.
- If dust is present, it is necessary to install into a suitable approved housing, whereby the surface temperature of the housing must be taken into consideration.

5.2 Installation in Zone 2

**WARNING: Explosion hazard when used in potentially explosive areas**

Please make sure that the following notes and instructions are observed.

- Observe the specified conditions for use in potentially explosive areas! Install the device in a suitable approved housing (with a minimum of IP54 protection) that meets the requirements of EN 60079-15. Observe the requirements of EN 60079-14.
- In zone 2, only connect devices to the supply and signal circuits that are suitable for operation in the Ex zone 2 and the conditions at the installation location.
- In potentially explosive areas, terminals may only be snapped onto or off the DIN rail connector and wires may only be connected or disconnected when the power is switched off.
- The switches of the device that can be accessed may only be actuated when the power supply to the device is disconnected.
- The device must be stopped and immediately removed from the Ex area if it is damaged, was subject to an impermissible load, stored incorrectly or if it malfunctions.

5.3 UL Notes

INDUSTRIAL CONTROL EQUIPMENT FOR HAZARDOUS LOCATIONS 45FP

- A This equipment is suitable for use in Class I, Zone 2, IIC T4 and Class I, Division 2, Groups A, B, C, D T4A hazardous locations or non-hazardous locations only.
- B **WARNING - EXPLOSION HAZARD - DO NOT DISCONNECT EQUIPMENT UNLESS POWER HAS BEEN SWITCHED OFF OR THE AREA IS KNOWN TO BE NON-HAZARDOUS.**
- C **WARNING - EXPLOSION HAZARD - SUBSTITUTION OF COMPONENTS MAY IMPAIR SUITABILITY FOR CLASS 1, DIVISION 2.**
- D These devices are open-type devices that are to be installed in an enclosure suitable for the environment that is only accessible with the use of a tool.
- E **WARNING - Exposure to some chemicals may degrade the sealing properties of materials used in relays within this device.**

6 Installation



NOTE: electrostatic discharge!

The device contains components that can be damaged or destroyed by electrostatic discharge. When handling the device, observe the necessary safety precautions against electrostatic discharge (ESD) according to EN 61340-5-1 and IEC 61340-5-1.

6.1 Structure

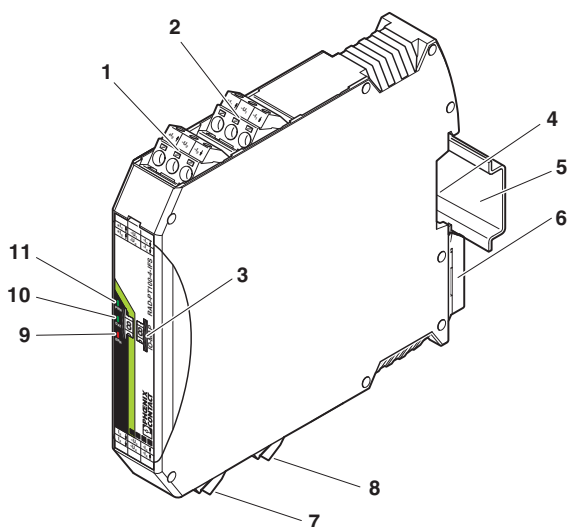


Figure 1 RAD-PT100-4-IFS

| Pos. | Terminal block | Designation |
|------|-----------------|--------------------------------------------------|
| 1 | 3.1 / 3.2 / 3.3 | Pt 100 input 2 for 2- and 3-wire sensors |
| 2 | 2.1 / 2.2 / 2.3 | Pt 100 input 1 for 2- and 3-wire sensors |
| 3 | | White thumbwheel for setting the I/O-MAP address |
| 4 | | Connection option for DIN rail connector |
| 5 | | DIN rail |
| 6 | | Metal foot catch for DIN rail fixing |
| 7 | 4.1 / 4.2 / 4.3 | Pt 100 input 3 for 2- and 3-wire sensors |
| 8 | 5.1 / 5.2 / 5.3 | Pt 100 input 4 for 2- and 3-wire sensors |
| 9 | | ERR status LED, red (communication error) |
| 10 | | DAT status LED, green (BUS communication) |
| 11 | | PWR status LED, green (supply voltage) |

6.2 Basic circuit diagram

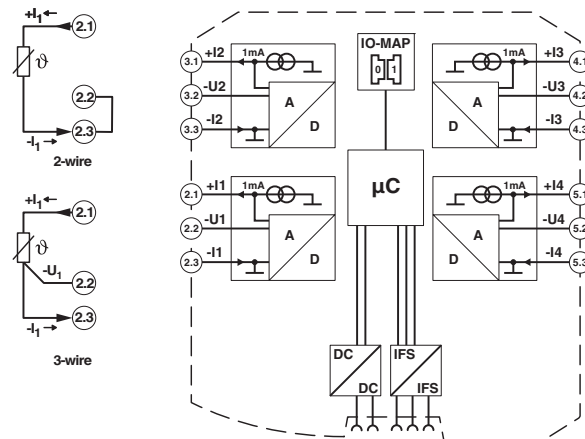


Figure 2 RAD-PT100-4-IFS basic circuit diagram

6.3 I/O MAP address in the Radioline wireless system

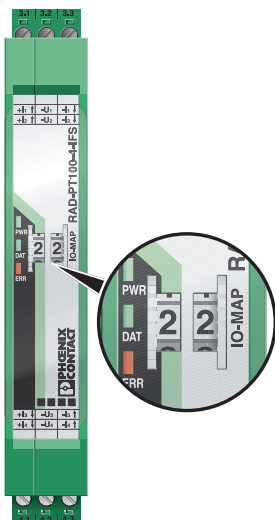


Figure 3 Thumb wheel

Use the thumbwheel to set the I/O-MAP address. The extension module in the Radioline wireless system is addressed using the I/O-MAP address.

On the entire wireless network, addresses 1 to 99 (I/O MAP) (maximum) may be assigned for the I/O extension modules.



The I/O MAP address of an input module may only appear once in the network.

| Thumbwheel | Description |
|--------------|------------------------------------------------------------------------------------------|
| 01 - 99 | I/O MAP address |
| 00 | Delivery state |
| ** , 1* - 9* | Setting not permitted |
| *1 - *9 | Interface System slave address, for use with other Interface System (IFS) master devices |

6.4 Network applications (operating mode)

You can set the network application of the wireless module with the PSI-CONF software. All Radioline wireless modules are set to I/O data mode (wire in/wire out) by default.

Radioline wireless module in I/O data mode

The input device must be provided with the same I/O MAP address as the assigned output device at the other Radioline wireless station (I/O mapping).

| Example: | I/O MAP address |
|-----------------|-----------------|
| RAD-PT100-4-IFS | 02 |
| RAD-AO4-IFS | 02 |

Only the RAD-AO4-IFS module can be assigned to the RAD-PT100-4-IFS module.

The Pt 100 inputs, T1 ... T4, can be configured to the analog outputs I1/U1 ... I4/U4 of the RAD-AO4-IFS extension module.

| Pt 100 input | Analog output |
|--------------|---------------|
| -50°C | 0 mA or 0 V |
| +250°C | 20 mA or 10 V |

Radioline wireless module in PLC/Modbus RTU mode

The I/O MAP address of an input module may only appear once in the network.

The input data is saved in a Modbus memory map in the Radioline master wireless module. You can read or write the process data via the serial interface of the master wireless module (RAD-ID = 01) using the Modbus RTU commands (see Section 7).

6.5 Display and diagnostic elements

The I/O extension module uses a total of three LEDs to indicate the operating states.

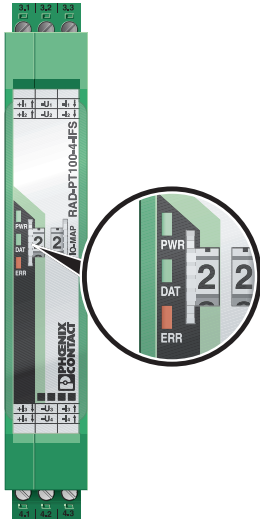


Figure 4 Display and diagnostic elements

PWR LED

The green PWR LED indicates the supply voltage status.

- OFF No supply voltage
- ON Supply voltage OK

DAT LED

The green DAT LED indicates the bus communication status.

- OFF No communication
- Flashing Configuration and addressing mode
- ON Cyclic data communication

ERR LED

The red ERR LED indicates the error status, e.g., no corresponding output module found (e.g., incorrect addressing).

- OFF No error
- Flashing Slow (1.4 Hz) I/O-MAP address changed
- Fast (2.8 Hz) No bus communication
- ON Critical internal error

6.6 Temperature input (Pt 100)

The Pt 100 inputs of the extension module can process temperatures from -50 °C ... +250 °C.

All the inputs are electrically isolated from one another, from the supply voltage (via bus foot), and from other electronic components.

Pt 100 resistance thermometers can be connected to the RAD-PT100-4-IFS I/O extension module. The thermometers change their resistance depending on the temperature. The Pt 100 input signals are acquired by the RAD-PT100-4-IFS and can be mapped to proportional, analog voltage or current signals of the RAD-AO4-IFS output module. Thus, conclusions can be made about the temperature via the standard analog signal.

$1\text{ °C} \cong 66.66\text{ }\mu\text{A}$

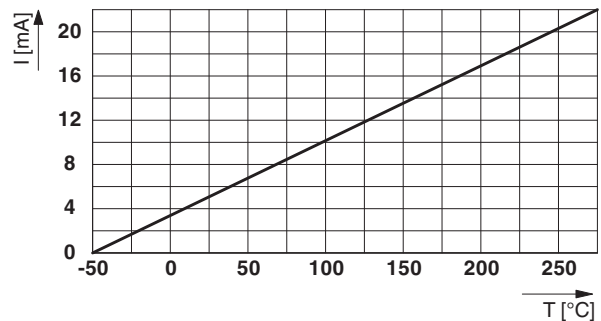


Figure 5 Current strength [mA] depending on the temperature [°C]

6.7 Mounting and removing

Connection station with I/O extension modules

Up to 32 different I/O extension modules can be connected to every wireless module via the DIN rail connector (see accessories). Data is transmitted and power is supplied to the I/O extension modules via the bus foot.

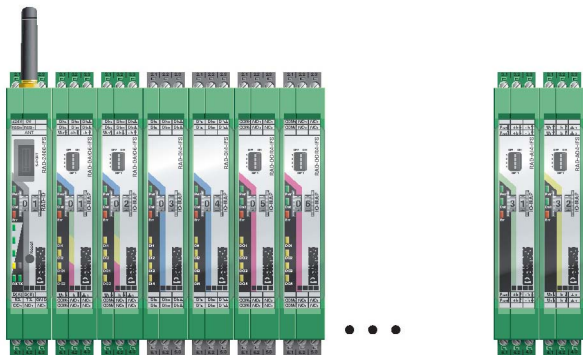


Figure 6 Radioline connection station with up to 32 I/O extension modules



Only mount the I/O extension modules to the right of the wireless module.

Assembly

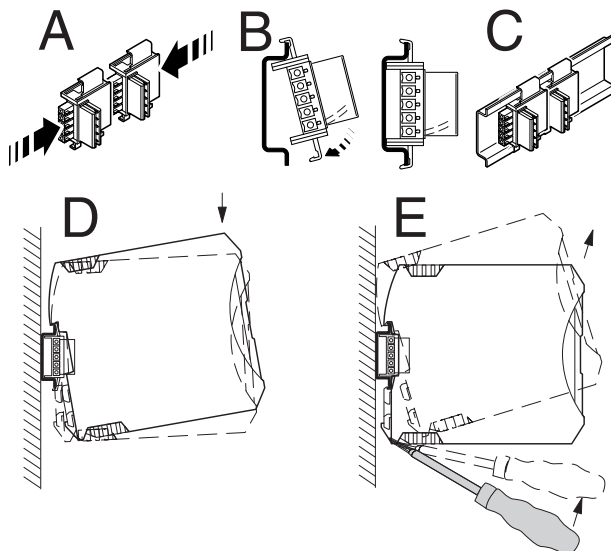


Figure 7 Mounting and removing

When using the device in a connection station, use the 17.5 mm wide DIN rail connector supplied. Only use the DIN rail connector in connection with 24 V DC devices.



Outside the Ex area, module extension or module replacement is also possible during operation.

- Connect the DIN rail connectors together for a connection station.
- Push the connected DIN rail connectors into the DIN rail.
- Place the device onto the DIN rail from above. Ensure the device and DIN rail connector are aligned correctly.
- Holding the device by the housing cover, carefully push the device towards the mounting surface so that the device bus connector is securely fixed onto the DIN rail connector.
- Once the snap-on foot has been audibly snapped onto the DIN rail, check that it is fixed securely. The device is only mechanically secured via the DIN rail.
- Connect the desired number of I/O extension modules to the wireless module via the DIN rail connector.
- In order to meet the requirements for the protection class, install the device in suitable housing.
- During startup, check that the device is operating, wired, and marked correctly.
- You can establish a connection between two DIN rail connectors using MINI COMBICON connectors: MC 1,5/5-ST-3,81 (female, 1803604); IMC 1,5/5-ST-3,81 (male, 1857919).

Removing

- Use a suitable screwdriver to release the locking mechanism on the snap-on foot of the device.
- Hold onto the device by the housing cover and carefully tilt it upwards.
- Carefully lift the device off the DIN rail connector and the DIN rail.

6.8 Connecting cables

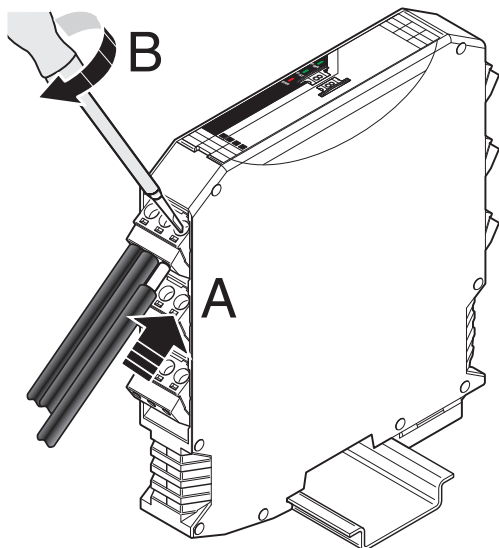


Figure 8 Connecting cables

- Crimp ferrules to the wires.
Permissible cable cross section: 0.2...2.5 mm².
- Insert the wire with ferrule into the corresponding connection terminal block.
- Use a screwdriver to tighten the screw in the opening above the connection terminal block.
Tightening torque: 0.6 Nm

3-wire connection method

For long distances between the PT 100 sensor and the extension module. To compensate the wire resistances, all wire resistances must have exactly the same values ($R_{L1} = R_{L2} = R_{L3}$).

- Connect the Pt 100 sensor to terminals x.1, x.2, and x.3.

With 3-wire connection technology, the temperature-related voltage is measured several times. Corresponding calculations additionally reduce the effect of the cable resistance on the measurement result. The results are almost as good as those achieved using 4-wire technology.

The cable resistances R_L at terminals +I and -I must have the same value. This allows you to subtract the established cable resistance from the measurement result and to get the Pt 100 platinum resistance value.

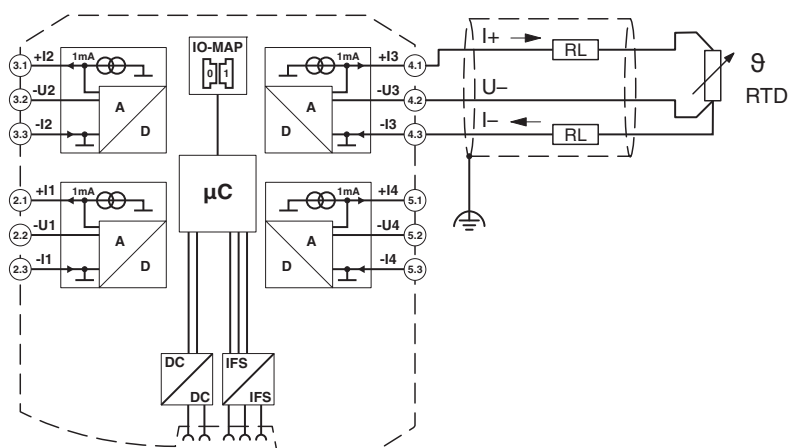


Figure 10 3-wire connection method



SCATTERGOOD & JOHNSON LTD

ELECTRICAL ENGINEERING & FLUID CONTROL DISTRIBUTORS

Est.1899


At Scattergood & Johnson Ltd, we pride ourselves on being a technical distributor to specialist industries.

Working with a range of quality product suppliers across a number of specialist markets, we are not your average 'box shifter' - we are your technical and supply chain partner.

We fully support every product we sell - for free! Our internal team and external sales engineers can answer any product or application question, no matter the complexity.

Backing up this technical ability is a range of 50,000+ products available from stock for nationwide next day delivery (same day if required!), or you can collect what you need from any of our trade counters around the UK.

Select your specialist interest below to learn more about how we can help.

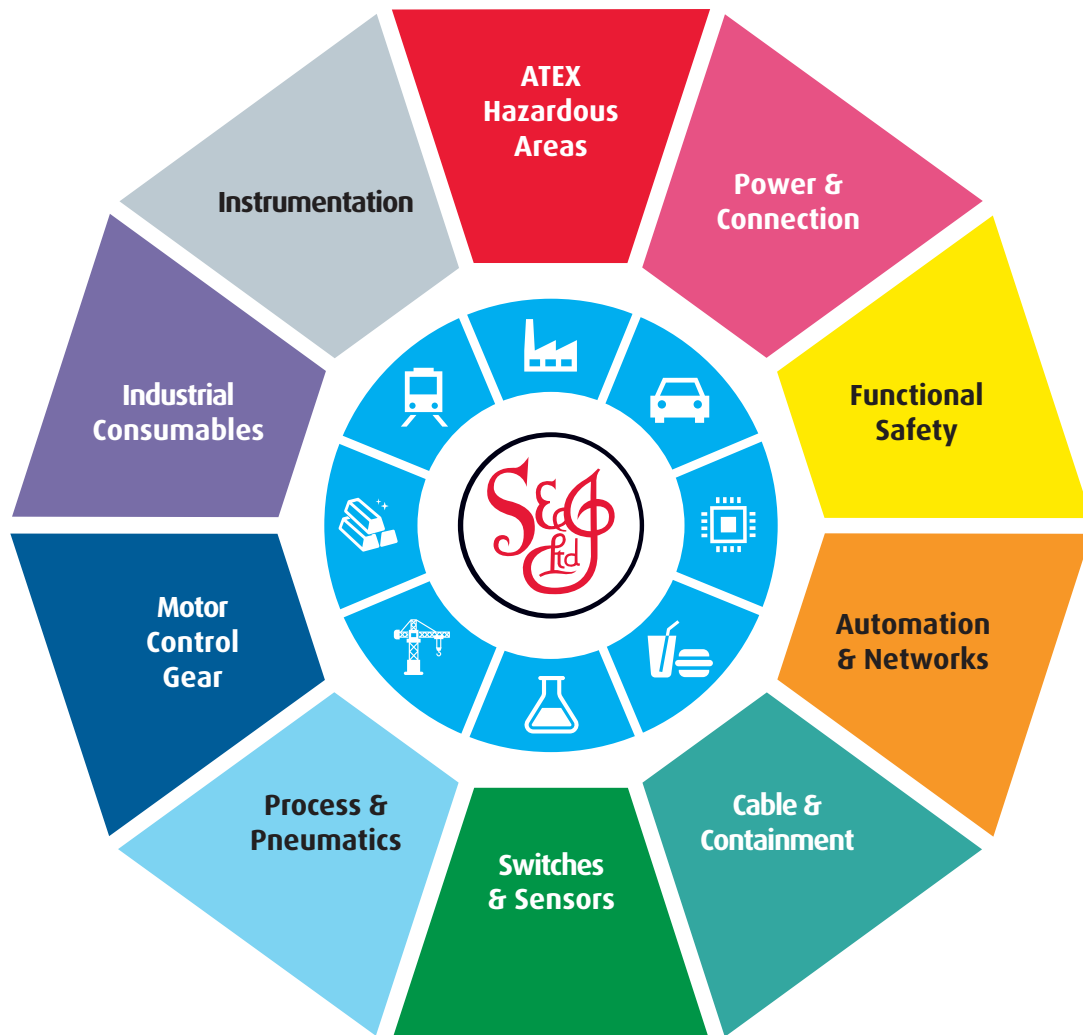

Online, In Branch and On the Road - Scattergood & Johnson Ltd, there when you need us.

www.scatts.co.uk