

# PSR-MS and PSR-MC

## Applications using PSR-MS and PSR-MC safety relays from the PSRmini product range

Application note  
106509\_en\_01

© PHOENIX CONTACT 2015-08-27



### 1 Description

Our PSR safety relays demonstrate that innovative safety solutions do not necessarily have to be complex in order to meet the high requirements of machine building and systems manufacturing.

As well as offering easy integration and handling, the modules are characterized by their compact, space-saving design as well as their high quality, safety, and reliability.

In particular, safety applications can be implemented under optimum cost-benefit conditions with the new PSRmini safety relay range.

### Solutions for all common applications

Use the PSRmini safety relays, for example, to implement monitoring of the following safety equipment:

- Emergency stop
- Safety door
- Light grid
- Magnetic switch

#### PSR-MS

- Single or two-channel control
- 1 enabling current path
- 6.8 mm housing width

#### PSR-MC

- Single or two-channel control
- 2 or 3 enabling current paths
- 12.5 mm housing width



Make sure you always use the latest documentation.  
It can be downloaded at [phoenixcontact.net/products](http://phoenixcontact.net/products).



This document is valid for the products listed in the "Ordering data".

**PSR-MS and PSR-MC**

---

**Table of contents**

|                                                                 |    |
|-----------------------------------------------------------------|----|
| Description .....                                               | 1  |
| Ordering data .....                                             | 5  |
| Documentation .....                                             | 6  |
| Applications with the PSR-MS20 .....                            | 7  |
| Emergency stop monitoring/automatic start .....                 | 7  |
| Safety door monitoring/automatic start .....                    | 7  |
| Connection to failsafe controller/automatic start .....         | 8  |
| Applications with the PSR-MS25 .....                            | 9  |
| Emergency stop monitoring/manual, monitored start .....         | 9  |
| Safety door monitoring/manual, monitored start .....            | 9  |
| Connection to failsafe controller/manual, monitored start ..... | 10 |
| Applications with the PSR-MS30 .....                            | 11 |
| Emergency stop monitoring/automatic start .....                 | 11 |
| Safety door monitoring/automatic start .....                    | 11 |
| Magnetic switch monitoring/automatic start .....                | 12 |
| Applications with the PSR-MS35 .....                            | 13 |
| Emergency stop monitoring/manual, monitored start .....         | 13 |
| Safety door monitoring/manual, monitored start .....            | 13 |
| Magnetic switch monitoring/manual, monitored start .....        | 14 |
| Applications with the PSR-MS40 .....                            | 15 |
| Emergency stop monitoring/automatic start .....                 | 15 |
| Safety door monitoring/automatic start .....                    | 15 |
| Magnetic switch monitoring/automatic start .....                | 16 |
| Applications with the PSR-MS45 .....                            | 17 |
| Emergency stop monitoring/manual, monitored start .....         | 17 |
| Safety door monitoring/manual, monitored start .....            | 17 |
| Magnetic switch monitoring/manual, monitored start .....        | 18 |
| Applications with the PSR-MS50 .....                            | 19 |
| Magnetic switch monitoring/automatic start .....                | 19 |
| Applications with the PSR-MS55 .....                            | 19 |
| Magnetic switch monitoring/manual, monitored start .....        | 19 |
| Applications with the PSR-MS60 .....                            | 20 |
| Light grid monitoring/automatic start .....                     | 20 |
| Two-channel control via LPSDO module .....                      | 20 |
| Single-channel control via failsafe controller .....            | 21 |
| Applications with the PSR-MC20 .....                            | 22 |
| Emergency stop monitoring/automatic start .....                 | 22 |
| Emergency stop monitoring/manual, monitored start .....         | 22 |
| Safety door monitoring/automatic start .....                    | 23 |

|                                                                                      |           |
|--------------------------------------------------------------------------------------|-----------|
| Safety door monitoring/manual, monitored start .....                                 | 23        |
| Connection to failsafe controller/automatic start .....                              | 24        |
| <b>Applications with the PSR-MC30 .....</b>                                          | <b>25</b> |
| Emergency stop monitoring/automatic start .....                                      | 25        |
| Emergency stop monitoring/manual, monitored start .....                              | 25        |
| Safety door monitoring/automatic start .....                                         | 26        |
| Safety door monitoring/automatic start/without cross-circuit detection .....         | 26        |
| Single-channel safety door monitoring/automatic start .....                          | 27        |
| Safety door monitoring/manual, monitored start .....                                 | 27        |
| Safety door monitoring/manual, monitored start/without cross-circuit detection ..... | 28        |
| Single-channel safety door monitoring/manual, monitored start .....                  | 28        |
| Magnetic switch monitoring/automatic start .....                                     | 29        |
| Magnetic switch monitoring/manual, monitored start .....                             | 29        |
| <b>Applications with the PSR-MC34 .....</b>                                          | <b>30</b> |
| Emergency stop monitoring/automatic start .....                                      | 30        |
| Emergency stop monitoring/manual, monitored start .....                              | 30        |
| Safety door monitoring/automatic start .....                                         | 31        |
| Safety door monitoring/automatic start/without cross-circuit detection .....         | 31        |
| Single-channel safety door monitoring/automatic start .....                          | 32        |
| Safety door monitoring/manual, monitored start .....                                 | 32        |
| Safety door monitoring/manual, monitored start/without cross-circuit detection ..... | 33        |
| Single-channel safety door monitoring/manual, monitored start .....                  | 33        |
| Magnetic switch monitoring/automatic start .....                                     | 34        |
| Magnetic switch monitoring/manual, monitored start .....                             | 34        |
| <b>Applications with the PSR-MC40 .....</b>                                          | <b>35</b> |
| Emergency stop monitoring/automatic start .....                                      | 35        |
| Emergency stop monitoring/manual, monitored start .....                              | 35        |
| Safety door monitoring/automatic start .....                                         | 36        |
| Safety door monitoring/manual, monitored start .....                                 | 36        |
| Single-channel safety door monitoring/automatic start .....                          | 37        |
| Single-channel safety door monitoring/manual, monitored start .....                  | 37        |
| Connection to failsafe controller/automatic start .....                              | 38        |
| Connection to failsafe controller/manual, monitored start .....                      | 38        |
| Single-channel connection to failsafe controller/automatic start .....               | 39        |
| Single-channel connection to failsafe controller/manual, monitored start .....       | 39        |
| Light grid monitoring/automatic start .....                                          | 40        |
| Light grid monitoring/manual, monitored start .....                                  | 40        |
| Transponder monitoring/automatic start .....                                         | 41        |
| Transponder monitoring/manual, monitored start .....                                 | 41        |
| <b>Applications with the PSR-MC50 .....</b>                                          | <b>42</b> |
| Magnetic switch monitoring/automatic start .....                                     | 42        |
| Magnetic switch monitoring/manual, monitored start .....                             | 42        |
| Safety door monitoring/automatic start .....                                         | 43        |
| Safety door monitoring/manual, monitored start .....                                 | 43        |

**PSR-MS and PSR-MC**

---

|                        |    |
|------------------------|----|
| Revision history ..... | 44 |
|------------------------|----|

## 2 Ordering data

### Application note

Applications using PSR-MS and PSR-MC safety relays from the PSRmini product range

Designation: AH EN PSR-MS / PSR-MC  
 Revision: 01  
 MNR/Revision: 52007563/00

### PSR-MS

| Description                                                                                                                                                                                                                                                                      | Type                     | Order No. | Pcs. / Pkt. |
|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------|-----------|-------------|
| Safety relay for emergency stop and safety doors up to SIL 1, SILCL 1, Cat. 1, PL c, depending on the application up to SIL 3, SILCL 3, Cat. 4, PL e, 1-channel operation, automatic start, 1 enabling current path, $U_S = 24\text{ V DC}$ , fixed screw terminal block         | PSR-MS20-1NO-1DO-24DC-SC | 2904950   | 1           |
| Safety relay for emergency stop and safety doors up to SIL 1, SILCL 1, Cat. 1, PL c, depending on the application up to SIL 3, SILCL 3, Cat. 4, PL e, 1-channel operation, manual, monitored start, 1 enabling current path, $U_S = 24\text{ V DC}$ , fixed screw terminal block | PSR-MS25-1NO-1DO-24DC-SC | 2904951   | 1           |
| Safety relay for emergency stop and safety doors up to SIL 3, SILCL 3, Cat. 4, PL e, 2-channel operation, automatic start, cross-circuit detection, 1 enabling current path, $U_S = 24\text{ V DC}$ , fixed screw terminal block                                                 | PSR-MS30-1NO-24DC-SC     | 2904952   | 1           |
| Safety relay for emergency stop and safety doors up to SIL 3, SILCL 3, Cat. 4, PL e, 2-channel operation, manual, monitored start, cross-circuit detection, 1 enabling current path, $U_S = 24\text{ V DC}$ , fixed screw terminal block                                         | PSR-MS35-1NO-24DC-SC     | 2904953   | 1           |
| Safety relay for emergency stop and safety doors up to SIL 3, SILCL 3, Cat. 4, PL e, 2-channel operation, automatic start, 1 enabling current path, $U_S = 24\text{ V DC}$ , fixed screw terminal block                                                                          | PSR-MS40-1NO-1DO-24DC-SC | 2904954   | 1           |
| Safety relay for emergency stop and safety doors up to SIL 3, SILCL 3, Cat. 4, PL e, 2-channel operation, manual, monitored start, 1 enabling current path, $U_S = 24\text{ V DC}$ , fixed screw terminal block                                                                  | PSR-MS45-1NO-1DO-24DC-SC | 2904955   | 1           |
| Safety relay for monitoring non-equivalent signal generators up to SIL 3, SILCL 3, Cat. 4, PL e, 2-channel, non-equivalent operation, automatic start, 1 enabling current path, $U_S = 24\text{ V DC}$ , fixed screw terminal block                                              | PSR-MS50-1NO-1DO-24DC-SC | 2904956   | 1           |
| Safety relay for monitoring non-equivalent signal generators up to SIL 3, SILCL 3, Cat. 4, PL e, 2-channel, non-equivalent operation, manual, monitored start, 1 enabling current path, $U_S = 24\text{ V DC}$ , fixed screw terminal block                                      | PSR-MS55-1NO-1DO-24DC-SC | 2904957   | 1           |
| Safety relay for emergency stop, safety doors and light grids up to SIL 3, SILCL 3, Cat. 4, PL e, 2-channel operation, automatic start, 2 enabling current paths (1-channel), $U_S = 24\text{ V DC}$ , fixed screw terminal block                                                | PSR-MS60-2NO-24DC-SC     | 2904958   | 1           |

### PSR-MC

| Description                                                                                                                                                                                                                                                                              | Type                     | Order No. | Pcs. / Pkt. |
|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------|-----------|-------------|
| Safety relay for emergency stop and safety doors up to SIL 1, SILCL 1, Cat. 1, PL c, depending on the application up to SIL 3, SILCL 3, Cat. 4, PL e, 1-channel operation, automatic/manual start, 3 enabling current paths, $U_S = 24\text{ V DC}$ , plug-in screw terminal block       | PSR-MC20-3NO-1DO-24DC-SC | 2700466   | 1           |
| Safety relay for emergency stop and safety doors up to SIL 1, SILCL 1, Cat. 1, PL c, depending on the application up to SIL 3, SILCL 3, Cat. 4, PL e, 1-channel operation, automatic/manual start, 3 enabling current paths, $U_S = 24\text{ V DC}$ , plug-in spring-cage terminal block | PSR-MC20-3NO-1DO-24DC-SP | 2700467   | 1           |
| Safety relay for emergency stop and safety doors up to SIL 3, SILCL 3, Cat. 4, PL e, 2-channel operation, automatic or manual, monitored start, cross-circuit detection, 2 enabling current paths, $U_S = 24\text{ V DC}$ , plug-in screw terminal block                                 | PSR-MC30-2NO-1DO-24DC-SC | 2700498   | 1           |

## PSR-MS and PSR-MC

| Description                                                                                                                                                                                                                                            | Type                     | Order No. | Pcs. / Pkt. |
|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------|-----------|-------------|
| Safety relay for emergency stop and safety doors up to SIL 3, SILCL 3, Cat. 4, PL e, 2-channel operation, automatic or manual, monitored start, cross-circuit detection, 2 enabling current paths, Us = 24 V DC, plug-in spring-cage terminal block    | PSR-MC30-2NO-1DO-24DC-SP | 2700499   | 1           |
| Safety relay for emergency stop and safety doors up to SIL 3, SILCL 3, Cat. 4, PL e, 2-channel operation, automatic or manual, monitored start, cross-circuit detection, 3 enabling current paths, Us = 24 V DC, plug-in screw terminal block          | PSR-MC34-3NO-1DO-24DC-SC | 2700540   | 1           |
| Safety relay for emergency stop and safety doors up to SIL 3, SILCL 3, Cat. 4, PL e, 2-channel operation, automatic or manual, monitored start, cross-circuit detection, 3 enabling current paths, Us = 24 V DC, plug-in spring-cage terminal block    | PSR-MC34-3NO-1DO-24DC-SP | 2700548   | 1           |
| Safety relay for emergency stop, safety doors and light grids up to SIL 3, SILCL 3, Cat. 4, PL e, 2-channel operation, automatic or manual, monitored start, 3 enabling current paths, Us = 24 V DC, plug-in screw terminal block                      | PSR-MC40-3NO-1DO-24DC-SC | 2700569   | 1           |
| Safety relay for emergency stop, safety doors and light grids up to SIL 3, SILCL 3, Cat. 4, PL e, 2-channel operation, automatic or manual, monitored start, 3 enabling current paths, Us = 24 V DC, plug-in spring-cage terminal block                | PSR-MC40-3NO-1DO-24DC-SP | 2700570   | 1           |
| Safety relay for monitoring non-equivalent signal generators up to SIL 3, SILCL 3, Cat. 4, PL e, 2-channel, non-equivalent operation, automatic or manual, monitored start, 3 enabling current paths, Us = 24 V DC, plug-in screw terminal block       | PSR-MC50-3NO-1DO-24DC-SC | 2700553   | 1           |
| Safety relay for monitoring non-equivalent signal generators up to SIL 3, SILCL 3, Cat. 4, PL e, 2-channel, non-equivalent operation, automatic or manual, monitored start, 3 enabling current paths, Us = 24 V DC, plug-in spring-cage terminal block | PSR-MC50-3NO-1DO-24DC-SP | 2700564   | 1           |

## 3 Documentation



Further documentation for individual products can be downloaded at [phoenixcontact.net/products](https://phoenixcontact.net/products).

**Key:**

S1 = Emergency-stop button  
B1 = Mechanical safety door switch  
K1/K2 = Contactors

- Single-channel emergency stop monitoring
- Automatic start
- Monitoring of external contactors
- Suitable up to category 1, PL c (EN ISO 13849-1), SIL 1 (EN 62061)



Contactor K2 is not essential in order to achieve category 1.

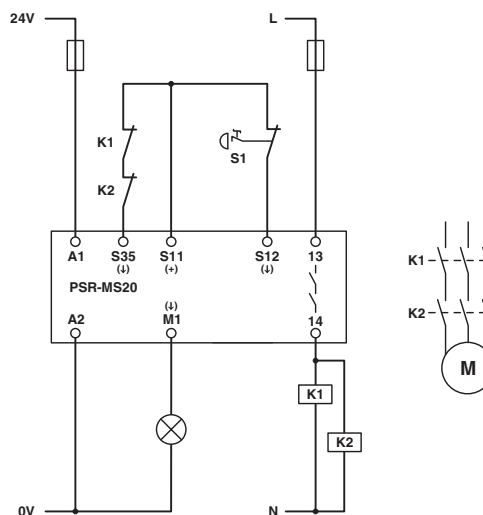


Figure 1 Emergency stop monitoring/automatic start

- Single-channel safety door monitoring
- Automatic start
- Monitoring of external contactors
- Suitable up to category 1, PL c (EN ISO 13849-1), SIL 1 (EN 62061)



Contactor K2 is not essential in order to achieve category 1.

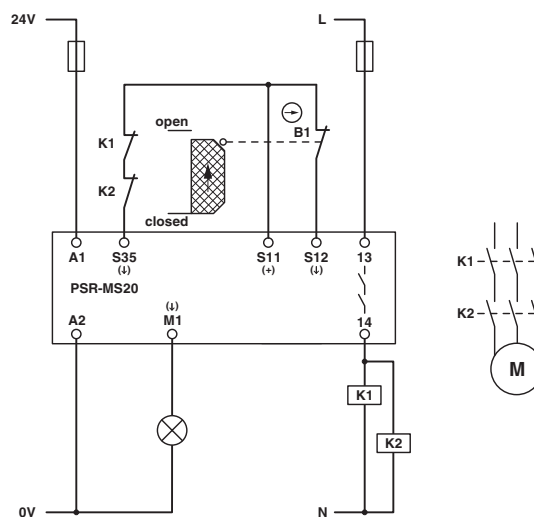


Figure 2 Safety door monitoring/automatic start

## PSR-MS and PSR-MC

### 4.3 Connection to failsafe controller/automatic start

- Automatic start
- Monitoring of external contactors
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if the digital output of the safety-related controller meets PL e, SIL 3, and cross-circuits can be ruled out



**WARNING: Loss of functional safety!**

Make sure that the signal generator (e.g., PLC output card or light grid) and the safety relay have the same ground potential.



Cross-circuits in the cable installation can be excluded if the failsafe PLC, safety relay, and external contactors K1 and K2 are located in the same electrical installation space.

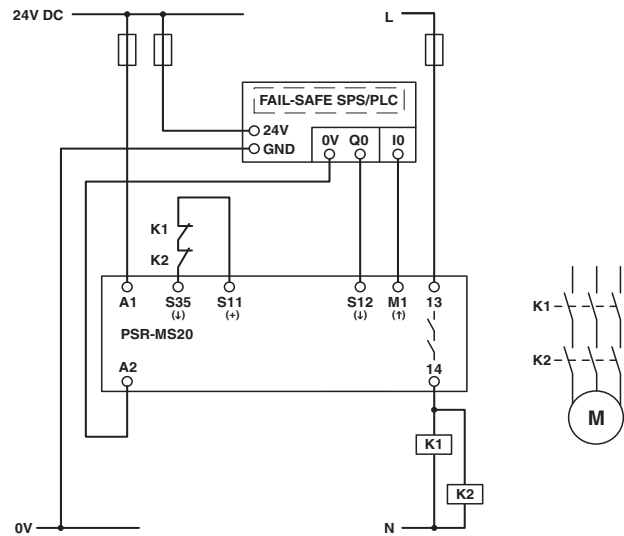


Figure 3 Connection to failsafe PLC/automatic start

## 5 Applications with the PSR-MS25

### Key:

- S1 = Emergency-stop button
- S2 = Manual reset device
- B1 = Mechanical safety door switch
- K1/K2 = Contactors

### 5.1 Emergency stop monitoring/manual, monitored start

- Single-channel emergency stop monitoring
- Manual, monitored start
- Monitoring of external contactors
- Suitable up to category 1, PL c (EN ISO 13849-1), SIL 1 (EN 62061)



Contactors K2 is not essential in order to achieve category 1.

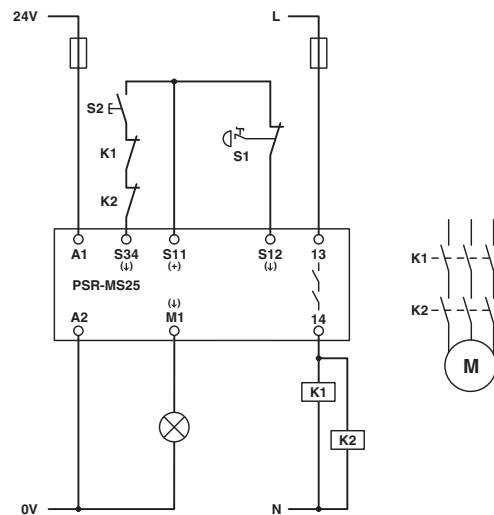


Figure 4 Emergency stop monitoring/manual, monitored start

### 5.2 Safety door monitoring/manual, monitored start

- Single-channel safety door monitoring
- Manual, monitored start
- Monitoring of external contactors
- Suitable up to category 1, PL c (EN ISO 13849-1), SIL 1 (EN 62061)



Contactors K2 is not essential in order to achieve category 1.

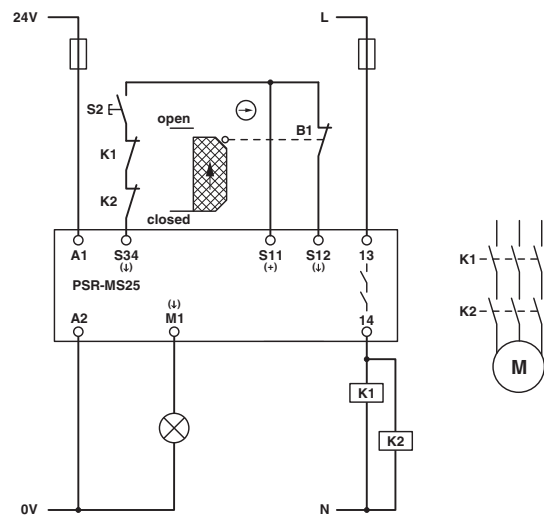


Figure 5 Safety door monitoring/manual, monitored start

## PSR-MS and PSR-MC

### 5.3 Connection to failsafe controller/manual, monitored start

- Manual, monitored start
- Monitoring of external contactors
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if the digital output of the safety-related controller meets PL e, SIL 3, and cross-circuits can be ruled out



**WARNING: Loss of functional safety!**

Make sure that the signal generator (e.g., PLC output card or light grid) and the safety relay have the same ground potential.



Cross-circuits in the cable installation can be excluded if the failsafe PLC, safety relay, and external contactors K1 and K2 are located in the same electrical installation space.

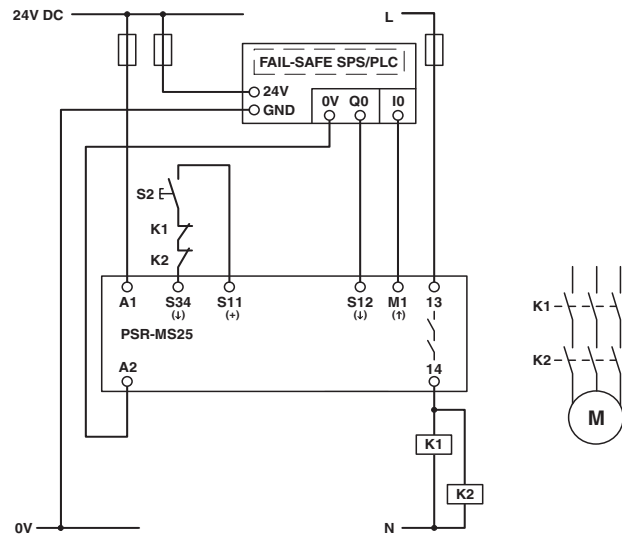


Figure 6 Connection to failsafe PLC/manual, monitored start

## 6 Applications with the PSR-MS30

### Key:

- S1 = Emergency-stop button  
 S3 = Magnetic switch  
 B1/B2 = Mechanical safety door switches  
 K1/K2 = Contactors



Cross-circuits in the cable installation can be excluded if the safety relay and external contactors K1 and K2 are located in the same electrical installation space.

### 6.1 Emergency stop monitoring/automatic start

- Two-channel emergency stop monitoring
- Automatic start
- Monitoring of external contactors
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator can be ruled out

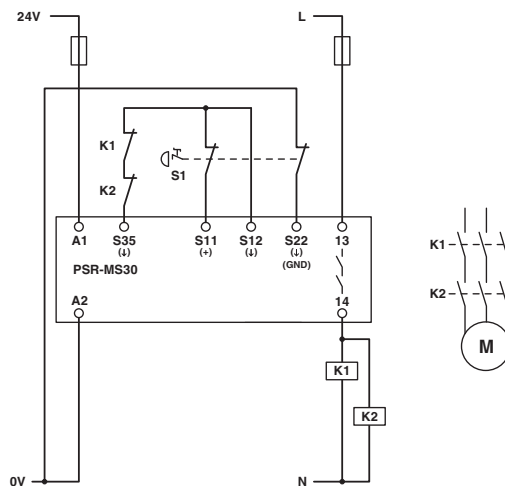


Figure 7 Emergency stop monitoring/automatic start

### 6.2 Safety door monitoring/automatic start

- Two-channel safety door monitoring
- Automatic start
- Monitoring of external contactors
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator can be ruled out

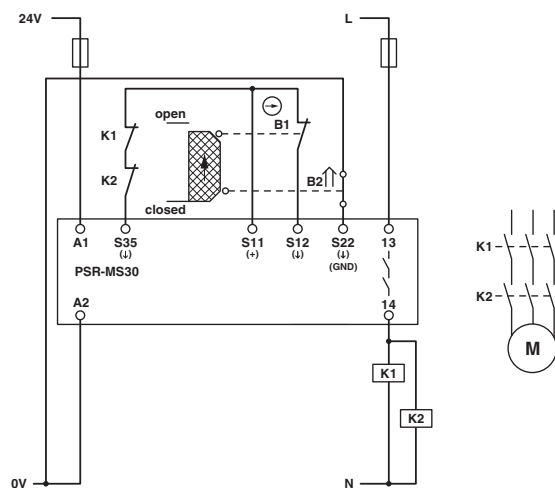


Figure 8 Safety door monitoring/automatic start

## PSR-MS and PSR-MC

### 6.3 Magnetic switch monitoring/automatic start

- Two-channel magnetic switch monitoring
- Automatic start
- Monitoring of external contactors
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator can be ruled out

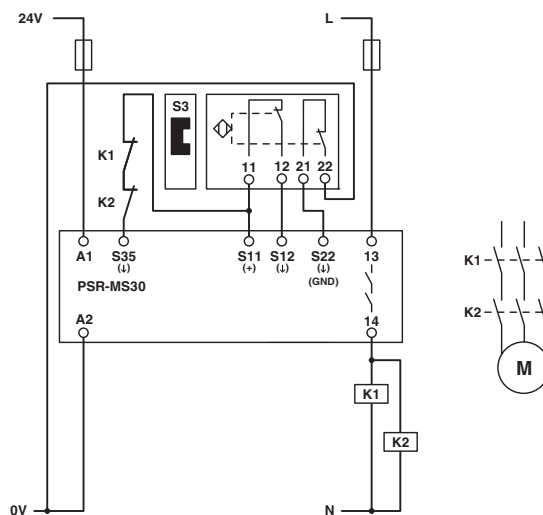


Figure 9 Magnetic switch monitoring/automatic start

## 7 Applications with the PSR-MS35

### Key:

- S1 = Emergency-stop button  
 S2 = Manual reset device  
 S3 = Magnetic switch  
 B1/B2 = Mechanical safety door switches  
 K1/K2 = Contactors



Cross-circuits in the cable installation can be excluded if the safety relay and external contactors K1 and K2 are located in the same electrical installation space.

### 7.1 Emergency stop monitoring/manual, monitored start

- Two-channel emergency stop monitoring
- Manual, monitored start
- Monitoring of external contactors
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator can be ruled out

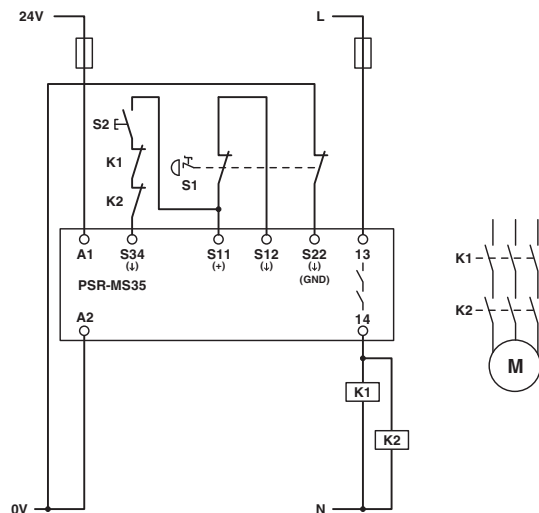


Figure 10 Emergency stop monitoring/manual, monitored start

### 7.2 Safety door monitoring/manual, monitored start

- Two-channel safety door monitoring
- Manual, monitored start
- Monitoring of external contactors
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator can be ruled out

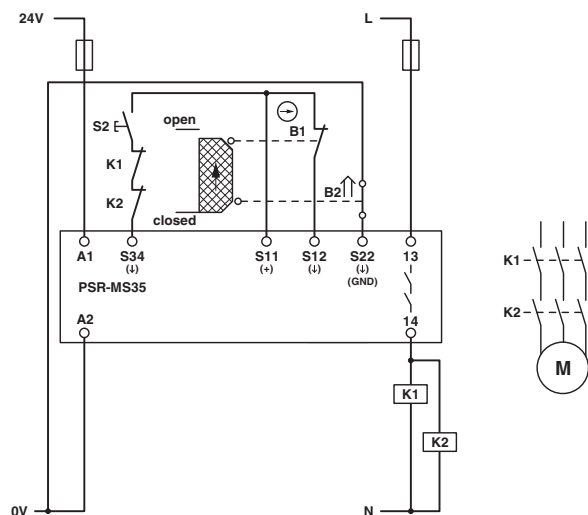


Figure 11 Safety door monitoring/manual, monitored start

## PSR-MS and PSR-MC

### 7.3 Magnetic switch monitoring/manual, monitored start

- Two-channel magnetic switch monitoring
- Manual, monitored start
- Monitoring of external contactors
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator can be ruled out

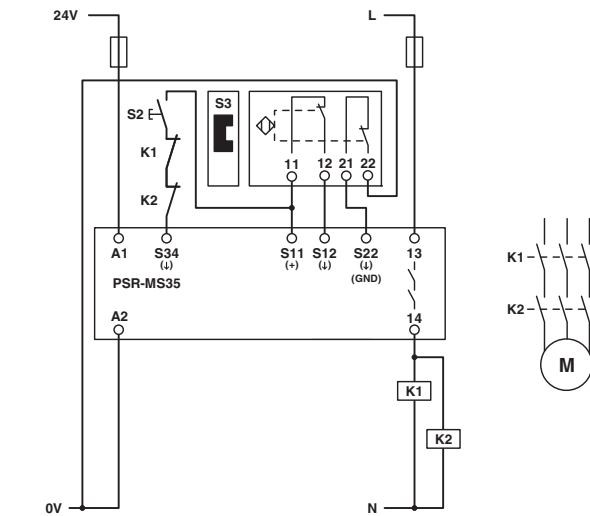


Figure 12 Magnetic switch monitoring/manual, monitored start

## 8 Applications with the PSR-MS40

### Key:

- S1 = Emergency-stop button  
 S3 = Magnetic switch  
 B1/B2 = Mechanical safety door switches  
 K1/K2 = Contactors



Cross-circuits in the cable installation can be excluded if the safety relay and external contactors K1 and K2 are located in the same electrical installation space.

### 8.1 Emergency stop monitoring/automatic start

- Two-channel emergency stop monitoring
- Automatic start
- Monitoring of external contactors
- No cross-circuit detection in the sensor circuit
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator and the sensor circuit can be ruled out

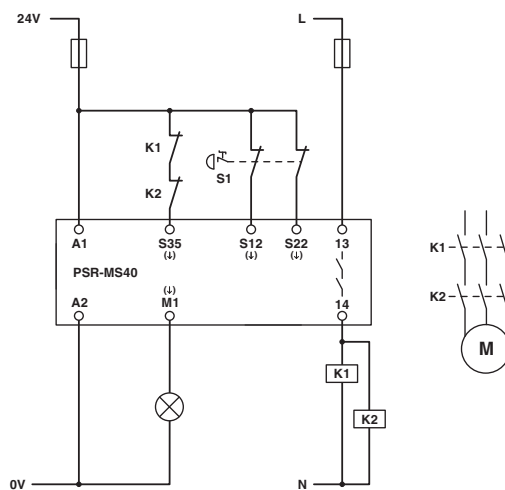


Figure 13 Emergency stop monitoring/automatic start

### 8.2 Safety door monitoring/automatic start

- Two-channel safety door monitoring
- Automatic start
- Monitoring of external contactors
- No cross-circuit detection in the sensor circuit
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator and the sensor circuit can be ruled out

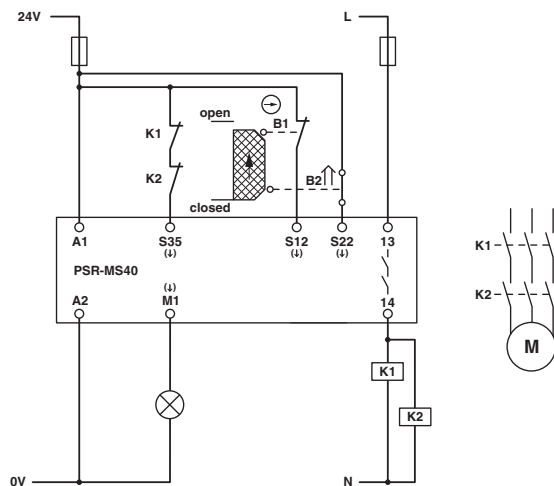


Figure 14 Safety door monitoring/automatic start

## PSR-MS and PSR-MC

### 8.3 Magnetic switch monitoring/automatic start

- Two-channel magnetic switch monitoring
- Automatic start
- Monitoring of external contactors
- No cross-circuit detection in the sensor circuit
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator and the sensor circuit can be ruled out

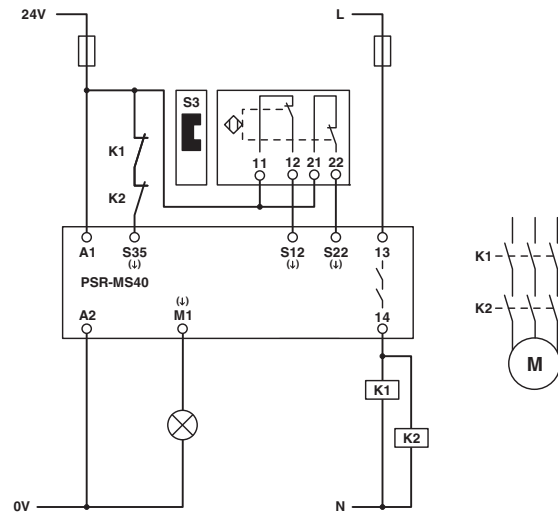


Figure 15 Magnetic switch monitoring/automatic start

## 9 Applications with the PSR-MS45

### Key:

- S1 = Emergency-stop button  
 S2 = Manual reset device  
 S3 = Magnetic switch  
 B1/B2 = Mechanical safety door switches  
 K1/K2 = Contactors



Cross-circuits in the cable installation can be excluded if the safety relay and external contactors K1 and K2 are located in the same electrical installation space.

### 9.1 Emergency stop monitoring/manual, monitored start

- Two-channel emergency stop monitoring
- Manual, monitored start
- Monitoring of external contactors
- No cross-circuit detection in the sensor circuit
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator and the sensor circuit can be ruled out

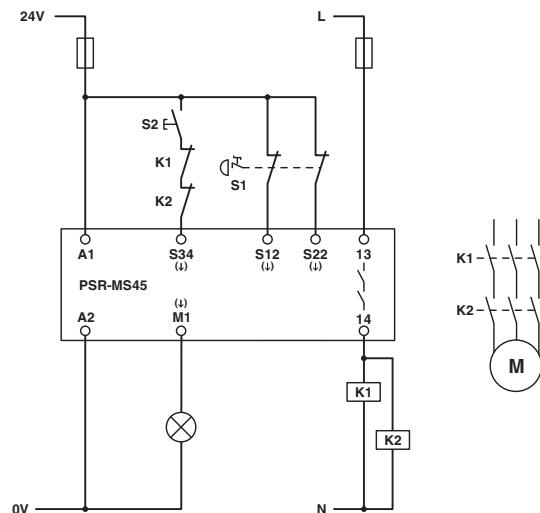


Figure 16 Emergency stop monitoring/manual, monitored start

### 9.2 Safety door monitoring/manual, monitored start

- Two-channel safety door monitoring
- Manual, monitored start
- Monitoring of external contactors
- No cross-circuit detection in the sensor circuit
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator and the sensor circuit can be ruled out

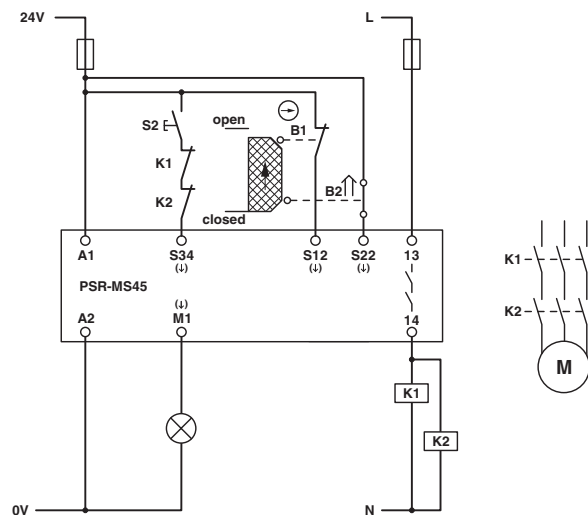


Figure 17 Safety door monitoring/manual, monitored start

## PSR-MS and PSR-MC

### 9.3 Magnetic switch monitoring/manual, monitored start

- Two-channel magnetic switch monitoring
- Manual, monitored start
- Monitoring of external contactors
- No cross-circuit detection in the sensor circuit
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator and the sensor circuit can be ruled out

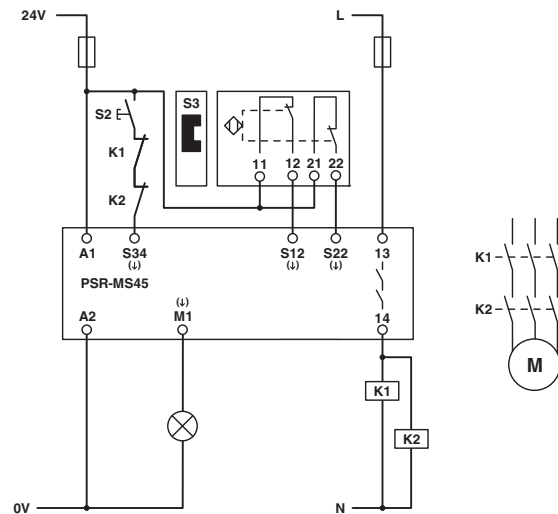


Figure 18 Magnetic switch monitoring/manual, monitored start

## 10 Applications with the PSR-MS50

### Key:

- S1 = Emergency-stop button  
 S3 = Magnetic switch  
 K1/K2 = Contactors



Cross-circuits in the cable installation can be excluded if the safety relay and external contactors K1 and K2 are located in the same electrical installation space.

### 10.1 Magnetic switch monitoring/automatic start

- Two-channel, non-equivalent magnetic switch monitoring
- Automatic start
- Monitoring of external contactors
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator can be ruled out

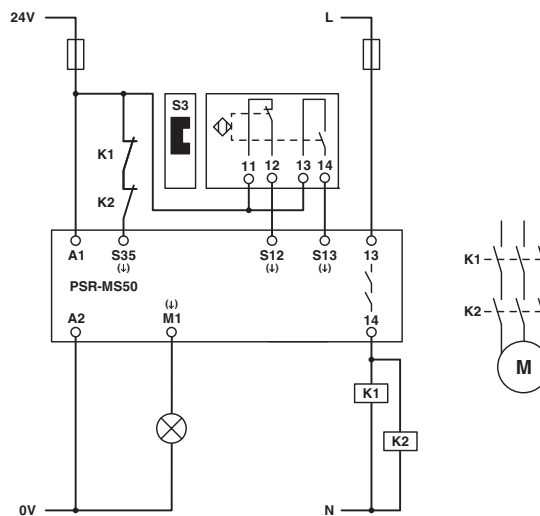


Figure 19 Magnetic switch monitoring/automatic start

## 11 Applications with the PSR-MS55

### Key:

- S1 = Emergency-stop button  
 S2 = Manual reset device  
 S3 = Magnetic switch  
 K1/K2 = Contactors



Cross-circuits in the cable installation can be excluded if the safety relay and external contactors K1 and K2 are located in the same electrical installation space.

### 11.1 Magnetic switch monitoring/manual, monitored start

- Two-channel, non-equivalent magnetic switch monitoring
- Manual, monitored start
- Monitoring of external contactors
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator can be ruled out

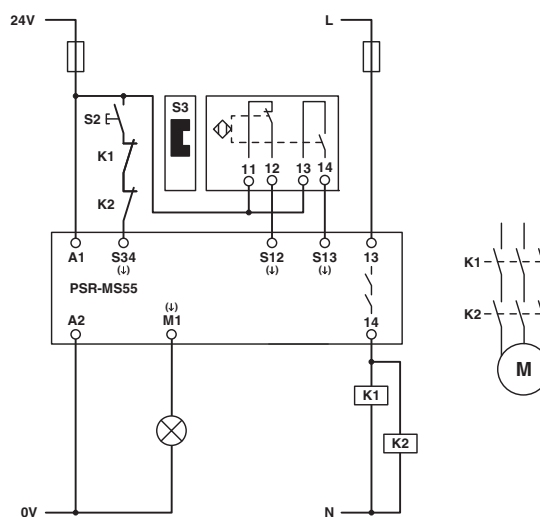


Figure 20 Magnetic switch monitoring/manual, monitored start

## 12 Applications with the PSR-MS60

### Key:

K1/K2 = Contactors

### 12.1 Light grid monitoring/automatic start

- Two-channel light grid monitoring
- Automatic start
- Monitoring of external contactors
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061)



**WARNING: Loss of functional safety!**

Make sure that the signal generator (e.g., PLC output card or light grid) and the safety relay have the same ground potential.

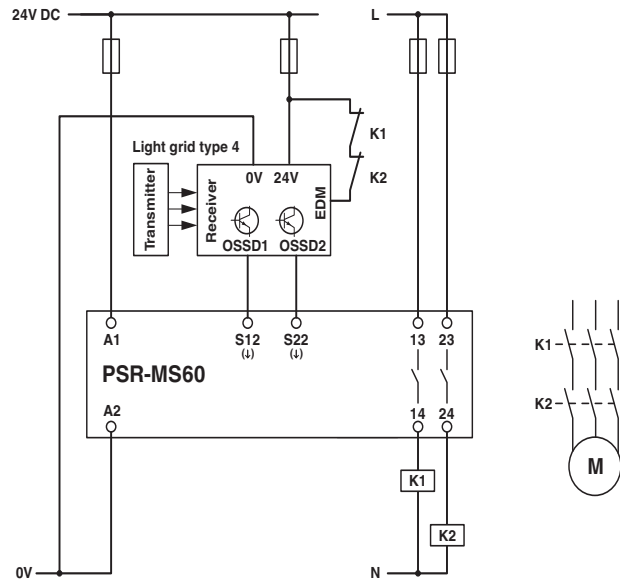


Figure 21 Light grid monitoring/automatic start

### 12.2 Two-channel control via LPSDO module

- Two-channel control
- Cross-circuit detection by means of LPSDO module
- Automatic start
- Monitoring of external contactors
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061)



**WARNING: Loss of functional safety!**

Make sure that the signal generator (e.g., PLC output card or light grid) and the safety relay have the same ground potential.



The bright pulses (test pulses generated by switching on briefly) sent by the controller can lead to the brief, unwanted activation of the safety relay. You should therefore deactivate the bright pulses of the failsafe controller.

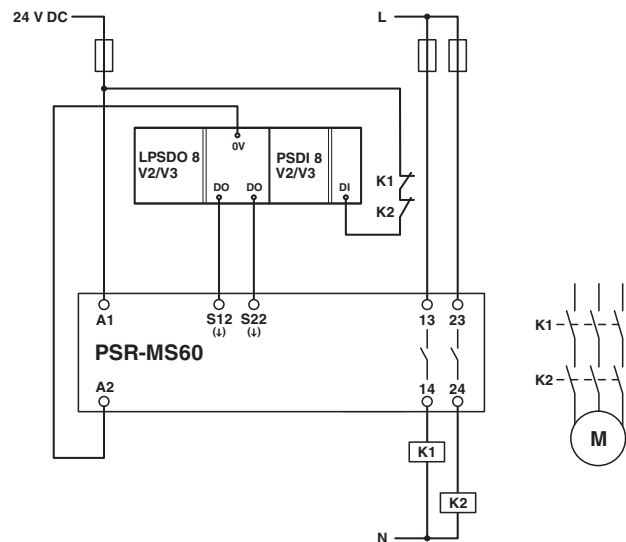


Figure 22 Two-channel control via LPSDO module

### 12.3 Single-channel control via failsafe controller

- Single-channel control
- Automatic start
- Monitoring of external contactors
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if the digital output of the safety-related controller meets PL e, SIL 3, and cross-circuits can be ruled out



**WARNING: Loss of functional safety!**

Make sure that the signal generator (e.g., PLC output card or light grid) and the safety relay have the same ground potential.

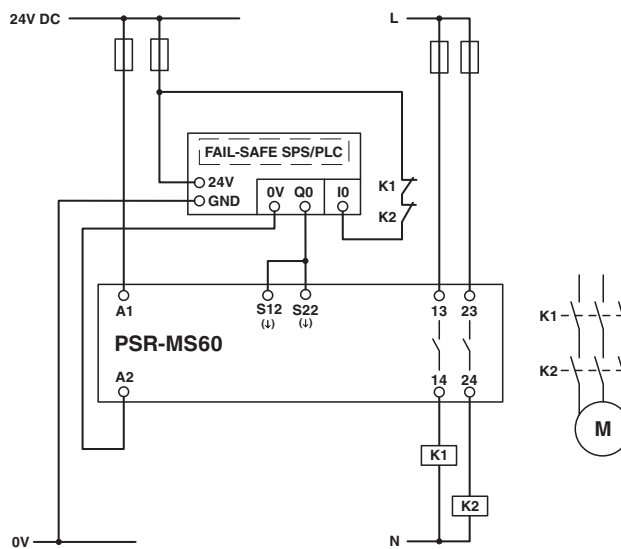


Figure 23 Single-channel control via failsafe PLC



### 13.3 Safety door monitoring/automatic start

- Single-channel safety door monitoring
- Automatic start
- Monitoring of external contactors
- Suitable up to category 1, PL c (EN ISO 13849-1), SIL 1 (EN 62061)



Contactor K2 is not essential in order to achieve category 1.

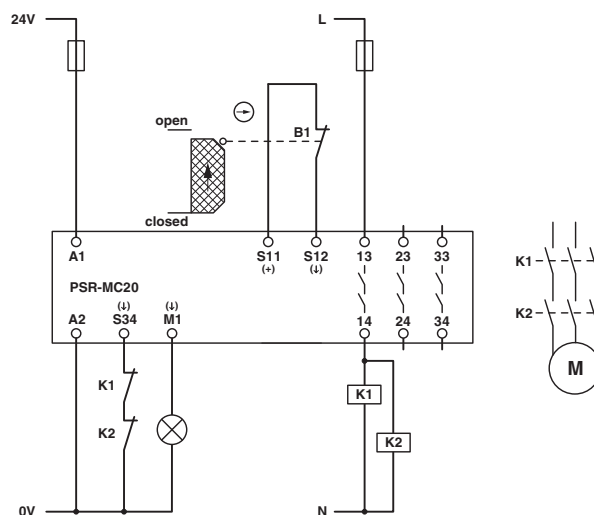


Figure 26 Safety door monitoring/automatic start

### 13.4 Safety door monitoring/manual, monitored start

- Single-channel safety door monitoring
- Manual, monitored start
- Monitoring of external contactors
- Suitable up to category 1, PL c (EN ISO 13849-1), SIL 1 (EN 62061)



Contactor K2 is not essential in order to achieve category 1.

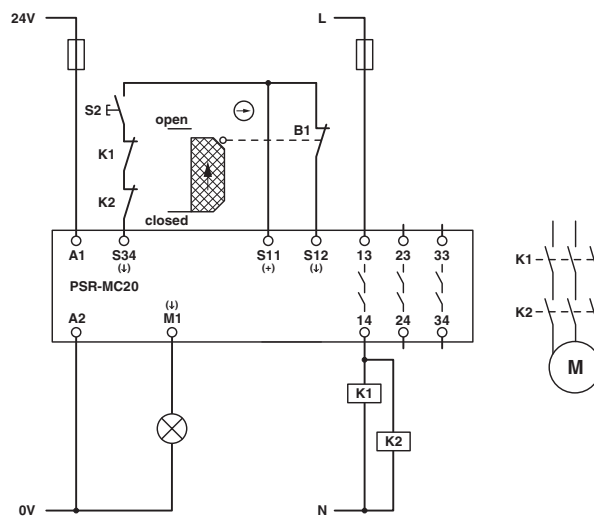


Figure 27 Safety door monitoring/manual, monitored start

## PSR-MS and PSR-MC

### 13.5 Connection to failsafe controller/automatic start

- Automatic start
- Monitoring of external contactors
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if the digital output of the safety-related controller meets PL e, SIL 3, and cross-circuits can be ruled out



**WARNING: Loss of functional safety!**

Make sure that the signal generator (e.g., PLC output card or light grid) and the safety relay have the same ground potential.



Cross-circuits in the cable installation can be excluded if the failsafe PLC, safety relay, and external contactors K1 and K2 are located in the same electrical installation space.

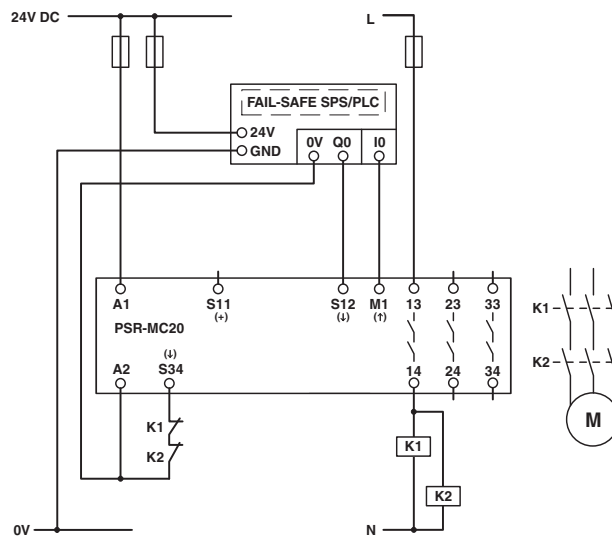


Figure 28 Connection to failsafe PLC/automatic start

## 14 Applications with the PSR-MC30

### Key:

- S1 = Emergency-stop button
- S2 = Manual reset device
- S3 = Magnetic switch
- B1/B2 = Mechanical safety door switches
- K1/K2 = Contactors



Cross-circuits in the cable installation can be excluded if the safety relay and external contactors K1 and K2 are located in the same electrical installation space.

### 14.1 Emergency stop monitoring/automatic start

- Two-channel emergency stop monitoring
- Automatic start
- Monitoring of external contactors
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator can be ruled out

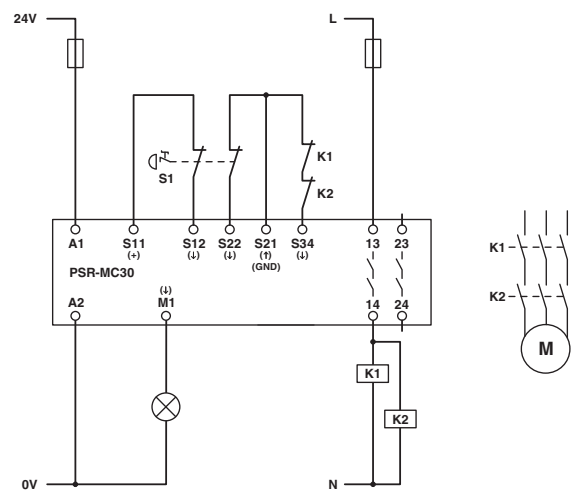


Figure 29 Emergency stop monitoring/automatic start

### 14.2 Emergency stop monitoring/manual, monitored start

- Two-channel emergency stop monitoring
- Manual, monitored start
- Monitoring of external contactors
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator can be ruled out

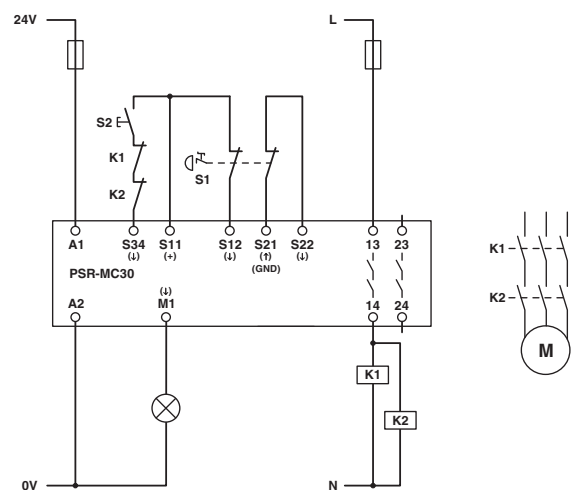


Figure 30 Emergency stop monitoring/manual, monitored start

## PSR-MS and PSR-MC

### 14.3 Safety door monitoring/automatic start

- Two-channel safety door monitoring
- Automatic start
- Monitoring of external contactors
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator can be ruled out

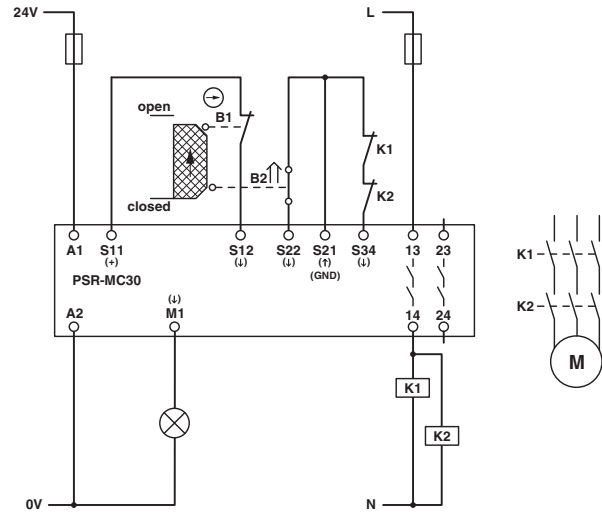


Figure 31 Safety door monitoring/automatic start

### 14.4 Safety door monitoring/automatic start/without cross-circuit detection

- Two-channel safety door monitoring
- Automatic start
- Monitoring of external contactors
- No cross-circuit detection in the sensor circuit
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator and the sensor circuit can be ruled out

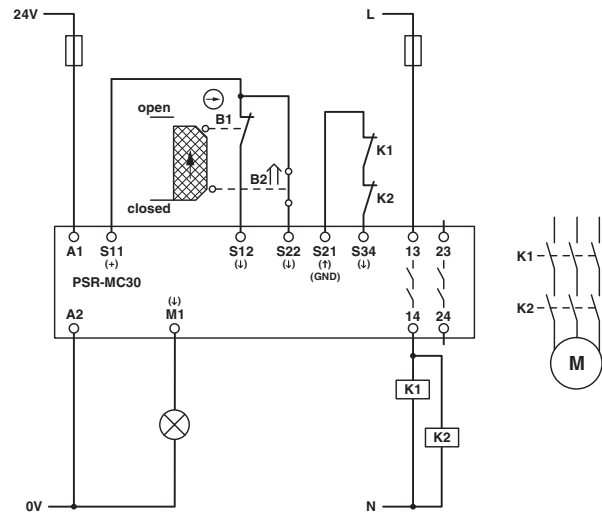


Figure 32 Safety door monitoring/automatic start/without cross-circuit detection

#### 14.5 Single-channel safety door monitoring/automatic start

- Single-channel safety door monitoring
- Automatic start
- Monitoring of external contactors
- No cross-circuit detection in the sensor circuit
- Suitable up to category 1, PL c (EN ISO 13849-1), SIL 1 (EN 62061)



Contactor K2 is not essential in order to achieve category 1.

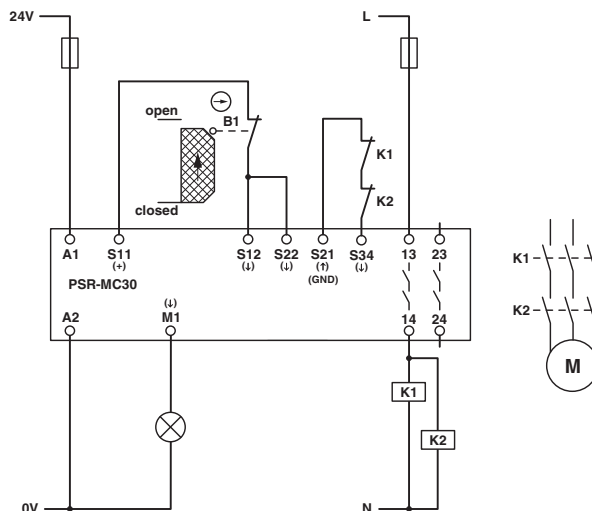


Figure 33 Single-channel safety door monitoring/automatic start

#### 14.6 Safety door monitoring/manual, monitored start

- Two-channel safety door monitoring
- Manual, monitored start
- Monitoring of external contactors
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator can be ruled out

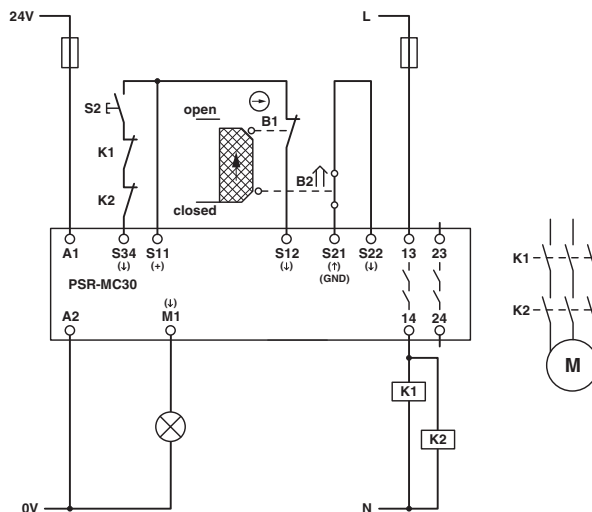


Figure 34 Safety door monitoring/manual, monitored start

## PSR-MS and PSR-MC

### 14.7 Safety door monitoring/manual, monitored start/without cross-circuit detection

- Two-channel safety door monitoring
- Manual, monitored start
- Monitoring of external contactors
- No cross-circuit detection in the sensor circuit
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator and the sensor circuit can be ruled out

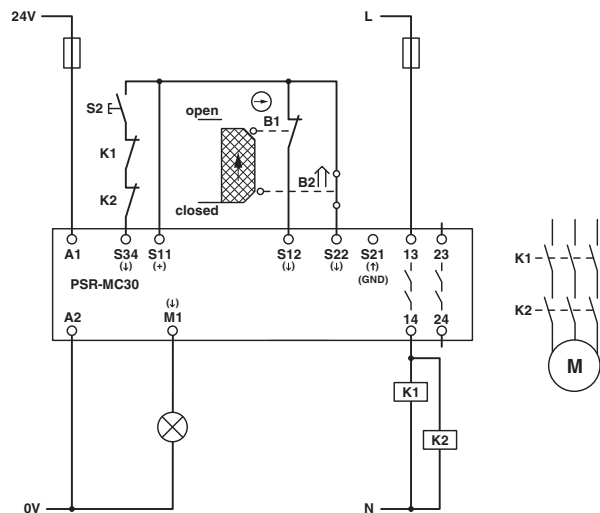


Figure 35 Safety door monitoring/manual, monitored start/without cross-circuit detection

### 14.8 Single-channel safety door monitoring/manual, monitored start

- Single-channel safety door monitoring
- Manual, monitored start
- Monitoring of external contactors
- No cross-circuit detection in the sensor circuit
- Suitable up to category 1, PL c (EN ISO 13849-1), SIL 1 (EN 62061)



Contactors K2 is not essential in order to achieve category 1.

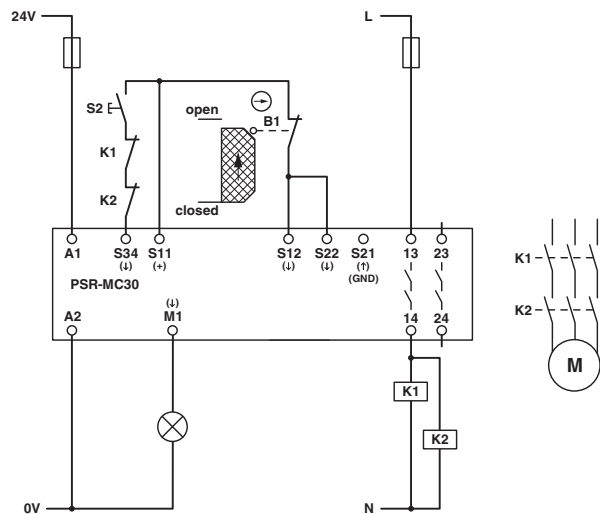


Figure 36 Single-channel safety door monitoring/manual, monitored start

### 14.9 Magnetic switch monitoring/automatic start

- Two-channel magnetic switch monitoring
- Automatic start
- Monitoring of external contactors
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator can be ruled out

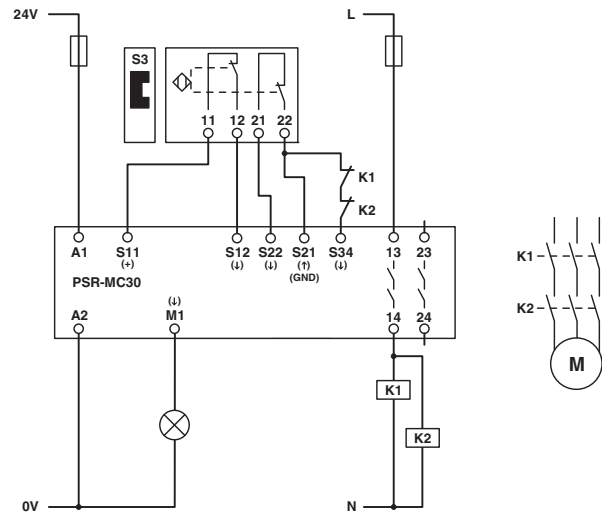


Figure 37 Magnetic switch monitoring/automatic start

### 14.10 Magnetic switch monitoring/manual, monitored start

- Two-channel magnetic switch monitoring
- Manual, monitored start
- Monitoring of external contactors
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator can be ruled out

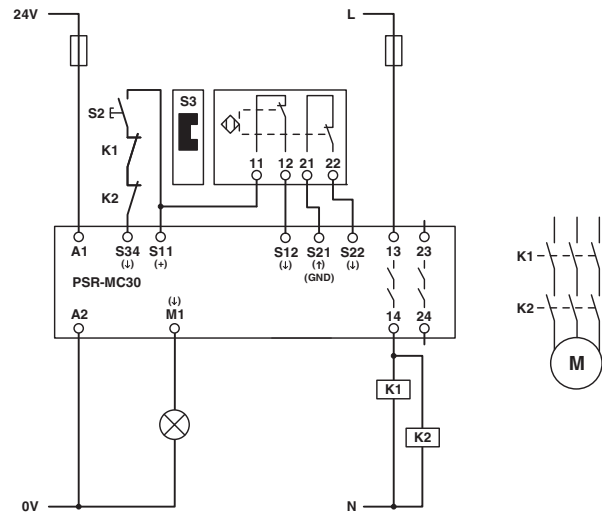


Figure 38 Magnetic switch monitoring/manual, monitored start

## 15 Applications with the PSR-MC34

### Key:

- S1 = Emergency-stop button  
 S2 = Manual reset device  
 S3 = Magnetic switch  
 B1/B2 = Mechanical safety door switches  
 K1/K2 = Contactors



Cross-circuits in the cable installation can be excluded if the safety relay and external contactors K1 and K2 are located in the same electrical installation space.

### 15.1 Emergency stop monitoring/automatic start

- Two-channel emergency stop monitoring
- Automatic start
- Monitoring of external contactors
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator can be ruled out

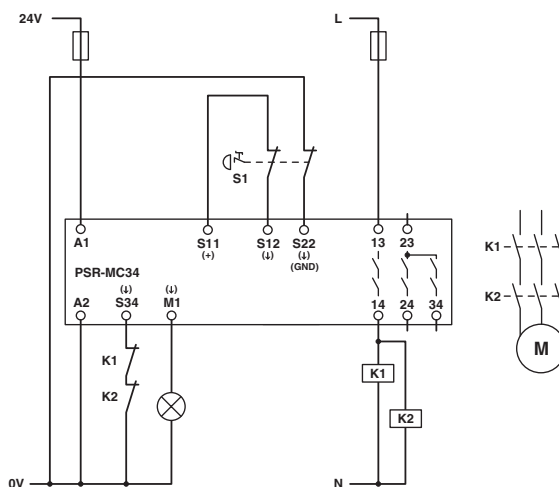


Figure 39 Emergency stop monitoring/automatic start

### 15.2 Emergency stop monitoring/manual, monitored start

- Two-channel emergency stop monitoring
- Manual, monitored start
- Monitoring of external contactors
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator can be ruled out

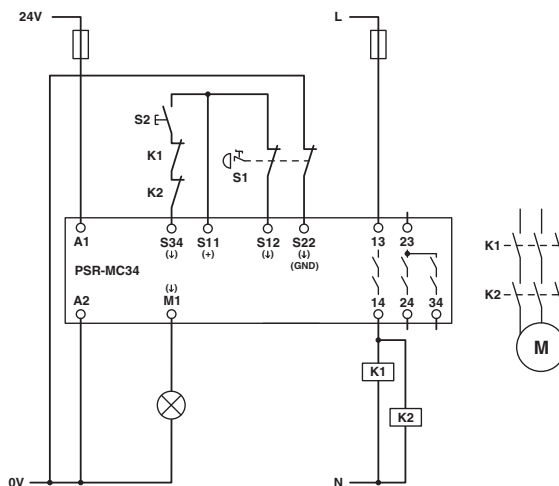


Figure 40 Emergency stop monitoring/manual, monitored start

### 15.3 Safety door monitoring/automatic start

- Two-channel safety door monitoring
- Automatic start
- Monitoring of external contactors
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator can be ruled out

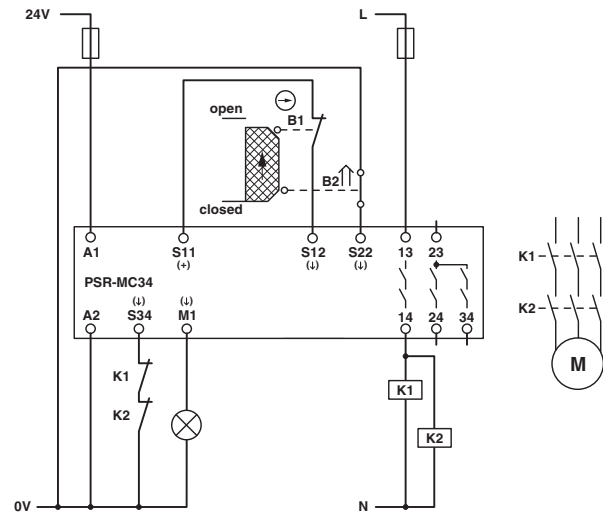


Figure 41 Safety door monitoring/automatic start

### 15.4 Safety door monitoring/automatic start/without cross-circuit detection

- Two-channel safety door monitoring
- Automatic start
- Monitoring of external contactors
- No cross-circuit detection in the sensor circuit
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator and the sensor circuit can be ruled out

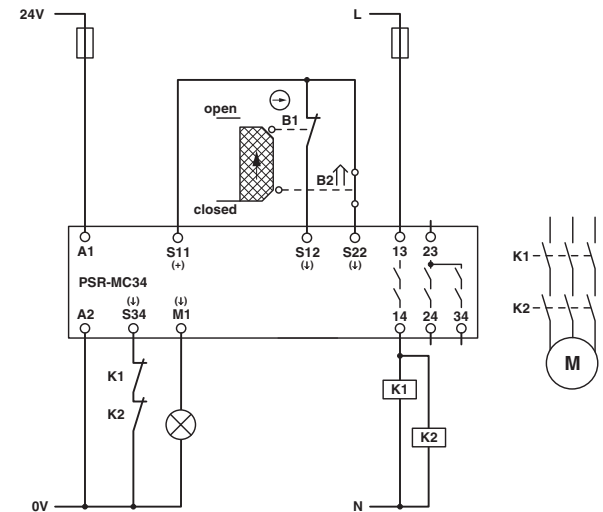


Figure 42 Safety door monitoring/automatic start/without cross-circuit detection

## PSR-MS and PSR-MC

### 15.5 Single-channel safety door monitoring/automatic start

- Single-channel safety door monitoring
- Automatic start
- Monitoring of external contactors
- No cross-circuit detection in the sensor circuit
- Suitable up to category 1, PL c (EN ISO 13849-1), SIL 1 (EN 62061)



Contactor K2 is not essential in order to achieve category 1.

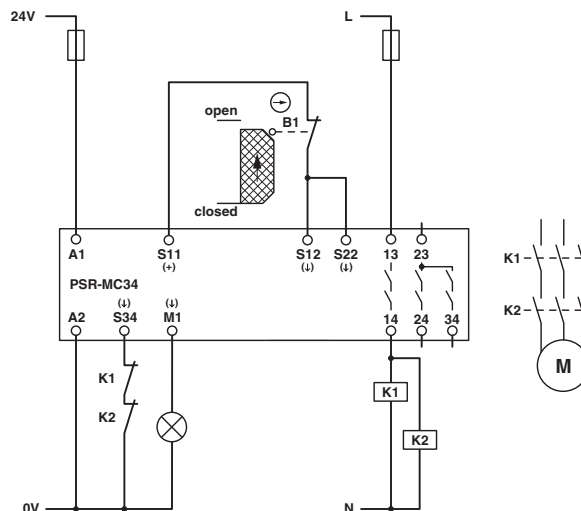


Figure 43 Single-channel safety door monitoring/automatic start

### 15.6 Safety door monitoring/manual, monitored start

- Two-channel safety door monitoring
- Manual, monitored start
- Monitoring of external contactors
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator can be ruled out

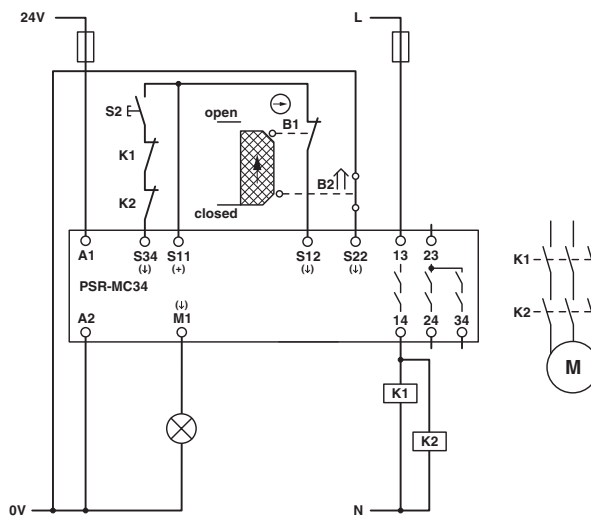


Figure 44 Safety door monitoring/manual, monitored start

### 15.7 Safety door monitoring/manual, monitored start/without cross-circuit detection

- Two-channel safety door monitoring
- Manual, monitored start
- Monitoring of external contactors
- No cross-circuit detection in the sensor circuit
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator and the sensor circuit can be ruled out

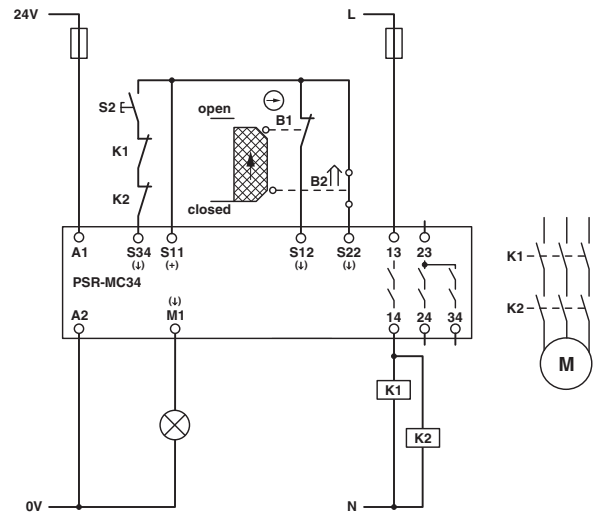


Figure 45 Safety door monitoring/manual, monitored start/without cross-circuit detection

### 15.8 Single-channel safety door monitoring/manual, monitored start

- Single-channel safety door monitoring
- Manual, monitored start
- Monitoring of external contactors
- No cross-circuit detection in the sensor circuit
- Suitable up to category 1, PL c (EN ISO 13849-1), SIL 1 (EN 62061)



Contactors K2 is not essential in order to achieve category 1.


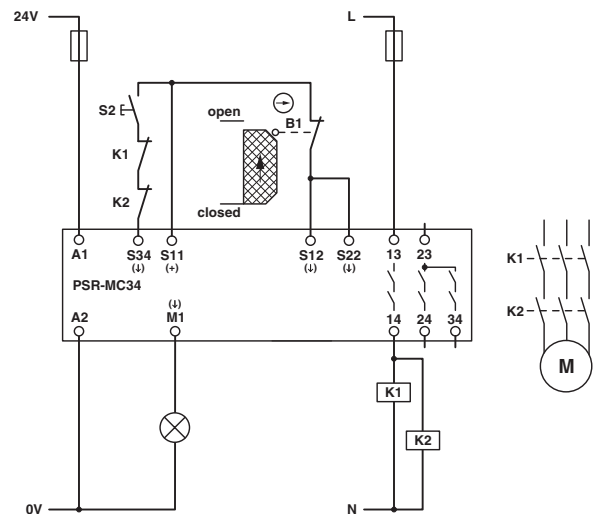


Figure 46 Single-channel safety door monitoring/manual, monitored start

- Two-channel magnetic switch monitoring
- Automatic start
- Monitoring of external contactors
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator can be ruled out



- Two-channel magnetic switch monitoring
- Manual, monitored start
- Monitoring of external contactors
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator can be ruled out



## 16 Applications with the PSR-MC40

### Key:

- S1 = Emergency-stop button  
 S2 = Manual reset device  
 B1/B2 = Mechanical safety door switches  
 K1/K2 = Contactors



Cross-circuits in the cable installation can be excluded if the safety relay and external contactors K1 and K2 are located in the same electrical installation space.

### 16.1 Emergency stop monitoring/automatic start

- Two-channel emergency stop monitoring
- Automatic start
- Monitoring of external contactors
- No cross-circuit detection in the sensor circuit
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator and the sensor circuit can be ruled out

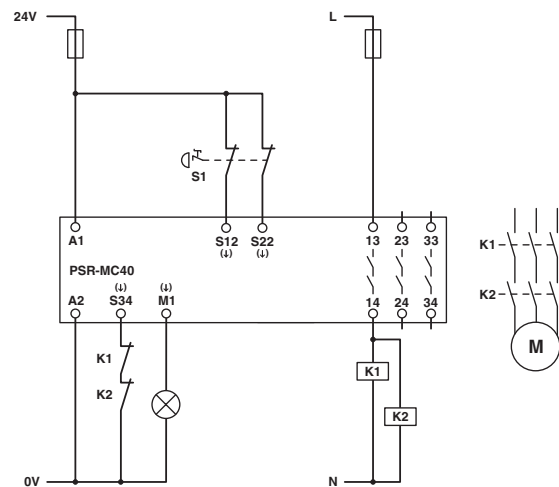


Figure 49 Emergency stop monitoring/automatic start

### 16.2 Emergency stop monitoring/manual, monitored start

- Two-channel emergency stop monitoring
- Manual, monitored start
- Monitoring of external contactors
- No cross-circuit detection in the sensor circuit
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator and the sensor circuit can be ruled out

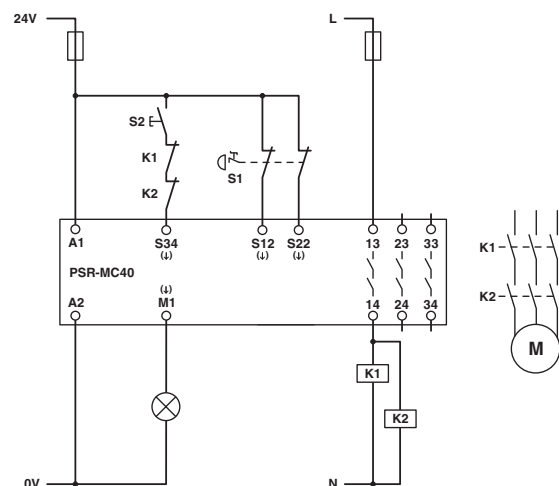


Figure 50 Emergency stop monitoring/manual, monitored start

## PSR-MS and PSR-MC

### 16.3 Safety door monitoring/automatic start

- Two-channel safety door monitoring
- Automatic start
- Monitoring of external contactors
- No cross-circuit detection in the sensor circuit
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator and the sensor circuit can be ruled out

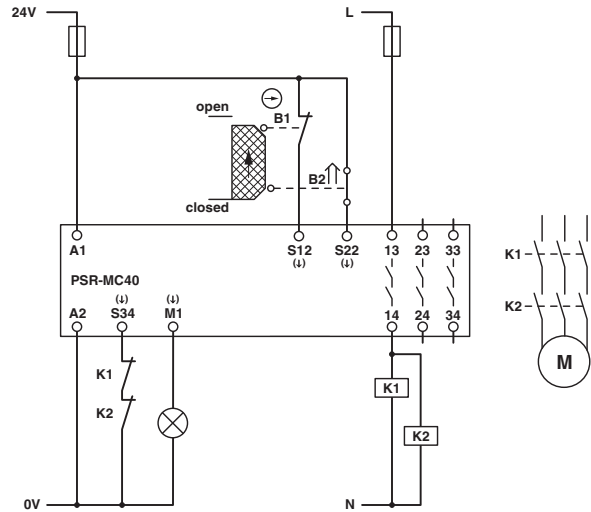


Figure 51 Safety door monitoring/automatic start

### 16.4 Safety door monitoring/manual, monitored start

- Two-channel safety door monitoring
- Manual, monitored start
- Monitoring of external contactors
- No cross-circuit detection in the sensor circuit
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator and the sensor circuit can be ruled out

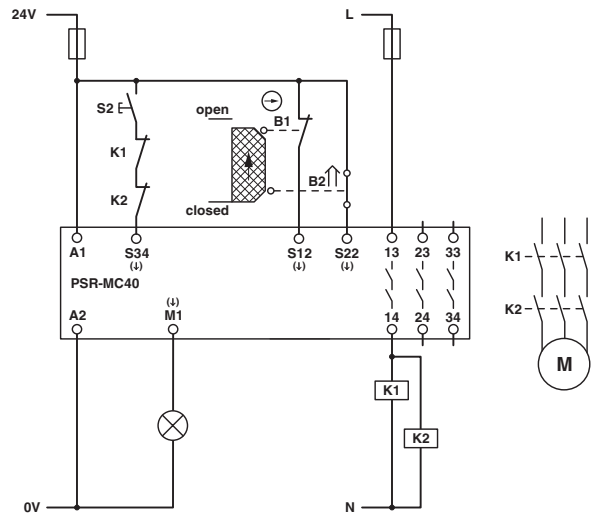
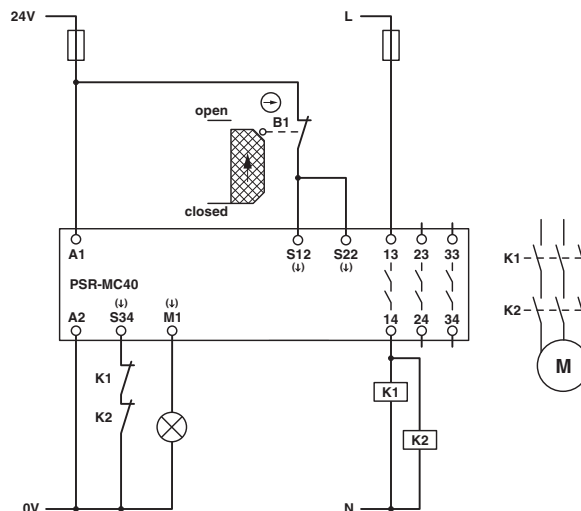



Figure 52 Safety door monitoring/manual, monitored start

- Single-channel safety door monitoring
- Automatic start
- Monitoring of external contactors
- No cross-circuit detection in the sensor circuit
- Suitable up to category 1, PL c (EN ISO 13849-1), SIL 1 (EN 62061)



**Figure 53** Single-channel safety door monitoring/automatic start

- Single-channel safety door monitoring
- Manual, monitored start
- Monitoring of external contactors
- No cross-circuit detection in the sensor circuit
- Suitable up to category 1, PL c (EN ISO 13849-1), SIL 1 (EN 62061)


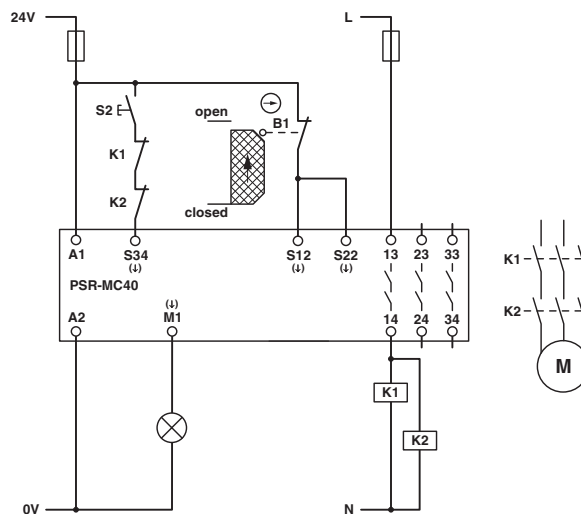


Figure 54 Single-channel safety door monitoring/manual, monitored start

## PSR-MS and PSR-MC

### 16.7 Connection to failsafe controller/automatic start

- Two-channel connection to the failsafe PLC
- Automatic start
- Monitoring of external contactors
- No cross-circuit detection in the sensor circuit
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if the two-channel digital output of the safety-related controller meets PL e, SIL 3



**WARNING: Loss of functional safety!**

Make sure that the signal generator (e.g., PLC output card or light grid) and the safety relay have the same ground potential.

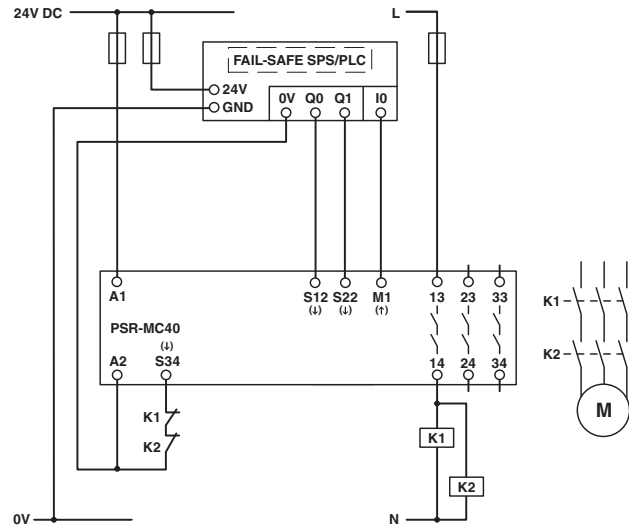


Figure 55 Connection to failsafe PLC/automatic start

### 16.8 Connection to failsafe controller/manual, monitored start

- Two-channel connection to the failsafe PLC
- Manual, monitored start
- Monitoring of external contactors
- No cross-circuit detection in the sensor circuit
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if the two-channel digital output of the safety-related controller meets PL e, SIL 3



**WARNING: Loss of functional safety!**

Make sure that the signal generator (e.g., PLC output card or light grid) and the safety relay have the same ground potential.

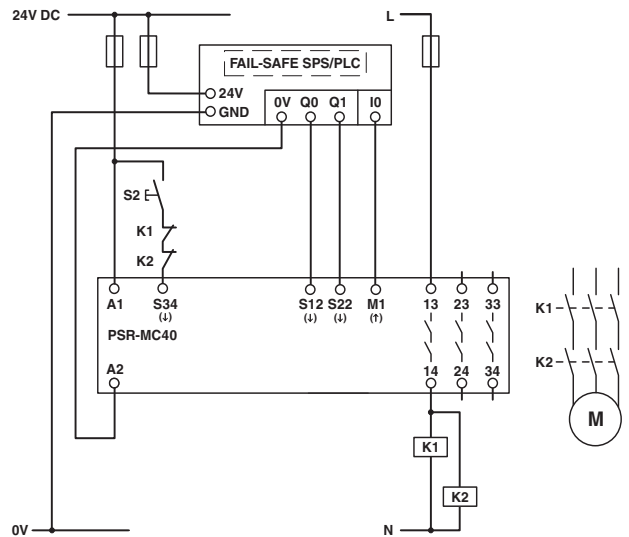


Figure 56 Connection to failsafe PLC/manual, monitored start

### 16.9 Single-channel connection to failsafe controller/automatic start

- Single-channel connection to the failsafe PLC
- Automatic start
- Monitoring of external contactors
- No cross-circuit detection in the sensor circuit
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if the digital output of the safety-related controller meets PL e, SIL 3, and cross-circuits can be ruled out



**WARNING: Loss of functional safety!**

Make sure that the signal generator (e.g., PLC output card or light grid) and the safety relay have the same ground potential.



Cross-circuits in the cable installation can be excluded if the failsafe PLC, safety relay, and external contactors K1 and K2 are located in the same electrical installation space.

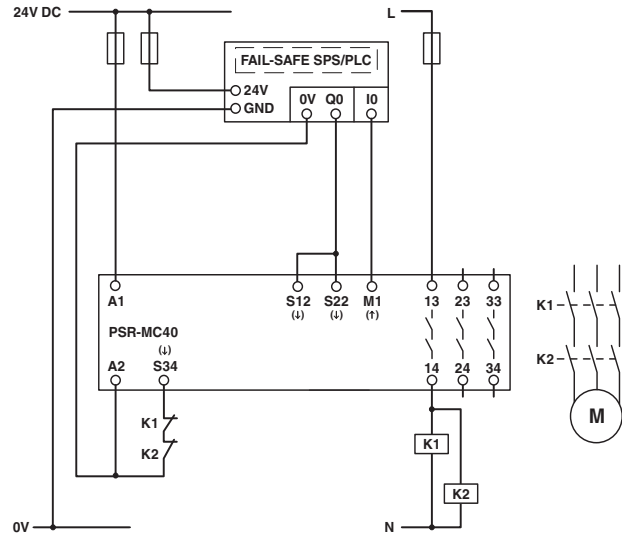


Figure 57 Single-channel connection to failsafe PLC/automatic start

### 16.10 Single-channel connection to failsafe controller/manual, monitored start

- Single-channel connection to the failsafe PLC
- Manual, monitored start
- Monitoring of external contactors
- No cross-circuit detection in the sensor circuit
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if the digital output of the safety-related controller meets PL e, SIL 3, and cross-circuits can be ruled out



**WARNING: Loss of functional safety!**

Make sure that the signal generator (e.g., PLC output card or light grid) and the safety relay have the same ground potential.



Cross-circuits in the cable installation can be excluded if the failsafe PLC, safety relay, and external contactors K1 and K2 are located in the same electrical installation space.

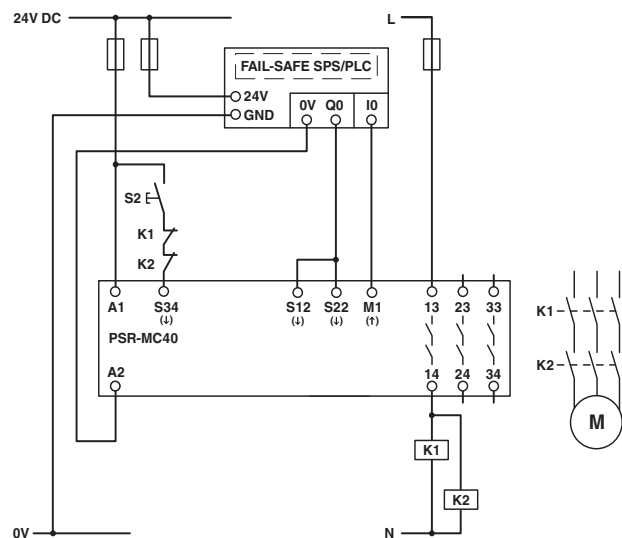


Figure 58 Single-channel connection to failsafe PLC/manual, monitored start

## PSR-MS and PSR-MC

### 16.11 Light grid monitoring/automatic start

- Two-channel light grid monitoring
- Automatic start
- Monitoring of external contactors
- No cross-circuit detection in the sensor circuit
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator can be ruled out



**WARNING: Loss of functional safety!**

Make sure that the signal generator (e.g., PLC output card or light grid) and the safety relay have the same ground potential.

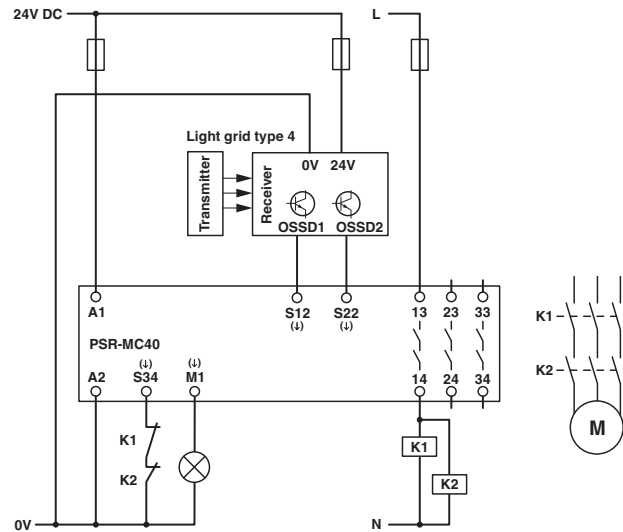


Figure 59 Light grid monitoring/automatic start

### 16.12 Light grid monitoring/manual, monitored start

- Two-channel light grid monitoring
- Manual, monitored start
- Monitoring of external contactors
- No cross-circuit detection in the sensor circuit
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator can be ruled out



**WARNING: Loss of functional safety!**

Make sure that the signal generator (e.g., PLC output card or light grid) and the safety relay have the same ground potential.

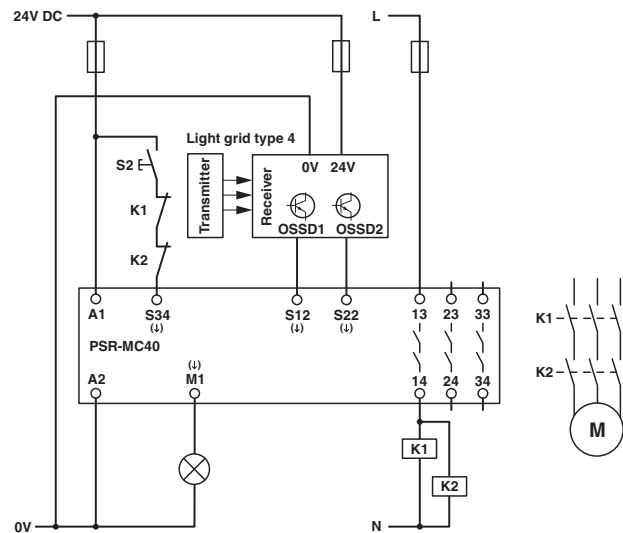


Figure 60 Light grid monitoring/manual, monitored start

### 16.13 Transponder monitoring/automatic start

- Two-channel transponder monitoring
- Automatic start
- Monitoring of external contactors
- No cross-circuit detection in the sensor circuit
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator can be ruled out



**WARNING: Loss of functional safety!**

Make sure that the signal generator (e.g., PLC output card or light grid) and the safety relay have the same ground potential.

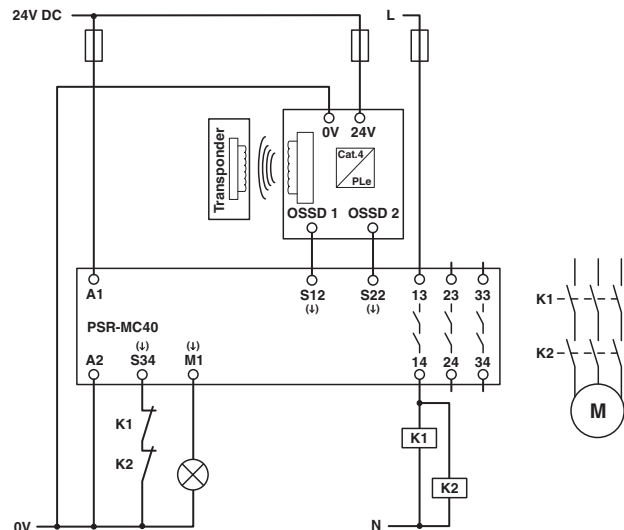


Figure 61 Transponder monitoring/automatic start

### 16.14 Transponder monitoring/manual, monitored start

- Two-channel transponder monitoring
- Manual, monitored start
- Monitoring of external contactors
- No cross-circuit detection in the sensor circuit
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator can be ruled out



**WARNING: Loss of functional safety!**

Make sure that the signal generator (e.g., PLC output card or light grid) and the safety relay have the same ground potential.

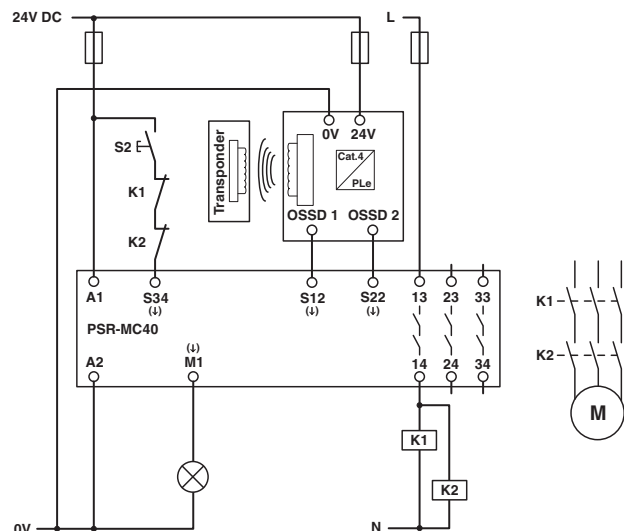


Figure 62 Transponder monitoring/manual, monitored start

## 17 Applications with the PSR-MC50

### Key:

- S1 = Emergency-stop button  
 S2 = Manual reset device  
 S3 = Magnetic switch  
 K1/K2 = Contactors



Cross-circuits in the cable installation can be excluded if the safety relay and external contactors K1 and K2 are located in the same electrical installation space.

### 17.1 Magnetic switch monitoring/automatic start

- Two-channel, non-equivalent magnetic switch monitoring
- Automatic start
- Monitoring of external contactors
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator can be ruled out

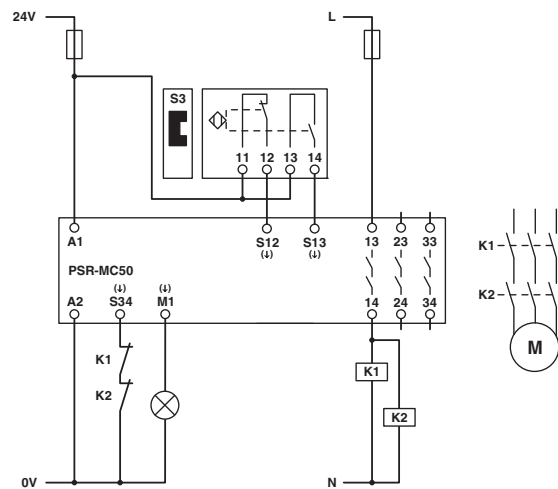


Figure 63 Magnetic switch monitoring/automatic start

### 17.2 Magnetic switch monitoring/manual, monitored start

- Two-channel, non-equivalent magnetic switch monitoring
- Manual, monitored start
- Monitoring of external contactors
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator can be ruled out

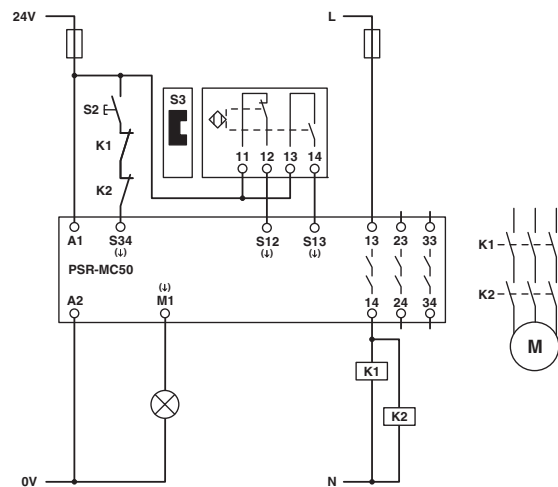


Figure 64 Magnetic switch monitoring/manual, monitored start

### 17.3 Safety door monitoring/automatic start

- Non-equivalent safety door monitoring
- Automatic start
- Monitoring of external contactors
- Suitable up to category 1, PL c (EN ISO 13849-1), SIL 1 (EN 62061)
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator can be ruled out and two switches of Type 1 are used

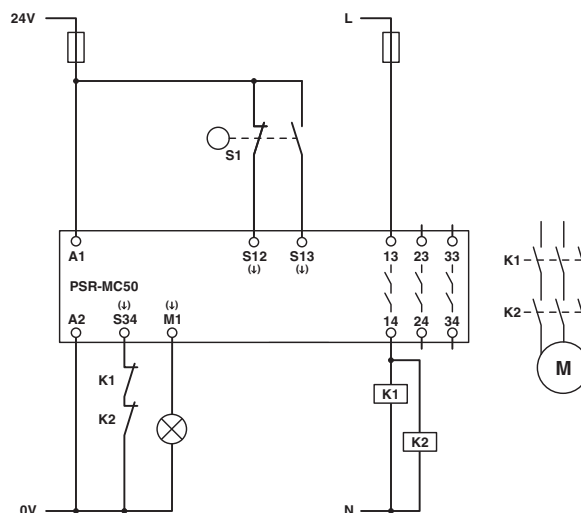


Figure 65 Safety door monitoring/automatic start

#### 17.4 Safety door monitoring/manual, monitored start

- Non-equivalent safety door monitoring
- Manual, monitored start
- Monitoring of external contactors
- Suitable up to category 1, PL c (EN ISO 13849-1), SIL 1 (EN 62061)
- Suitable up to category 4, PL e (EN ISO 13849-1), SIL 3 (EN 62061), if cross-circuits in the control to the actuator can be ruled out and two switches of Type 1 are used

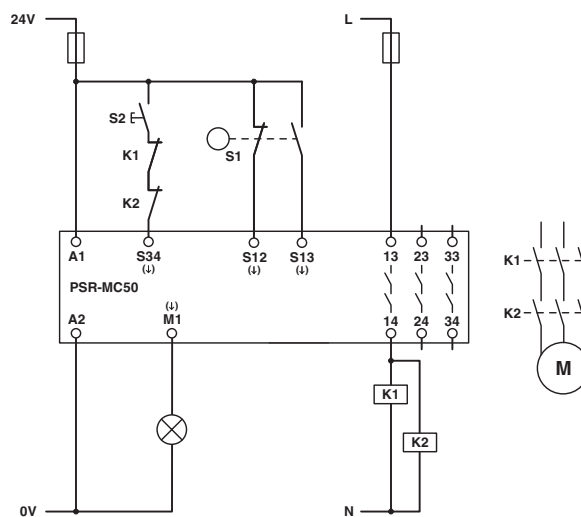


Figure 66 Safety door monitoring/manual, monitored start

## 18 Revision history

| Revision | Date       | Content                                                                                                                                                                                                                                                                 |
|----------|------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| 00       | 2015-01-14 | First publication                                                                                                                                                                                                                                                       |
| 01       | 2015-08-27 | Ordering data changed: Article number 2992239 replaced by material number 52007563<br>Application examples revised: 4.3, 5.3, 12.1, 12.2, 12.3, 13.5, 16.7, 16.8, 16.9, 16.10, 16.11, 16.12, 16.13, 16.14<br>Infobox inserted for all application examples up to Cat. 1 |



# SCATTERGOOD & JOHNSON LTD

ELECTRICAL ENGINEERING & FLUID CONTROL DISTRIBUTORS


At Scattergood & Johnson Ltd, we pride ourselves on being a technical distributor to specialist industries.

Working with a range of quality product suppliers across a number of specialist markets, we are not your average 'box shifter' - we are your technical and supply chain partner.

We fully support every product we sell - for free! Our internal team and external sales engineers can answer any product or application question, no matter the complexity.

Backing up this technical ability is a range of 50,000+ products available from stock for nationwide next day delivery (same day if required!), or you can collect what you need from any of our trade counters around the UK.

Select your specialist interest below to learn more about how we can help.

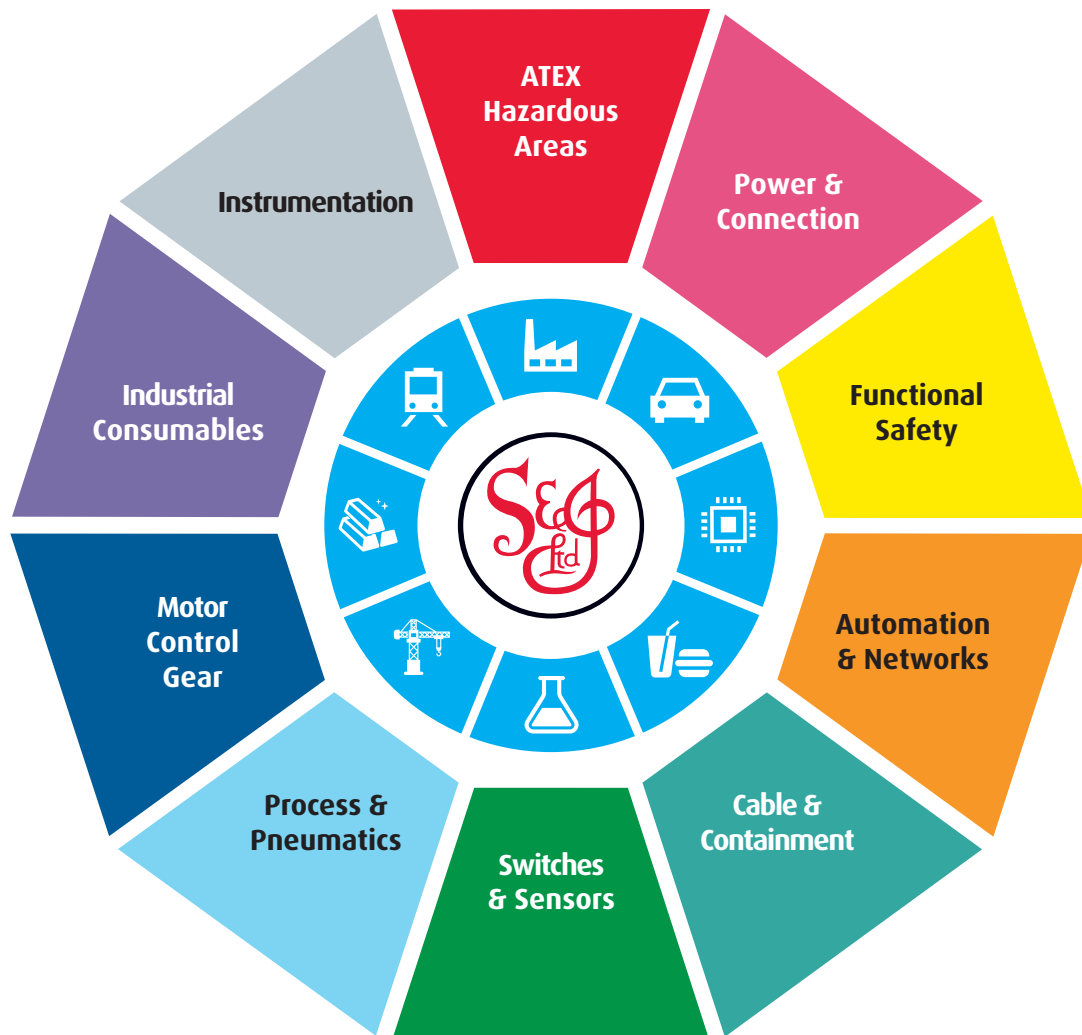

Online, In Branch and On the Road - Scattergood & Johnson Ltd, there when you need us.

# [www.scatts.co.uk](http://www.scatts.co.uk)