

iC60 RCBO A9D

en



1 Installation


⚠ ⚠ DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

- Install this product in accordance with National Wiring Regulation.
 - Check compatibility with earthing system. Do not use this product on installations which require double pole switching eg. IT or TT systems.
- Failure to follow these instructions will result in death or serious injury.**

All electrical equipment protected by iC60 RCBO must be effectively earthed. Maximum, permissible earthing resistance is as follows:

Device Ue	Maximum Earthing Resistance
110 V~	50 Ω
230/240 V~	100 Ω

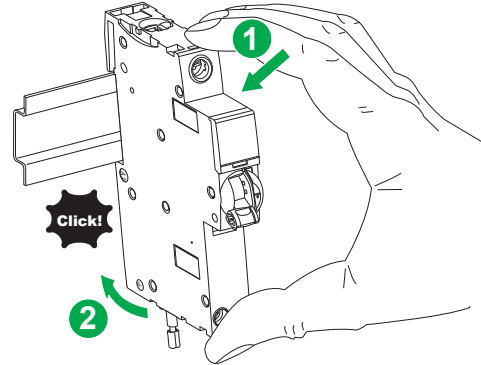


2 Connection

NOTICE

INOPERABLE EQUIPMENT

- Do not bind the neutral cable for installation.
 - Install the neutral cable straight between the iC60 RCBO and the main neutral terminal block.
- Failure to follow these instructions can result in equipment damage.**

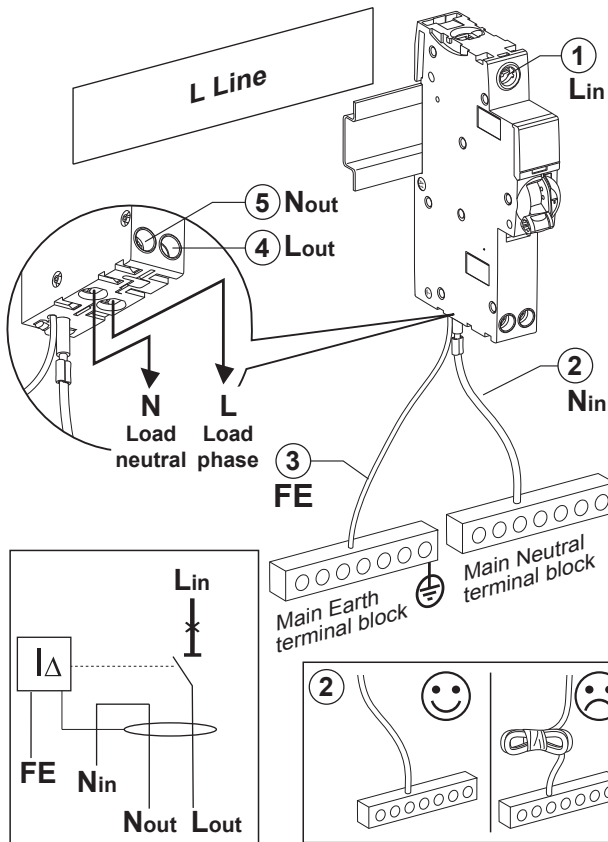

3 Testing

The installation, or part of it, is protected by devices which automatically switch off the supply if earth default develops. These devices should be tested periodically according to the local regulations, by pressing on the button marked "T".

⚠ ⚠ DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH


- Test once a month each device by pressing on the button marked "T".
- Failure to follow these instructions will result in death or serious injury.**

The devices should switch off the supply immediately, and should then be switched on to restore the supply. If the devices do not switch off the supply when the button is pressed, seek expert advice.

NOTICE

HAZARD OF IMPROPER OPERATION

- Do not use Test Button to switch OFF RCBO.
- Failure to follow these instructions can result in death, serious injury, or equipment damage.**

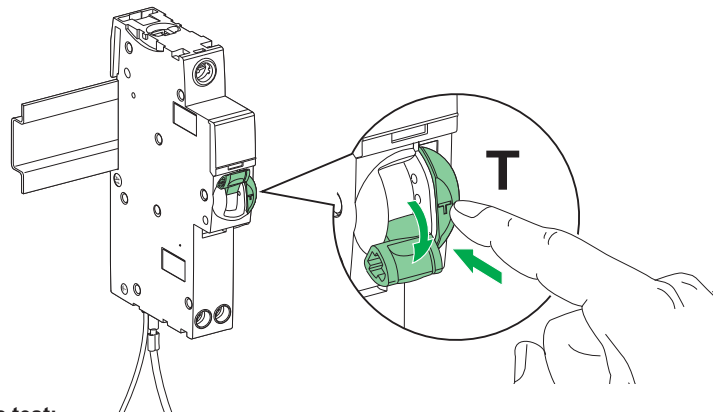

Periodic test:

In the absence of any regulation, Schneider Electric recommends the test should be carried out once a month.

Megger test:

iC60 RCBO must be disconnected before any dielectric tests are carried out.

Schneider Electric Industries SAS
35, rue Joseph Monier
CS 30323
F - 92506 Rueil Malmaison Cedex
www.schneider-electric.com

This product must be installed, connected and used in compliance with prevailing standards and/or installation regulations.
As standards, specifications and designs change from time to time, always ask for confirmation of the information given in this publication.



SCATTERGOOD & JOHNSON LTD

ELECTRICAL ENGINEERING & FLUID CONTROL DISTRIBUTORS

Est.1899

At Scattergood & Johnson Ltd, we pride ourselves on being a technical distributor to specialist industries.

Working with a range of quality product suppliers across a number of specialist markets, we are not your average 'box shifter' - we are your technical and supply chain partner.

We fully support every product we sell - for free! Our internal team and external sales engineers can answer any product or application question, no matter the complexity.

Backing up this technical ability is a range of 50,000+ products available from stock for nationwide next day delivery (same day if required!), or you can collect what you need from any of our trade counters around the UK.

Select your specialist interest below to learn more about how we can help.



Online, In Branch and On the Road - Scattergood & Johnson Ltd, there when you need us.

www.scatts.co.uk