



▲ WARNING / 警告
RISK OF FIRE OR ELECTRIC SHOCK (FOR CONTACTOR WITH UL HI-FAULT SHORT CIRCUIT CURRENT RATINGS ONLY)
 The opening of the branch-circuit protective device may be an indication that a fault current has been interrupted.
 To reduce the risk of the fire or electrical shock, current-carrying parts and other components of the controller should be examined and replaced if damaged.
Failure to follow these instructions can result in death, serious injury, or equipment damage.
 可能有火灾或者触电的危险 (仅限UL高故障短路电流额定值的接触器)。
 支路保护设备断开, 表明故障电流已被中断。
 为降低火灾或触电风险, 应检查带电部件和其它控制元件, 如有损坏, 需及时更换。
 不遵循上述说明可能导致人员伤亡或设备损坏。

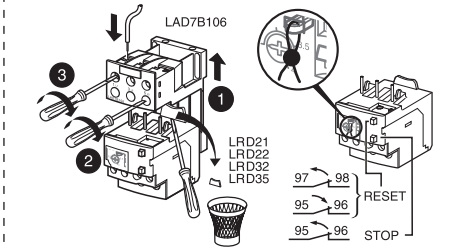

W9 1645523 0211 A07
 04 - 2016

Schneider Electric Industries SAS
 35, rue Joseph Monier
 92506 Rueil Malmaison
 France

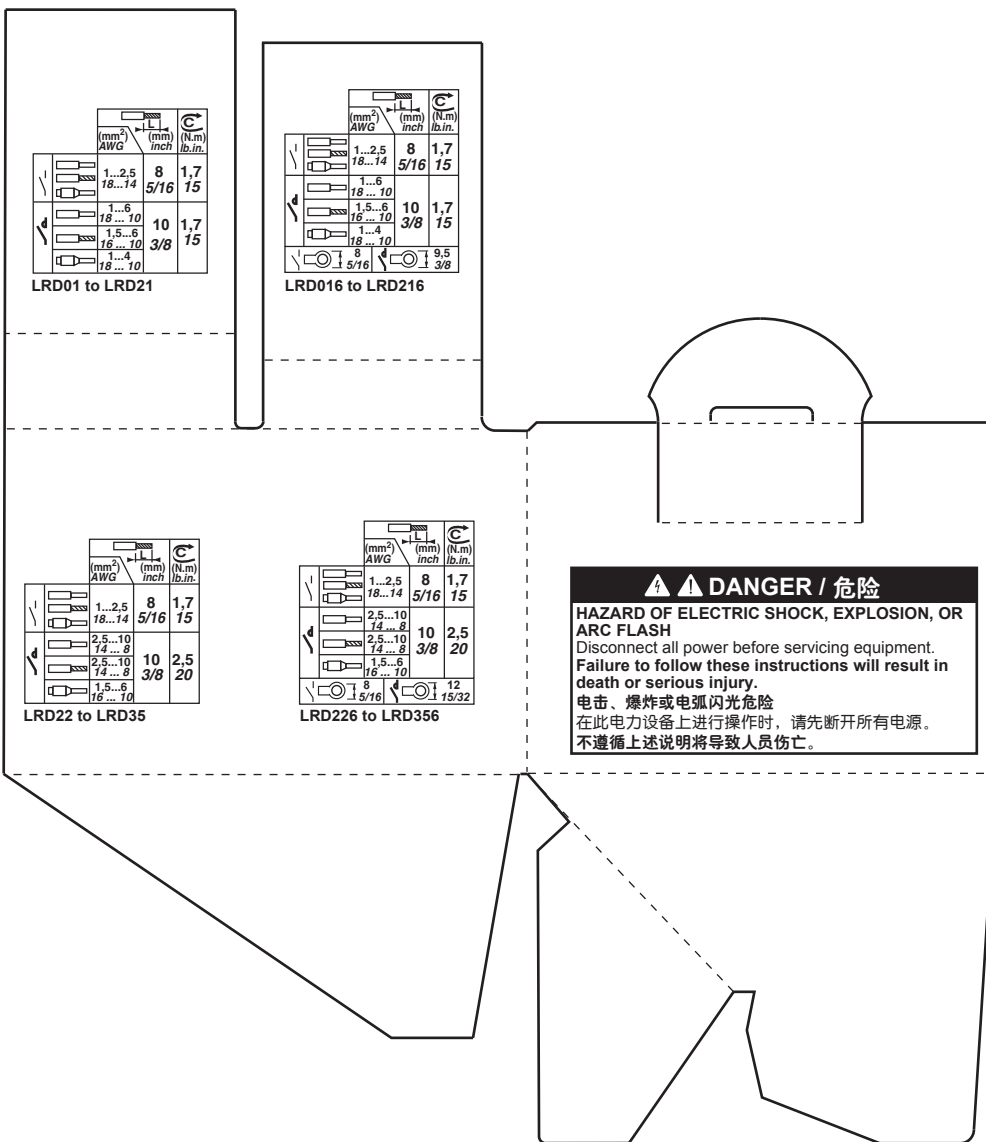



SCATTERGOOD & JOHNSON LTD

ELECTRICAL ENGINEERING & FLUID CONTROL DISTRIBUTORS

Est.1899

At Scattergood & Johnson Ltd, we pride ourselves on being a technical distributor to specialist industries.

Working with a range of quality product suppliers across a number of specialist markets, we are not your average 'box shifter' - we are your technical and supply chain partner.

We fully support every product we sell - for free! Our internal team and external sales engineers can answer any product or application question, no matter the complexity.

Backing up this technical ability is a range of 50,000+ products available from stock for nationwide next day delivery (same day if required!), or you can collect what you need from any of our trade counters around the UK.

Select your specialist interest below to learn more about how we can help.



Online, In Branch and On the Road - Scattergood & Johnson Ltd, there when you need us.

www.scatts.co.uk