

# WAGO → I/O → SYSTEM 750

## Fieldbus Independent I/O Modules

### Counter Modules 750-404, (/xxx-xxx)



## Manual

Version 1.2.0



Copyright © 2012 by WAGO Kontakttechnik GmbH & Co. KG  
All rights reserved.

**WAGO Kontakttechnik GmbH & Co. KG**

Hansastraße 27  
D-32423 Minden

Phone: +49 (0) 571/8 87 – 0  
Fax: +49 (0) 571/8 87 – 1 69  
E-Mail: [info@wago.com](mailto:info@wago.com)  
Web: <http://www.wago.com>

**Technical Support**

Phone: +49 (0) 571/8 87 – 5 55  
Fax: +49 (0) 571/8 87 – 85 55  
E-Mail: [support@wago.com](mailto:support@wago.com)

Every conceivable measure has been taken to ensure the correctness and completeness of this documentation. However, as errors can never be fully excluded, we would appreciate any information or ideas at any time.

E-Mail: [documentation@wago.com](mailto:documentation@wago.com)

We wish to point out that the software and hardware terms as well as the trademarks of companies used and/or mentioned in the present manual are generally trademark or patent protected.

# Content

<b>1</b>	<b>Important Notes .....</b>	<b>5</b>
1.1	Legal Bases.....	5
1.1.1	Copyright.....	5
1.1.2	Personnel Qualifications.....	5
1.1.3	Use of the 750 Series in Compliance with Underlying Provisions .....	6
1.1.4	Technical Condition of Specified Devices .....	6
1.1.5	Standards and Guidelines for Operating the 750 Series.....	7
1.2	Symbols .....	8
1.3	Safety Information.....	9
1.4	Font Conventions .....	10
1.5	Number Notation.....	10
1.6	Scope .....	11
<b>2</b>	<b>I/O Modules .....</b>	<b>12</b>
2.1	Specialty Modules .....	12
2.1.1	Overview Counter Modules 750-404, (/xxx-xxx).....	12
2.1.2	750-404 [Up/Down Counter /100 kHz].....	13
2.1.2.1	Variations .....	13
2.1.2.2	View .....	13
2.1.2.3	Description.....	13
2.1.2.4	Display Elements .....	15
2.1.2.5	Schematic Diagram.....	15
2.1.2.6	Technical Data .....	16
2.1.2.7	Process Image .....	17
2.1.2.7.1	Control- / Status byte 750-404 .....	18
2.1.2.7.2	Control- / Status byte 750-404/000-002.....	19
2.1.2.7.3	Control- / Status byte 750-404/000-004.....	20
2.1.2.8	Examples.....	21
2.1.2.8.1	750-404 .....	21
2.1.2.8.2	750-404/000-002 .....	23
2.1.2.8.3	750-404/000-004 .....	24
2.1.3	750-404/000-001 [Up Counter / Enable Input] .....	25
2.1.3.1	View .....	25
2.1.3.2	Description.....	25
2.1.3.3	Display Elements .....	26
2.1.3.4	Schematic Diagram.....	27
2.1.3.5	Technical Data .....	28
2.1.3.6	Process Image .....	29
2.1.3.7	Example .....	30
2.1.4	750-404/000-003 [Frequency Counter 0.1 Hz-100 kHz] .....	32
2.1.4.1	View .....	32
2.1.4.2	Description.....	32
2.1.4.3	Display Elements .....	34
2.1.4.4	Schematic Diagram.....	34
2.1.4.5	Technical Data .....	35
2.1.4.6	Functional Description.....	36
2.1.4.7	Process Image .....	37

---

2.1.4.8	Example .....	40
2.1.5	750-404/000-005 [2 Up Counter/16 Bit/5 kHz] .....	42
2.1.5.1	View .....	42
2.1.5.2	Description .....	42
2.1.5.3	Display Elements .....	44
2.1.5.4	Schematic Diagram .....	44
2.1.5.5	Technical Data .....	45
2.1.5.6	Process Image .....	46
2.1.5.7	Example .....	47

# 1 Important Notes

This section includes an overall summary of the most important safety requirements and notes that are mentioned in each individual section. To protect your health and prevent damage to devices as well, it is imperative to read and carefully follow the safety guidelines.

## 1.1 Legal Bases

### 1.1.1 Copyright

This Manual, including all figures and illustrations, is copyright-protected. Any further use of this Manual by third parties that violate pertinent copyright provisions is prohibited. Reproduction, translation, electronic and phototechnical filing/archiving (e.g., photocopying) as well as any amendments require the written consent of WAGO Kontakttechnik GmbH & Co. KG, Minden, Germany. Non-observance will involve the right to assert damage claims.

WAGO Kontakttechnik GmbH & Co. KG reserves the right to provide for any alterations or modifications that serve to increase the efficiency of technical progress. WAGO Kontakttechnik GmbH & Co. KG owns all rights arising from the granting of patents or from the legal protection of utility patents. Third-party products are always mentioned without any reference to patent rights. Thus, the existence of such rights cannot be excluded.

### 1.1.2 Personnel Qualifications

The use of the product described in this Manual requires special personnel qualifications, as shown in the following table:

Activity	Electrical specialist	Instructed personnel*)	Specialists**) having qualifications in PLC programming
Assembly	X	X	
Commissioning	X		X
Programming			X
Maintenance	X	X	
Troubleshooting	X		
Disassembly	X	X	

\*) Instructed persons have been trained by qualified personnel or electrical specialists.

\*\*) A specialist is a person, who – thanks to technical training – has the qualification, knowledge and expertise to meet the required specifications of this work and to identify any potential hazardous situation in the above listed fields of activity.

## 6 • Important Notes

### Legal Bases

---

All responsible persons have to familiarize themselves with the underlying legal standards to be applied. WAGO Kontakttechnik GmbH & Co. KG does not assume any liability whatsoever resulting from improper handling and damage incurred to both WAGO's own and third-party products by disregarding detailed information in this Manual.

### 1.1.3 Use of the 750 Series in Compliance with Underlying Provisions

Couplers, controllers and I/O modules found in the modular WAGO-I/O-SYSTEM 750 receive digital and analog signals from sensors and transmit them to the actuators or higher-level control systems. Using programmable controllers, the signals can also be (pre-)processed.

The components have been developed for use in an environment that meets the IP20 protection class criteria. Protection against finger injury and solid impurities up to 12.5 mm diameter is assured; protection against water damage is not ensured. Unless otherwise specified, operation of the components in wet and dusty environments is prohibited.

### 1.1.4 Technical Condition of Specified Devices

The components to be supplied Ex Works, are equipped with hardware and software configurations, which meet the individual application requirements. Changes in hardware, software and firmware are permitted exclusively within the framework of the various alternatives that are documented in the specific manuals. WAGO Kontakttechnik GmbH & Co. KG will be exempted from any liability in case of changes in hardware or software as well as to non-compliant usage of components.

Please send your request for modified and new hardware or software configurations directly to WAGO Kontakttechnik GmbH & Co. KG.

### 1.1.5 Standards and Guidelines for Operating the 750 Series

Please adhere to the standards and guidelines required for the use of your system:

- The data and power lines shall be connected and installed in compliance with the standards required to avoid failures on your system and to substantially minimize any imminently hazardous situations resulting in personal injury.
- For assembly, start-up, maintenance and troubleshooting, adhere to the specific accident prevention provisions which apply to your system (e.g. BGV A 3, "Electrical Installations and Equipment").
- Emergency stop functions and equipment shall not be made ineffective. See relevant standards (e.g. DIN EN 418).
- The equipment of your system shall be conform to EMC guidelines so that any electromagnetic interferences will be eliminated.
- Operating 750 Series components in home applications without further measures is permitted only if they meet the emission limits (emissions of interference) in compliance with EN 61000-6-3. You will find the detailed information in section "WAGO-I/O-SYSTEM 750" → "System Description" → "Technical Data".
- Please observe the safety precautions against electrostatic discharge in accordance with DIN EN 61340-5-1/-3. When handling the modules, please ensure that environmental factors (persons, working place and packaging) are well grounded.
- The valid standards and guidelines applicable for the installation of switch cabinets shall be adhered to.

## 1.2 Symbols



---

**Danger**

Always observe this information to protect persons from injury.

---



---

**Warning**

Always observe this information to prevent damage to the device.

---



---

**Attention**

Marginal conditions that must always be observed to ensure smooth and efficient operation.

---



---

**ESD (Electrostatic Discharge)**

Warning of damage to the components through electrostatic discharge. Observe the precautionary measure for handling components at risk of electrostatic discharge.

---



---

**Note**

Make important notes that are to be complied with so that a trouble-free and efficient device operation can be guaranteed.

---



---

**Additional Information**

References to additional literature, manuals, data sheets and internet pages.

---

## 1.3 Safety Information

When connecting the device to your installation and during operation, the following safety notes must be observed:



### **Danger**

The WAGO-I/O-SYSTEM 750 and its components are an open system. It must only be assembled in housings, cabinets or in electrical operation rooms. Access is only permitted via a key or tool to authorized qualified personnel.



### **Danger**

All power sources to the device must always be switched off before carrying out any installation, repair or maintenance work.



### **Warning**

Replace defective or damaged device/module (e.g. in the event of deformed contacts), as the functionality of field bus station in question can no longer be ensured on a long-term basis.



### **Warning**

The components are not resistant against materials having seeping and insulating properties. Belonging to this group of materials is: e.g. aerosols, silicones, triglycerides (found in some hand creams). If it cannot be ruled out that these materials appear in the component environment, then the components must be installed in an enclosure that is resistant against the above mentioned materials. Clean tools and materials are generally required to operate the device/module.



### **Warning**

Soiled contacts must be cleaned using oil-free compressed air or with ethyl alcohol and leather cloths.



### **Warning**

Do not use contact sprays, which could possibly impair the functioning of the contact area.



### **Warning**

Avoid reverse polarity of data and power lines, as this may damage the devices.



### **ESD (Electrostatic Discharge)**

The devices are equipped with electronic components that may be destroyed by electrostatic discharge when touched.

## 10 • Important Notes

### Font Conventions

---



#### Warning

For components with ETHERNET/RJ-45 connectors:  
Only for use in LAN, not for connection to telecommunication circuits.

---

## 1.4 Font Conventions

- italic* Names of paths and data files are marked in italic-type.  
e.g.: *C:\Programs\WAGO-IO-CHECK*
  
- italic* Menu items are marked in italic-type, bold letters.  
e.g.: ***Save***
  
- \ A backslash between two names characterizes the selection of a menu point from a menu.  
e.g.: ***File | New***
  
- END** Pushbuttons are marked as bold with small capitals  
e.g.: **ENTER**
  
- <>** Keys are marked bold within angle brackets  
e.g.: **<F5>**
  
- Courier** The print font for program codes is Courier.  
e.g.: **END\_VAR**

## 1.5 Number Notation

Number code	Example	Note
Decimal	100	Normal notation
Hexadecimal	0x64	C notation
Binary	'100' '0110.0100'	In quotation marks, nibble separated with dots (.)

## 1.6 Scope

This manual describes the Special Module 750-404, (/xxx-xxx) Counter Modules of the modular WAGO-I/O-SYSTEM 750.

Handling, assembly and start-up are described in the manual of the Fieldbus Coupler/Controller. Therefore this documentation is valid only in the connection with the appropriate manual.

## 2 I/O Modules

### 2.1 Specialty Modules

#### 2.1.1 Overview Counter Modules 750-404, (/xxx-xxx)

I/O Module	<a href="#">750-404</a>	<a href="#">750-404/ 000-001</a>	<a href="#">750-404/ 000-002</a>	<a href="#">750-404/ 000-003</a>	<a href="#">750-404/ 000-004</a>	<a href="#">750-404/ 000-005</a>
Function	Up / Down Counter	Up Counter / Enable Input	Peak Time Counter	Frequency Counter	Up / Down Counter / Switch Output	2 Up Counter
Channels	1	1	1	1	1	2
Switching rate	max. 100 kHz	max. 100 kHz	max. 10 kHz	0,1 Hz ... 100 kHz	max. 100 kHz	max. 5 kHz
Counter depth	32 bit	32 bit	32 bit	32 bit	32 bit	16 bit

## 2.1.2 750-404 [Up/Down Counter /100 kHz]

Up/Down Counter, DC 24 V, 100 kHz

### 2.1.2.1 Variations

Item-No.	Designation	Description
750-404	Up/Down Counter / 100 kHz	Up/Down Counter, DC 24 V, 100 kHz
750-404/000-002	Peak Time Counter	Peak Time Counter, DC 24 V, 10 kHz
750-404/000-004	Up / Down Counter / Switch Output	Up/Down Counter, 24 V, 100kHz, Switch Output

### 2.1.2.2 View

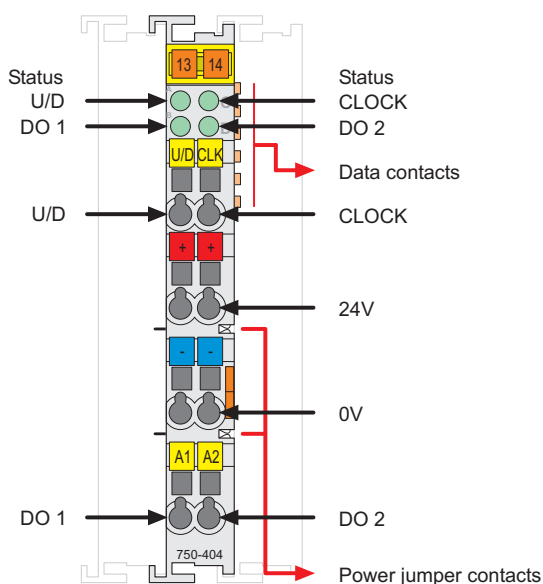


Fig. 2.1.2-1: View

g040400e

### 2.1.2.3 Description

The Up/Down counter 750-404 and the variation 750-404/000-004 is capable of counting binary pulses of DC 24 V at the input CLOCK and then transmits the data to the fieldbus.

The counter module 750-404/000-002 begins processing with pulses at the CLOCK input and counts the pulses in a special time span. The time span is given as 10 s.

The changes from 0 V to 24 V are counted

The counter counts up, if the input U/D is set at 24 V. With an open circuit input or 0 V the counter counts backwards.

## 14 • 750-404 [Up/Down Counter /100 kHz] Description

---

The counter can be set or reset with the control byte.

The digital outputs DO 1 and DO 2 of the counter module 750-404 and the variation 750-404/000-002 are activated through bits in the control byte. The digital outputs DO 1 and DO 2 of the counter module 750-404/000-004 are activated depending on the counter reading or through bits in the control byte.

The outputs are short-circuit-protected.

The high states of the inputs U/D and CLOCK and the digital output channels are each indicated by a green LED.

An optocoupler is used for electrical isolation between the bus and the field side.

Any configuration of the counter modules is possible when designing the fieldbus node. Grouping of module types is not necessary.

The field side supply voltage of 24 V for the counter module is derived from adjacent I/O modules or from a supply module. The supply voltage for the field side is made automatically through the individual I/O modules by means of power jumper contacts.



### Warning

The maximum current of the internal power jumper contacts is 10 A. When configuring the system it is important not to exceed the maximum/sum current. However, if such a case should occur, another supply module must be added.

---



### Attention

This module has no power contacts for receiving and transmitting the ground (earth) potential. A supply module is required, if the adjacent modules need to be connected to the ground.

---



### Note

Use an appropriate supply module (e.g. 750-602) if an electrically isolated voltage supply is required!

---

The module 750-404 and the variations 750-404/000-002 and 750-404/000-004 can be used with all couplers/controllers of the WAGO-I/O-SYSTEM 750 (except for the economy types 750-320, 750-323, 750-324 and 750-327 and the ModBus controllers 750-812, 750-812/025-000 and 750-814).

2.1.2.4 Display Elements




Fig. 2.1.2-2: Display Elements g041402x

LED	Channel	Meaning	State
A	Status U/D	off	Input U/D: Signal voltage (0), Backwards counting
		green	Input U/D: Signal voltage (1), Forward counting
B	Status DO 1	off	Digital Output DO 1 reset
		green	Digital Output DO 1 setting
C	Status CLOCK	off	Input CLOCK: Signal voltage (0)
		green	Input CLOCK: Signal voltage (1) Counting pulse
D	Status DO 2	off	Digital Output DO 2 reset
		green	Digital Output DO 2 setting

2.1.2.5 Schematic Diagram

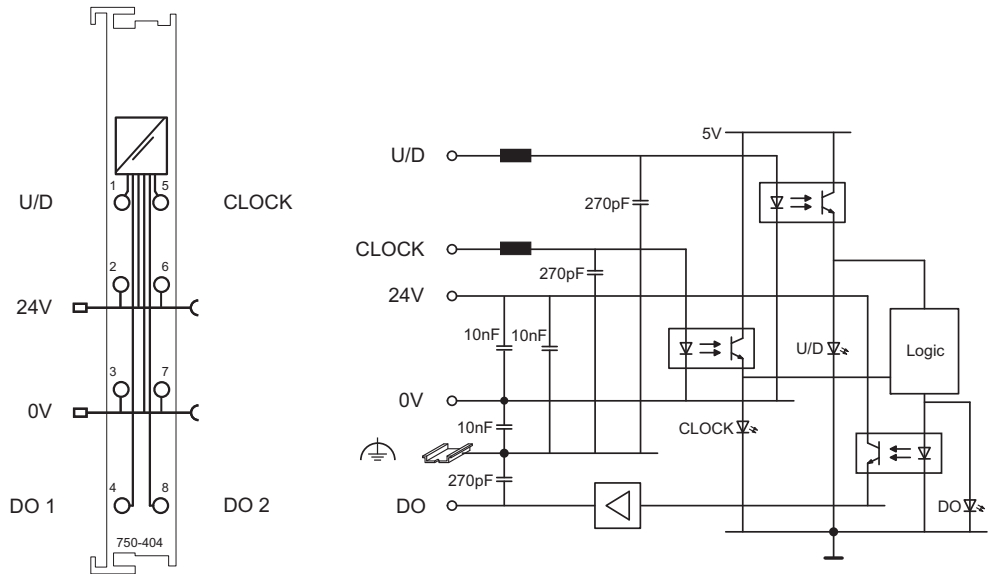















Fig. 2.1.2-3: Schematic Diagram

g040401e

16 • 750-404 [Up/Down Counter /100 kHz]  
 Technical Data

### 2.1.2.6 Technical Data

Module Specific Data		
Number of outputs	2	
Number of counters	1	
Output current	0.5 A short-circuit-protected	
Current consumption (internal)	15 mA	
Voltage via power jumper contacts	DC 24 V (-15 % ... + 20 %)	
Signal voltage	(0): DC -3 V ... +5 V (1): DC +15 V ... +30 V	
Switching rate <sub>max.</sub>	100 kHz (750-404, 750-404/000-004) 10 kHz (750-404/000-002)	
Input current <sub>typ.</sub>	6 mA	
Counter depth	32 bits data	
Isolation	500 V (System/Supply)	
Internal bit width	32 bits data 8 bits control /status	
Dimensions W x H* x L * from upper edge of 35 DIN rail	12 mm x 64 mm x 100 mm	
Weight	ca. 55 g	
Standards and Regulations (cf. Chapter 2.2 of the Coupler/Controller Manual)		
EMC-Immunity to interference (CE)	acc. to EN 50082-2 (96)	
EMC-Emission of interference (CE)	acc. to EN 50081-1 (93)	
Approvals (cf. Chapter 2.2 of the Coupler/Controller Manual)		
 cUL <sub>US</sub>	cUL <sub>US</sub> (UL508)	
	ABS (American Bureau of Shipping)	
	BV (Bureau Veritas) (applied for)	
	DNV (Det Norske Veritas)	Cl. B
	GL (Germanischer Lloyd) (applied for)	Cat. A, B, C, D
	KR (Korean Register of Shipping)	
	LR (Lloyd's Register)	Env. 1, 2, 3, 4
	NKK (Nippon Kaiji Kyokai)	
	PRS (Polski Rejestr Statków)	
	RINA (Registro Italiano Navale)	
	cUL <sub>US</sub> (ANSI/ISA 12.12.01)	Class I Div2 ABCD T4

	DEMKO / IEC	II 3 G EEx nA II T4
	Conformity Marking	



### More Information

Detailed references to the approvals are listed in the document "Overview Approvals WAGO-I/O-SYSTEM 750", which you can find on the CD ROM "AUTOMATION Tools and Docs" (Item-No.: 0888-0412) or in the internet under: <http://www.wago.com> → Documentation → WAGO-I/O-SYSTEM 750 → System Description

### 2.1.2.7 Process Image

Using the I/O module 750-404, a 5 byte input and output process image can be transferred to the fieldbus coupler / controller via one logical channel.

The transfer of the setting counter value in binary format is made via 4 output bytes (D0 ... D3) and the transfer of the counter reading in binary format is made via 4 input bytes (D0 ... D3). The control byte C0 serves for setting the counter and the outputs. The status byte S0 shows the status of the counter and the inputs and outputs.



### Attention

The representation of the process data of some I/O modules or their variations in the process image depends on the fieldbus coupler/-controller used. Please take this information as well as the particular design of the respective control/status bytes from the section "Fieldbus Specific Design of the Process Data" included in the description concerning the process image of the corresponding coupler/controller.

Input data		Output data	
S0	Status byte 0	C0	Control byte 0
D0	Counter value byte 0 (LSB)	D0	Set value byte 0 (LSB)
D1	Counter value byte 1	D1	Set value byte 1
D2	Counter value byte 2	D2	Set value byte 2
D3	Counter value byte 3 (MSB)	D3	Set value byte 3 (MSB)

18 • 750-404 [Up/Down Counter /100 kHz]  
Process Image

### 2.1.2.7.1 Control- / Status byte 750-404

The control byte C0 serves for setting and locking the counter and for setting the outputs. The status byte S0 shows the status of the counter and the inputs and outputs.

Control byte							
B7	B6	B5	B4	B3	B2	B1	B0
0	0	Set counter	Lock counter	Set output DO 2	Set output DO 1	0	0

0 This constant must be set to zero.

Status byte							
B7	B6	B5	B4	B3	B2	B1	B0
X	X	Counter is set	Counter is blocked	actual signal at output DO 2	actual signal at output DO 1	actual signal at input U/D	actual signal at input CLOCK

X This value is not evaluated.

With the control and status byte the following tasks are possible:

#### Set Counter:

Put Bit 5 into the control byte. The counter with the 32 bit value is loaded into output bytes 0-3. As long as the bits are set, the counter can stop and information is stored. The ensuing data of the counter will be conveyed to the status byte.

#### Lock Counter:

Bit 4 is set into the control byte, then the count process is suppressed. Bit 4 in the status byte communicates the suppression of the counter.

#### Set/ Reset Outputs:

Bits 2 and 3 set the additional two outputs of the counter module.

**2.1.2.7.2 Control- / Status byte 750-404/000-002**

The control byte C0 serves for starting the periodic counter pulse measurement and for setting the outputs. The status byte S0 shows the status of the counter and the inputs and outputs.

Control byte							
B7	B6	B5	B4	B3	B2	B1	B0
0	0	Start of the periodic counting	0	Set output DO 2	Set output DO 1	0	0

0 This constant must be set to zero.

Status byte							
B7	B6	B5	B4	B3	B2	B1	B0
X	X	Counting starting	X	actual signal at output DO 2	actual signal at output DO 1	actual signal at input U/D	Toggelbit for end of the record

X This value is not evaluated.

The counter begins processing with pulses at the CLOCK input and counts the pulses in a special time span. The time span is given as 10 s.

The state of the counter is stored in the process image until the next period. After the recording the counting starts again at 0.

The activation of the counting and the synchronization with the SPS is made by a handshake in the control and status byte.

The end of the counting period and thus the new process data is signaled by a toggle bit in the status byte.

20 • 750-404 [Up/Down Counter /100 kHz]  
Process Image

### 2.1.2.7.3 Control- / Status byte 750-404/000-004

The control byte C0 serves for setting and locking the counter and for setting the outputs dependent or independently on the counter reading. The status byte S0 shows the status of the counter and the inputs and outputs.

Control byte							
B7	B6	B5	B4	B3	B2	B1	B0
0	0	Set counter	Lock Counter	Set output DO 2	Set output DO 1	Output O2 activated depending of the counter value	Output O1 activated depending of the counter value

0 This constant must be set to zero.

Status byte							
B7	B6	B5	B4	B3	B2	B1	B0
X	X	Counter is set	Counter is blocked	actual signal at output DO 2	actual signal at output DO 1	actual signal at input U/D	actual signal at input CLOCK

X This value is not evaluated.

With the control and status byte the following tasks are possible:

#### Set Counter:

Put Bit 5 into the control byte. The counter with the 32 bit value is loaded into output bytes 0-3. As long as the bits are set, the counter can stop and information is stored. The ensuing data of the counter will be conveyed to the status byte.

#### Lock Counter:

Bit 4 is set into the control byte, then the count process is suppressed. Bit 4 in the status byte communicates the suppression of the counter.

#### Switching the outputs dependent of the counter:

The bits 0 and 1 activate the function: output dependent setting of binary outputs. If the counter reading 0x80000000 is exceeded, output DO 1 is activated. For the output DO 2 only the bottom 16 bits of the counter reading are taken into account, which means that output DO 2 is activated as soon as the counter reading 0x8000 is exceeded. Having reached 0 again, the outputs are reset.

**Set Outputs:**

Bits 2 and 3 set the digital outputs DO 1 and DO 2 of the counter module. If bits 2 or 3 are also set, they have priority before bits 0 and 1, so that the corresponding output is set independent of the counter reading.

**2.1.2.8 Examples****2.1.2.8.1 750-404****Set Counter:**

First of all the counter reading is set to 100 by "Setting counter", i. e. to the hexadecimal value: 0x64.

1. Enter the counter reading in the output data.

The data bytes D0 to D3 of the output data then read as follows:

Data bytes				
Output data	D3	D2	D1	D0
Value	0x00	0x00	0x00	0x64

2. Validate the counter reading in the control byte with bit 5 (setting counter) to have it adopted as an output value. The control byte has the following bits:

Control byte								
Output bit	B7	B6	B5	B4	B3	B2	B1	B0
Value	0	X	1	X	X	X	X	X

3. Wait for the feedback from the counter module in the status byte, bit 5 (counter set). The status byte has the following bits:

Status byte								
Input bit	B7	B6	B5	B4	B3	B2	B1	B0
Value	X	X	1	X	X	X	X	X

4. Delete bit 5 (setting counter) in the control byte in order to finish the Handshake. The bits in the control byte read as follows:

Control byte								
Output bit	B7	B6	B5	B4	B3	B2	B1	B0
Value	0	X	0	X	X	X	X	X

5. The set counter reading then appears in the input data with the following data bytes D0 to D3:

Data bytes				
Input bit	D3	D2	D1	D0
Wert	0x00	0x00	0x00	0x64

X is used if a value is not relevant.

22 • 750-404 [Up/Down Counter /100 kHz]  
Examples

**Up counting:**



**Attention**

For counting up, 24 V must be applied to input U/D.

6. Wait for the first and further count pulses.  
During counting, the data bytes D0 to D3 of the input data appear as follows:

Data bytes				
Remark	D3	D2	D1	D0
no count pulse received	0x00	0x00	0x00	0x64
1st count pulse received	0x00	0x00	0x00	0x65
2nd count pulse received	0x00	0x00	0x00	0x66
Further count pulses	.....	.....	.....	.....
Max. counter reading reached	0xFF	0xFF	0xFF	0xFF
the next count pulse causes a number overflow	0x00	0x00	0x00	0x00
One further count pulse received	0x00	0x00	0x00	0x01

## 2.1.2.8.2 750-404/000-002

1. The counter counts up (the input U/D is set at 24 V). The counter reading is 0. The timer interrupts. No count pulse received on the input CLOCK.

Control byte								
Input bit	B7	B6	B5	B4	B3	B2	B1	B0
Value	0	0	0	0	X	X	0	0

Status byte								
Output bit	B7	B6	B5	B4	B3	B2	B1	B0
Value	0	0	0	0	X	X	1	0

2. The cyclic period measurement is requested. The counter reading is 0. The timer interrupts. No count pulse received on the input CLOCK.

Control byte								
Input bit	B7	B6	B5	B4	B3	B2	B1	B0
Value	0	0	1	0	X	X	0	0

Status byte								
Output bit	B7	B6	B5	B4	B3	B2	B1	B0
Value	0	0	0	0	X	X	1	0

3. The cyclic period measurement is started. The counter reading is 0. The timer runs with the parameterized cycle time. Count pulses received on the input CLOCK.

Control byte								
Input bit	B7	B6	B5	B4	B3	B2	B1	B0
Value	0	0	1	0	X	X	0	0

Status byte								
Output bit	B7	B6	B5	B4	B3	B2	B1	B0
Value	0	0	1	0	X	X	1	0

4. The cyclic period measurement is running. The counter reading is reset and the timer is started again. The process data supply the number of impulses, which were registered in the previous cycle.

Control byte								
Input bit	B7	B6	B5	B4	B3	B2	B1	B0
Value	0	0	1	0	X	X	0	0

Status byte								
Output bit	B7	B6	B5	B4	B3	B2	B1	B0
Value	0	0	1	0	X	X	1	1

5. The cyclic period measurement is running. The counter reading is reset and the timer is started again. The process data supply the number of impulses, which were registered in the previous cycle.

Control byte								
Input bit	B7	B6	B5	B4	B3	B2	B1	B0
Value	0	0	1	0	X	X	0	0

Status byte								
Output bit	B7	B6	B5	B4	B3	B2	B1	B0
Value	0	0	1	0	X	X	1	0

24 • 750-404 [Up/Down Counter /100 kHz]  
Examples

6. The cyclic period measurement is running. Stopping the cyclic recording was requested. The process data supply the counter reading, which was registered in the previous cycle.

Control byte								
Input bit	B7	B6	B5	B4	B3	B2	B1	B0
Value	0	0	0	0	X	X	0	0

Status byte								
Output bit	B7	B6	B5	B4	B3	B2	B1	B0
Value	0	0	1	0	X	X	1	X

7. The cyclic period measurement is stopped. The counter reading is reset. The process data supply the value 0.

Control byte								
Input bit	B7	B6	B5	B4	B3	B2	B1	B0
Value	0	0	0	0	X	X	0	0

Status byte								
Output bit	B7	B6	B5	B4	B3	B2	B1	B0
Value	0	0	0	0	X	X	1	0

### 2.1.2.8.3 750-404/000-004

Set the digital output DO 1 after 4.000 pulses have been counted. There are several possibilities to set an output.

If DO 1 is used as an automatic switching output and if the counter is to count up, set the counter to

$$0x80000000 - 4000 = 0x7FFFF060$$

and apply + 24V to the U/D input. Furthermore, activate bit 0 in the control byte. After 4000 pulses, the counter reading of 0x80000000 is reached and output DO 1 activated.

If you wish the counter to count down, pre-set

$$0x80000000 + 4000 = 0x80000FA0$$

and apply 0V to U/D. After 4000 pulses the counter reading 0x80000000 is reached and output DO 1 deactivated.

If DO 2 is to be used as a switching output, load the counter with

$$0x8000 - 4000 = 0x7060 \text{ or}$$

$$0x8000 + 4000 = 0x8FA0$$

respectively, because only the bottom 16 bits of the counter are used for switching output DO 2. Instead of bit 0 now activate bit 1 in the control byte.

The binary output not involved each time can be directly addressed by the controls via bit 2 and 3.

## 2.1.3 750-404/000-001 [Up Counter / Enable Input]

Up Counter / Enable Input, DC 24 V, 100 kHz

### 2.1.3.1 View

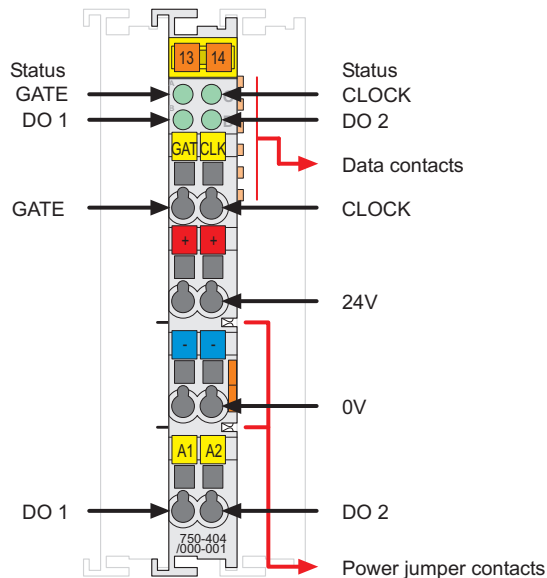


Fig. 2.1.3-1: View

g040410e

### 2.1.3.2 Description

The Up counter is capable of counting binary pulses of DC 24 V at the input CLOCK and then transmits the data to the fieldbus. The changes from 0 V to 24 V are counted.

The counter is locked with an open circuit or 0 V on input GATE. With +24 V on input GATE, the counter is enabled.

The counter can be set or reset with the control byte.

The digital outputs DO 1 and DO 2 are activated through bits in the control byte.

The outputs are short-circuit-protected.

The high states of the inputs GATE and CLOCK and the digital output channels are each indicated by a green LED.

An optocoupler is used for electrical isolation between the bus and the field side.

Any configuration of the counter modules is possible when designing the fieldbus node. Grouping of module types is not necessary.

## 26 • 750-404/000-001 [Up Counter / Enable Input] Display Elements

The field side supply voltage of 24 V for the counter module is derived from adjacent I/O modules or from a supply module. The supply voltage for the field side is made automatically through the individual I/O modules by means of power jumper contacts.



### Warning

The maximum current of the internal power jumper contacts is 10 A. When configuring the system it is important not to exceed the maximum/sum current. However, if such a case should occur, another supply module must be added.



### Attention

This module has no power contacts for receiving and transmitting the ground (earth) potential. A supply module is required, if the adjacent modules need to be connected to the ground.



### Note

Use an appropriate supply module (e.g. 750-602) if an electrically isolated voltage supply is required!

The module 750-404/000-001 can be used with all couplers/controllers of the WAGO-I/O-SYSTEM 750 (except for the economy types 750-320, 750-323, 750-324 and 750-327 and the ModBus controllers 750-812, 750-812/025-000 and 750-814).

### 2.1.3.3 Display Elements




Fig. 2.1.3-2: Display Elements g041402x

LED	Channel	Meaning	State
A	Status GATE	off	Input GATE: Signal voltage (0), Counting closed
		green	Input GATE: Signal voltage (1), Counting approved
B	Status DO 1	off	Digital Output DO 1 reset
		green	Digital Output DO 1 setting
C	Status CLOCK	off	Input CLOCK: Signal voltage (0)
		green	Input CLOCK: Signal voltage (1)
D	Status DO 2	off	Digital Output DO 2 reset
		green	Digital Output DO 2 setting

2.1.3.4 Schematic Diagram

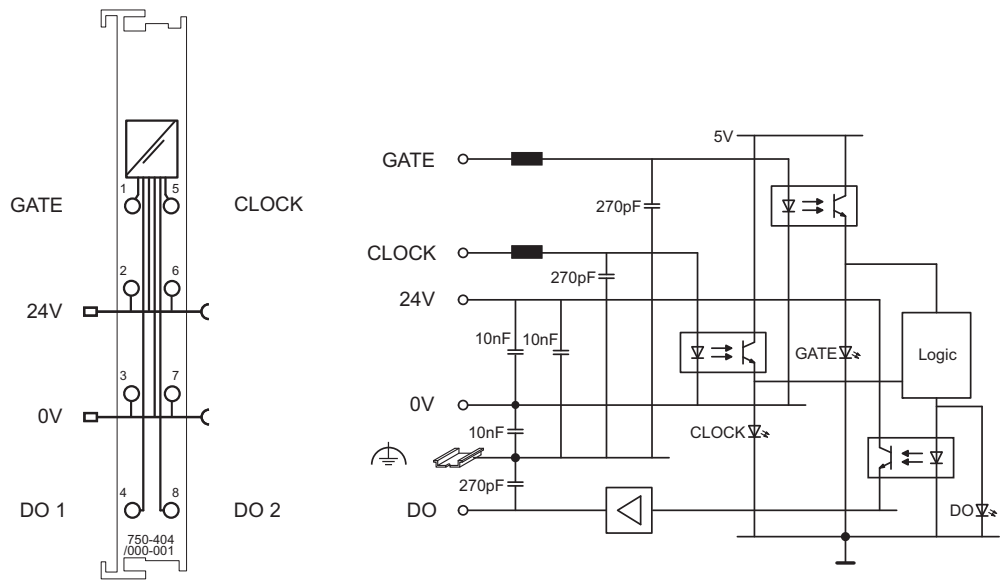







Fig. 2.1.3-3: Schematic Diagram

g040411e

28 • 750-404/000-001 [Up Counter / Enable Input]  
 Technical Data

### 2.1.3.5 Technical Data

Module Specific Data		
Number of outputs	2	
Number of counters	1	
Output current	0.5 A short-circuit-protected	
Current consumption (internal)	15 mA	
Voltage via power jumper contacts	DC 24 V (-15 % ... + 20 %)	
Signal voltage	(0): DC -3 V ... +5 V (1): DC +15 V ... +30 V	
Switching rate <sub>max.</sub>	100 kHz	
Input current <sub>typ.</sub>	6 mA	
Counter depth	32 bits data	
Isolation	500 V (System/Supply)	
Internal bit width	32 bits data 8 bits control /status	
Dimensions W x H* x L * from upper edge of 35 DIN rail	12 mm x 64 mm x 100 mm	
Weight	ca. 55 g	
Standards and Regulations (cf. Chapter 2.2 of the Coupler/Controller Manual)		
EMC-Immunity to interference (CE)	acc. to EN 50082-2 (96)	
EMC-Emission of interference (CE)	acc. to EN 50081-1 (93)	
Approvals (cf. Chapter 2.2 of the Coupler/Controller Manual)		
	cUL <sub>US</sub> (UL508)	
	cUL <sub>US</sub> (UL1604)	Class I Div2 ABCD T4A
	DNV (Det Norske Veritas)	Cl. B
	KEMA	II 3 G EEx nA II T4
	Conformity Marking	



#### More Information

Detailed references to the approvals are listed in the document "Overview Approvals WAGO-I/O-SYSTEM 750", which You can find on the CD ROM ELECTRONIC Tools and Docs (Item-No.: 0888-0412-0001-0101) or in the Internet under: <http://www.wago.com> → Service → Downloads → Documentation → WAGO-I/O-SYSTEM 750 → System Description.

### 2.1.3.6 Process Image

Using the I/O module 750-404/000-001, a 5 byte input and output process image can be transferred to the fieldbus coupler / controller via two logical channels.

The transfer of the setting counter value in binary format is made via 4 output bytes (D0 ... D3) and the transfer of the counter reading in binary format is made via 4 input bytes (D0 ... D3). The control byte C0 serves for setting and locking the counter and for setting the outputs. The status byte S0 shows the status of the counter and the inputs and outputs.



#### Attention

The representation of the process data of some I/O modules or their variations in the process image depends on the fieldbus coupler/-controller used. Please take this information as well as the particular design of the respective control/status bytes from the section "Fieldbus Specific Design of the Process Data" included in the description concerning the process image of the corresponding coupler/controller.

Input data		Output data	
S0	Status byte 0	C0	Control byte 0
D0	Counter value byte 0 (LSB)	D0	Set value byte 0 (LSB)
D1	Counter value byte 1	D1	Set value byte 1
D2	Counter value byte 2	D2	Set value byte 2
D3	Counter value byte 3 (MSB)	D3	Set value byte 3 (MSB)

Control byte							
B7	B6	B5	B4	B3	B2	B1	B0
0	0	Set counter	Lock counter	Set output DO 2	Set output DO 1	0	0

0 This constant must be set to zero.

Status byte 0							
B7	B6	B5	B4	B3	B2	B1	B0
X	X	Counter is set	Counter is blocked	actual signal at output DO 2	actual signal at output DO 1	actual signal at input U/D	actual signal at input CLOCK

X This value is not evaluated.

## 30 • 750-404/000-001 [Up Counter / Enable Input]

## Example

With the control and status byte the following tasks are possible:

**Set Counter:**

Put Bit 5 into the control byte. The counter with the 32 bit value is loaded into output bytes 0-3. As long as the bits are set, the counter can stop and information is stored. The ensuing data of the counter will be conveyed to the status byte.

**Lock Counter:**

Bit 4 is set into the control byte, then the count process is suppressed. Bit 4 in the status byte communicates the suppression of the counter.

**Set Outputs:**

Bits 2 and 3 set the additional two outputs of the counter module.

**2.1.3.7 Example****Set Counter:**

First of all the counter reading is set to 100 by "Setting counter", i. e. to the hexadecimal value: 0x64.

8. Enter the set value in the output data.

The data bytes D0 to D3 of the output data then read as follows:

Data bytes				
Output data	D3	D2	D1	D0
Value	0x00	0x00	0x00	0x64

9. Validate the counter reading in the control byte with bit 5 (setting counter) to have it adopted as an output value. The control byte has the following bits:

Control byte								
Output bit	B7	B6	B5	B4	B3	B2	B1	B0
Value	0	X	1	X	X	X	X	X

10. Wait for the feedback from the counter module in the status byte, bit 5 (counter set). The status byte has the following bits:

Status byte								
Input bit	B7	B6	B5	B4	B3	B2	B1	B0
Value	X	X	1	X	X	X	X	X

11. Delete bit 5 (setting counter) in the control byte in order to finish the Handshake. The bits in the control byte read as follows:

Control byte								
Output bit	B7	B6	B5	B4	B3	B2	B1	B0
Value	0	X	0	X	X	X	X	X

12. The set counter reading then appears in the input data with the following data bytes D0 to D3:

Data bytes				
Input bit	D3	D2	D1	D0
Value	0x00	0x00	0x00	0x64

X is used if a value is not relevant.

**Up counting:****Attention**

For counting up, 24 V must be applied to input GATE.

13. Wait for the first and further count pulses.

During counting, the data bytes D0 to D3 of the input data appear as follows:

Remark	Data bytes			
	D3	D2	D1	D0
no count pulse received	0x00	0x00	0x00	0x64
1st count pulse received	0x00	0x00	0x00	0x65
2nd count pulse received	0x00	0x00	0x00	0x66
Further count pulses	.....	.....	.....	.....
Max. counter reading reached	0xFF	0xFF	0xFF	0xFF
the next count pulse causes a number overflow	0x00	0x00	0x00	0x00
One further count pulse received	0x00	0x00	0x00	0x01

## 32 • 750-404/000-003 [Frequency Counter 0.1 Hz-100 kHz] View

### 2.1.4 750-404/000-003 [Frequency Counter 0.1 Hz-100 kHz]

Frequency Counter 0.1 Hz ... 100 kHz, DC 24 V

#### 2.1.4.1 View

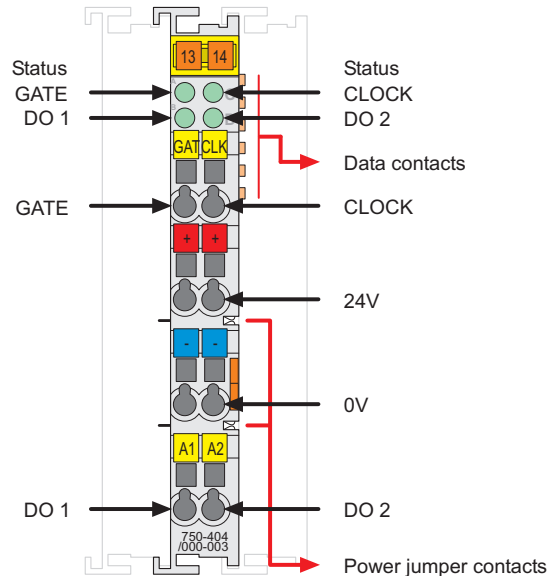


Fig. 2.1.4-1: View

g040430e

#### 2.1.4.2 Description

The counter module also can be ordered as frequency counter module with 750-404/000-003.

The counter module 750-404/000-003 measures the period of the 24 V DC input signal at the input CLOCK and converts it into a corresponding frequency value. The measurement is enabled if the input GATE is an open circuit input or 0V. To disable processing, the GATE input is to be set to 24 V DC.

To recognize low frequency or near zero frequency signals, the maximum time between two data updates is parameterizable.

The digital outputs DO1 and DO2 can be activated via specific bits in the Control byte.

The outputs are short-circuit-protected.

The high states of the inputs GATE and CLOCK and the output channels are each indicated by a LED.

An optocoupler is used for electrical isolation between the bus and the field side.

Any configuration of the counter modules is possible when designing the fieldbus node. Grouping of module types is not necessary.

The field side supply voltage of 24 V for the counter module is derived from adjacent I/O modules or from a supply module. The supply voltage for the field side is made automatically through the individual I/O modules by means of power jumper contacts.



---

**Warning**

The maximum current of the internal power jumper contacts is 10 A. When configuring the system it is important not to exceed the maximum/sum current. However, if such a case should occur, another supply module must be added.

---



---

**Attention**

This module has no power contacts for receiving and transmitting the ground (earth) potential. A supply module is required, if the adjacent modules need to be connected to the ground.

---



---

**Note**

Use an appropriate supply module (e.g. 750-602) if an electrically isolated voltage supply is required!

---

The module 750-404/000-003 can be used with all couplers/controllers of the WAGO-I/O-SYSTEM 750 (except for the economy types 750-320, 750-323, 750-324 and 750-327 and the ModBus controllers 750-812, 750-812/025-000 and 750-814).

34 • 750-404/000-003 [Frequency Counter 0.1 Hz-100 kHz]  
 Display Elements

2.1.4.3 Display Elements




Fig. 2.1.4-2: Display Elements g041402x

LED	Channel	Meaning	State
A	Status GATE	off	Input GATE: Signal voltage (0), Measurement released
		green	Input GATE: Signal voltage (1), Measurement disabled
B	Status DO 1	off	Digital Output DO 1 reset
		green	Digital Output DO 1 setting
C	Status CLOCK	off	Input CLOCK: Signal voltage (0)
		green	Input CLOCK: Signal voltage (1), Counting pulse
D	Status DO 2	off	Digital Output DO 2 reset
		green	Digital Output DO 2 setting

2.1.4.4 Schematic Diagram

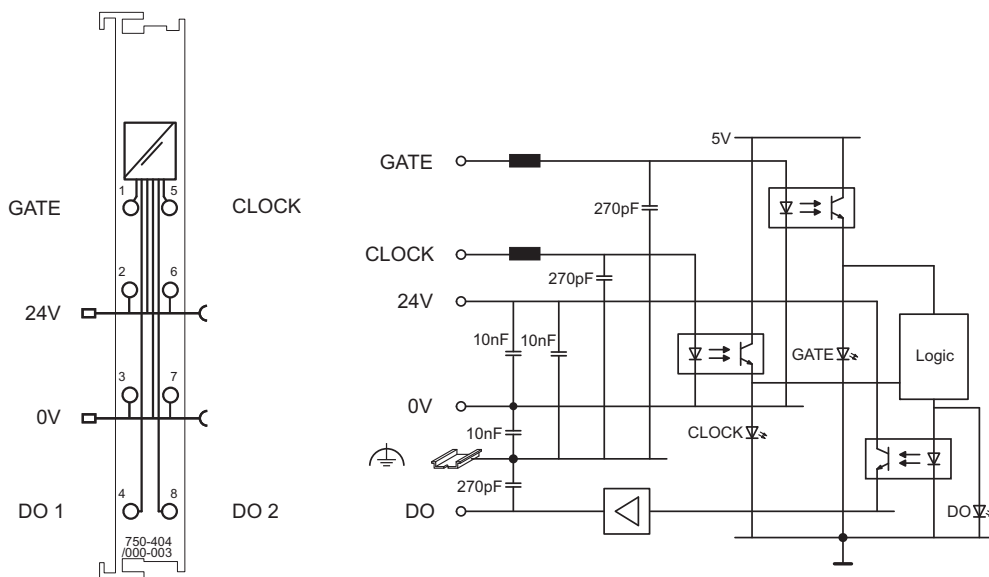







Fig. 2.1.4-3: Schematic Diagram

g040431e

## 2.1.4.5 Technical Data

Module Specific Data	
Number of outputs	2
Number of counters	1
Output current	0.5 A short-circuit-protected
Current consumption <sub>max.</sub>	75 mA at DC 5 V
Voltage via power jumper contacts	DC 24 V (-15 % ... + 20 %)
Signal voltage	(0): DC -3 V ... +5 V (1): DC +15 V ... +30 V
Switching rate <sub>max.</sub>	100 kHz
Pulse width <sub>min.</sub>	10 µs
Input current <sub>typ.</sub>	5 mA
Counter depth	32 Bit
Isolation	500 V (System/Supply)
Internal bit width	32 bits data 8 bits control /status
Dimensions W x H* x L * from upper edge of 35 DIN rail	12 mm x 64 mm x 100 mm
Weight	ca. 55 g
Maximum frequency range	
Integration time = 1 period	0.1 Hz - 8 kHz, resolution 0.001 Hz
Integration time = 4 period	0.25 Hz - 32 kHz, resolution 0.01 Hz
Integration time = 16 period	1 Hz - 100 kHz, resolution 0.1 Hz (1 Hz)
Measuring error at the maximum frequency range	
Range 0.1 Hz - 8 kHz	< ± 1 %
Range 0.25 Hz - 32 kHz	< ± 1.5 %
Range 1 Hz - 100 kHz	< ± 1.5 %
Lower frequency range*	
Integration time = 1 period	0,1 Hz - 100 Hz, resolution 0.001 Hz
Integration time = 4 period	1 Hz - 1 kHz, resolution 0.01 Hz
Integration time = 16 period	10 Hz - 10 kHz, resolution 0.1 Hz (1 Hz)
Measuring error at the lower frequency range *	
Range 0,1 Hz - 100 Hz	< ± 0.05 %
Range 1 Hz - 1 kHz	< ± 0.05 %
Range 10 Hz - 10 kHz	< ± 0.2 %
* For Measurements in a lower frequency range, the measuring error is lower than the measuring error using the maximum frequency rang.	
Standards and Regulations (cf. Chapter 2.2 of the Coupler/Controller Manual)	
EMC-Immunity to interference (CE)	acc. to EN 50082-2 (96)
EMC-Emission of interference (CE)	acc. to EN 50081-1 (93)

## 36 • 750-404/000-003 [Frequency Counter 0.1 Hz-100 kHz] Functional Description

Approvals (cf. Chapter 2.2 of the Coupler/Controller Manual)		
	cUL <sub>US</sub> (UL508)	
	cUL <sub>US</sub> (UL1604)	Class I Div2 ABCD T4A
	DNV (Det Norske Veritas)	Cl. B
	KEMA	II 3 G EEx nA II T4
	Conformity Marking	



### More Information

Detailed references to the approvals are listed in the document "Overview Approvals WAGO-I/O-SYSTEM 750", which You can find on the CD ROM ELECTRONICC Tools and Docs (Item-No.: 0888-0412-0001-0101) or in the Internet under: <http://www.wago.com> → Service → Downloads → Documentation → WAGO-I/O-SYSTEM 750 → System Description.

### 2.1.4.6 Functional Description

The counter module acquires the time between one or more rising edges of the CLOCK input signal and calculates the frequency of the applied signal.

The calculation and process image update are initiated every 1<sup>st</sup>, every 4<sup>th</sup> or every 16<sup>th</sup> rising edge depending on the integration time selected via the CONTROL byte. The first detection of a rising edge starts the cyclic period measurement and cannot provide a valid frequency value. In this case the module will send 0xFFFFFFFF<sub>H</sub> for input information. The same input value is returned when a static high or static low signal is applied to the CLOCK input.

If there are no signal changes seen at the CLOCK input, the module can be forced to update the process image after defined parameterizable time spans (Watchdog time). In this state the module will send the non valid value 0xFFFFFFFF<sub>H</sub> too.

The following figures illustrate a process data cycle.

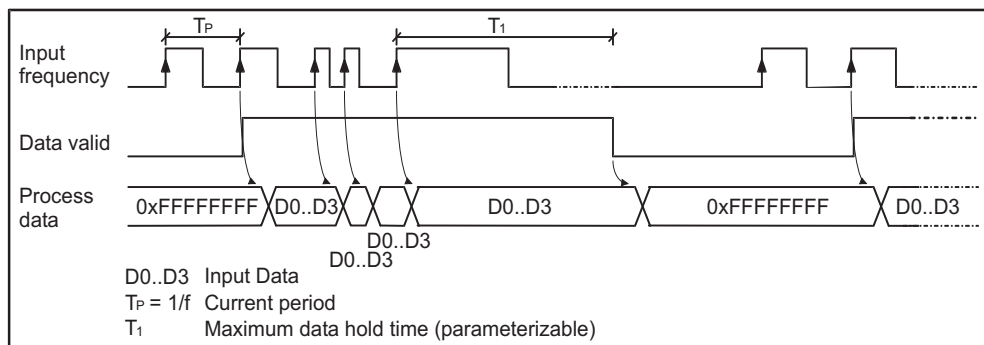


Fig. 2.1.4-4: Timing diagram for process data update sequence  
 (integration time = 1 period)

g040435e

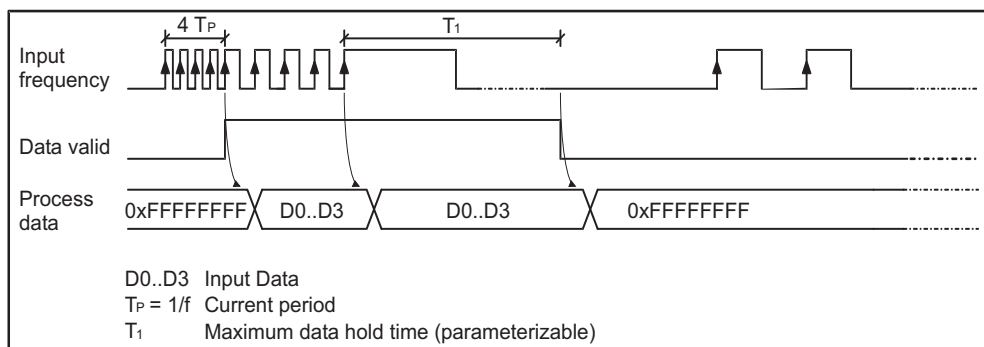


Fig. 2.1.4-5: Timing diagram for process data update sequence  
 (integration time = 1 period)

g040436e

### 2.1.4.7 Process Image

Using the I/O module 750-404/000-003, a 5 byte input and output process image can be transferred to the fieldbus coupler / controller via two logical channels.

The two output bytes (D0, D1) contain the setting Watchdog time in binary format. The other output bytes (D2, D3) are not used. The four input bytes (D0 ... D3) contain the frequency value in binary format. The control byte C0 serves for setting the integration time, the Watchdog time, the representation of the measured frequency value and the outputs. The status byte S0 displays the acknowledgement of the settings and shows the status of the inputs and outputs.



#### Attention

The representation of the process data of some I/O modules or their variations in the process image depends on the fieldbus coupler/-controller used. Please take this information as well as the particular design of the respective control/status bytes from the section "Fieldbus Specific Design of the Process Data" included in the description concerning the process image of the corresponding coupler/controller.

38 • 750-404/000-003 [Frequency Counter 0.1 Hz-100 kHz]  
Process Image

Input data		Output data	
S0	Status byte	C0	Control byte
D0	Frequency value byte 0 (LSB)	D0	Watchdog-time byte 0 (LSB)
D1	Frequency value byte 1	D1	Watchdog-time byte 1 (MSB)
D2	Frequency value byte 2	D2	reserved
D3	Frequency value byte 3 (MSB)	D3	reserved

Control byte							
B7	B6	B5	B4	B3	B2	B1	B0
0	0	0	T <sub>VD</sub> REQ	Set output DO 2	Set output DO 1	RANGE_SEL REQ1	RANGE_SEL REQ0

T<sub>VD</sub> REQ Request to change the Watchdog time (T<sub>VD</sub>) with valid data.

RANGE\_SEL REQ1 Selection of the integration time and the representation of measured frequency value.

RANGE\_SEL REQ0 Selection of the integration time and the representation of measured frequency value.

0 This constant must be set to zero.

Status byte							
B7	B6	B5	B4	B3	B2	B1	B0
X	X	ST_GATE	T <sub>VD</sub> ACK	Status output DO 2	Status output DO 1	RANGE_SEL ACK1	RANGE_SEL ACK0

ST\_GATE Status of the GATE input (0=enabled, 1=disabled)

T<sub>VD</sub> ACK Acknowledgement T<sub>VD</sub> changed.

RANGE\_SEL ACK1 Acknowledgment to Range Selection, Frequency values are valid.

RANGE\_SEL ACK0 Acknowledgment to Range Selection, Frequency values are valid.

X This value is not evaluated.

With the control and status byte the following tasks are possible:

**Setting the Method of Measuring, Frequency Range and Representation:**

The method of measuring and the representation depends on the RANGE\_SEL REQ bits in the CONTROL byte. Dependent on the adjusted measuring method also the maximum frequency range changes.

The following table illustrates the different modes.

RANGE_ SEL1	RANGE_ SEL0	Measuring method	Maximum frequency range	Measured – value display
		Integration over ...		
0	0	1 period	0.1 Hz ... 8 kHz	Frequency in 1/1000 Hz
0	1	4 periods	0.25 Hz ... 32 kHz	Frequency in 1/100 Hz
1	0	16 periods	1 Hz ... 100 kHz	Frequency in 1/10 Hz
1	1	16 periods	1 Hz ... 100 kHz	Frequency in Hz



### Attention

When a new frequency range is requested, the application has to wait for valid data until the RANGE\_SEL ACK bits contain the new frequency range.

The maximum delay can be calculated using the following formula:

$$T_{Dmax} = 2 \cdot \frac{\text{number of periods to be integrated}}{\text{actual frequency}}$$

If the gate is enabled the input data contains the last valid frequency value. In this state the application cannot request a new range.



### Attention

If the maximum possible frequency of the different ranges is raised (see the table with maximum frequency ratings), the module will return the non valid data 0xFFFFFFFF<sub>H</sub>.

### Set Watchdog time:

To recognize static CLOCK signals, a watchdog timer is implemented. The standard value for the timer is 10s. The timer resets on every Power On.

The application is able to change the watchdog time during operation by using the CONTROL byte.

This can be initiated by writing the corresponding value into the output bytes D 1 and D 0 before setting the T<sub>vd</sub> REQ bit in the CONTROL byte.

The success of the parameter transfer is acknowledged by the module via the T<sub>vd</sub> ACK bit in the STATUS information.

## 40 • 750-404/000-003 [Frequency Counter 0.1 Hz-100 kHz]

## Example

**Attention**

The range of the watchdog timer stretches from 0 to 16383ms (0x0000 to 0x3FFF) in steps of 1ms per digit. Values which raise the permitted range of the watchdog timer are masked with 0x3FFF.

**Set Outputs:**

Bits 2 and 3 set the additional two outputs of the counter module.

**2.1.4.8 Example****Changing the Method of Measurement, Frequency and Representation:**

The frequency counter is set to a measurement range of 1 Hz ... 100 kHz with a resolution of 1/10 Hz and 16 measurement periods.

14. Set the new measurement range with the bits 0 and 1 (RANGE\_SEL REQ 0 and 1) in the control byte.

Control byte								
Output bit	B7	B6	B5	B4	B3	B2	B1	B0
Value	0	X	X	X	X	X	0	1

15. Wait for the feedback from the counter module in the status byte, bit 0 and 1 (RANGE\_SEL ACK 1 and 0). The status byte has the following bits:

Status byte								
Input bit	B7	B6	B5	B4	B3	B2	B1	B0
Value	X	X	X	X	X	X	0	1

16. After the expiration of the delay the current frequency value with the adjusted resolution then appears in the input data with the following data bytes D0 to D3:

Data bytes				
Input data	D3	D2	D1	D0
Value	0x..	0x..	0x..	0x..

**Change the Watchdog Time:**

The Watchdog time is change to 5000 ms (hexadecimal value 0x1388).

17. Write the new Watchdog time value into the output bytes.

The data bytes D0 to D3 of the output data then read as follows:

Data bytes				
Output data	D3	D2	D1	D0
Value	0x00	0x00	0x13	0x88

18. With bit 4 ( $T_{VD}$  REQ) in the Control byte the changes are adopted.

Control byte								
Output bit	B7	B6	B5	B4	B3	B2	B1	B0
Value	0	X	X	1	X	X	X	X

19. After feedback of the counter module with bit 4 ( $T_{VD}$  ACK) in the status byte the counter works with the new Watchdog time.

Status byte								
Input sbit	B7	B6	B5	B4	B3	B2	B1	B0
Value	X	X	X	1	X	X	X	X

20. Reset bit 4 in the control byte.

Control byte								
Outout bit	B7	B6	B5	B4	B3	B2	B1	B0
Value	0	X	X	0	X	X	X	X

21. The resetting is acknowledged with bit 4 in the status byte.

Status byte								
Input sbit	B7	B6	B5	B4	B3	B2	B1	B0
Value	X	X	X	0	X	X	X	X

X is used if a value is not relevant.

42 • 750-404/000-005 [2 Up Counter/16 Bit/5 kHz]  
View

## 2.1.5 750-404/000-005 [2 Up Counter/16 Bit/5 kHz]

2 Up Counter 16 Bit, DC 24 V, 5 kHz

### 2.1.5.1 View

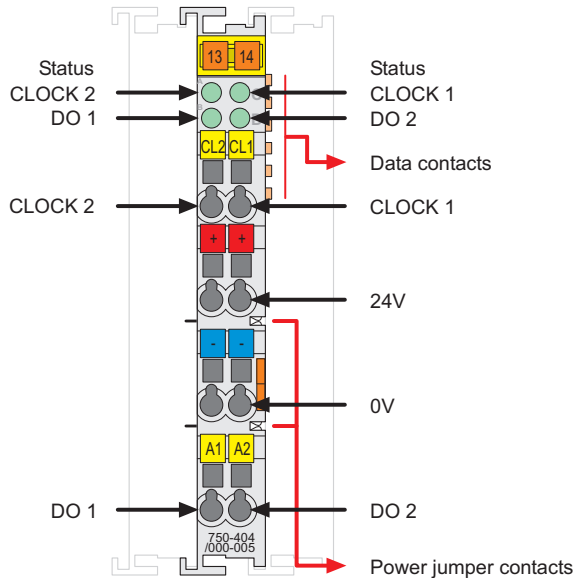


Fig. 2.1.5-1: View

g040450e

### 2.1.5.2 Description

The counter module also can be ordered as two Up Counters with 16 bits counter values; 750-404/000-005.

The Up counters are capable of counting binary pulses of DC 24 V at the inputs CLOCK 1 and CLOCK 2 and then transmit the data to the fieldbus. The changes from 0 V to 24 V are counted.

The counter can be set or reset with the control byte.

The digital outputs DO1 and DO2 can be activated via specific bits in the Control byte.

The outputs are short-circuit-protected.

The high states of the inputs CLOCK 1 and CLOCK 2 and the output channels are each indicated by a LED.

An optocoupler is used for electrical isolation between the bus and the field side.

Any configuration of the counter modules is possible when designing the fieldbus node. Grouping of module types is not necessary.

The field side supply voltage of 24 V for the counter module is derived from adjacent I/O modules or from a supply module. The supply voltage for the field side is made automatically through the individual I/O modules by means of power jumper contacts.



---

**Warning**

The maximum current of the internal power jumper contacts is 10 A. When configuring the system it is important not to exceed the maximum/sum current. However, if such a case should occur, another supply module must be added.

---



---

**Attention**

This module has no power contacts for receiving and transmitting the ground (earth) potential. A supply module is required, if the adjacent modules need to be connected to the ground.

---



---

**Note**

Use an appropriate supply module (e.g. 750-602) if an electrically isolated voltage supply is required!

---

The module 750-404/000-005 can be used with all couplers/controllers of the WAGO-I/O-SYSTEM 750 (except for the economy types 750-320, 750-323, 750-324 and 750-327 and the ModBus controllers 750-812, 750-812/025-000 and 750-814).

This description is valid for the XXXX3A05... hardware and software versions. The version is specified in the manufacturing number, which is part of the lateral marking on the module.

44 • 750-404/000-005 [2 Up Counter/16 Bit/5 kHz]  
Display Elements

2.1.5.3 Display Elements




Fig. 2.1.5-2: Display Elements g041402x

LED	Channel	Meaning	State
A	Status CLOCK 2	off	Input CLOCK 2: Signal voltage (0)
		green	Input CLOCK 2: Signal voltage (1), Counting pulse 2
B	Status DO 1	off	Digital Output DO 1 reset
		green	Digital Output DO 1 setting
C	Status CLOCK 1	off	Input CLOCK 1: Signalspannung (0)
		green	Input CLOCK 1: Signalspannung (1), Counting pulse 1
D	Status DO 2	off	Digital Output DO 2 setting
		green	Digital Output DO 2 reset

2.1.5.4 Schematic Diagram

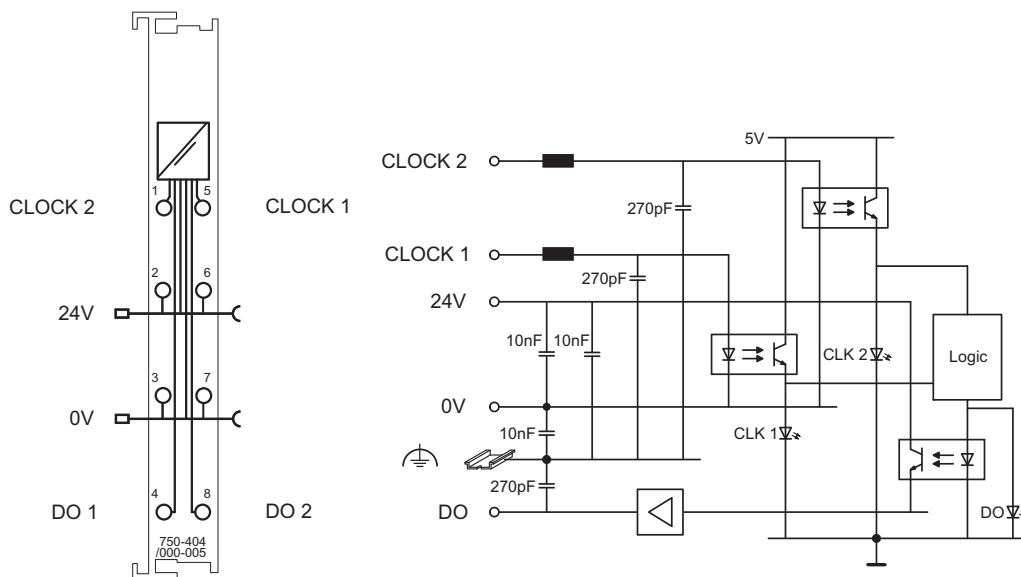







Fig. 2.1.5-3: Schematic Diagram

g040451e

## 2.1.5.5 Technical Data

Module Specific Data		
Number of outputs	2	
Number of counters	2	
Output current	0.5 A short-circuit-protected	
Current consumption	75 mA	
Voltage via power jumper contacts	DC 24 V (−15 % ... + 20 %)	
Signal voltage	(0): DC −3 V ... +5 V (1): DC +15 V ... +30 V	
Switching rate <sub>max.</sub>	5 kHz (pulse width > 100 μs)	
Input current <sub>typ.</sub>	5 mA	
Counter depth	2 x 16 bits data	
Isolation	500 V (System/Supply)	
Internal bit width	2 x 16 bits data 8 bits control /status	
Dimensions W x H* x L * from upper edge of 35 DIN rail	12 mm x 64 mm x 100 mm	
Weight	ca. 55 g	
Standards and Regulations (cf. Chapter 2.2 of the Coupler/Controller Manual)		
EMC-Immunity to interference (CE)	acc. to EN 50082-2 (96)	
EMC-Emission of interference (CE)	acc. to EN 50081-1 (93)	
Approvals (cf. Chapter 2.2 of the Coupler/Controller Manual)		
	cUL <sub>US</sub> (UL508)	
	cUL <sub>US</sub> (UL1604)	Class I Div2 ABCD T4A
	DNV (Det Norske Veritas)	Cl. B
	KEMA	II 3 G EEx nA II T4
	Conformity Marking	

**More Information**

Detailed references to the approvals are listed in the document "Overview Approvals WAGO-I/O-SYSTEM 750", which You can find on the CD ROM ELECTRONICC Tools and Docs (Item-No.: 0888-0412-0001-0101) or in the Internet under: <http://www.wago.com> → Service → Downloads → Documentation → WAGO-I/O-SYSTEM 750 → System Description.

46 • 750-404/000-005 [2 Up Counter/16 Bit/5 kHz]  
Process Image

### 2.1.5.6 Process Image

Using the I/O module 750-404/000-005, a 5 byte input and output process image can be transferred to the fieldbus coupler / controller via two logical channels.

The transfer of the setting counter values in binary format is made via 4 output bytes (D0, D1) or (D2, D3) and the transfer of the counter reading in binary format is made via 4 input bytes (D0, D1) or (D2, D3). The control byte C0 serves for setting and locking the counters and for setting the outputs. The status byte S0 shows the status of the counters and the inputs and outputs.



#### Attention

The representation of the process data of some I/O modules or their variations in the process image depends on the fieldbus coupler/-controller used. Please take this information as well as the particular design of the respective control/status bytes from the section "Fieldbus Specific Design of the Process Data" included in the description concerning the process image of the corresponding coupler/controller.

Input data		Output data	
S0	Status byte	C0	Control byte
D0	Counter value 1 byte 0 (LSB)	D0	Set value 1 byte 0 (LSB)
D1	Counter value 1 byte 1 (MSB)	D1	Set value 1 byte 1 (MSB)
D2	Counter value 2 byte 0 (LSB)	D2	Set value 2 byte 0 (LSB)
D3	Counter value 2 byte 1 (MSB)	D3	Set value 2 byte 1 (MSB)

Control byte							
B7	B6	B5	B4	B3	B2	B1	B0
0	0	Set counter 1	Set counter 2	Set output DO 2	Set output DO 1	0	0

0 This constant must be set to zero.

Status byte							
B7	B6	B5	B4	B3	B2	B1	B0
X	X	Counter is set	Counter is set	actual signal at output DO 2	actual signal at output DO 1	actual signal at input CLOCK 2	actual signal at input CLOCK 1

X This value is not evaluated.

With the control and status byte the following tasks are possible:

#### Set Counter:

Put Bit 5 (4) into the control byte. The counter 1 (2) with the 16 bit value is loaded into output bytes 0 (1) or 2 (3). As long as the bit is set, the counter can stop and information is stored. The ensuing data of the counter will be conveyed to the status byte. Bit 5 (4) in the status byte communicates the successful load of the counter.

#### Set Outputs:

Bits 2 and 3 set the additional two outputs of the counter module.

### 2.1.5.7 Example

#### Set Counter 1:

First of all the counter reading is set to 100 by "Setting counter", i. e. to the hexadecimal value: 0x64.

22. Enter the set value in the output data.

The data bytes D0 to D3 of the output data then read as follows:

Datenbytes				
Output data	D3	D2	D1	D0
Value	0x00	0x00	0x00	0x64

23. Validate the counter reading in the control byte with bit 5 (setting counter 1) to have it adopted as an output value. The control byte has the following bits:

Steuerbyte								
Output bit	B7	B6	B5	B4	B3	B2	B1	B0
Value	0	X	1	X	X	X	X	X

24. Wait for the feedback from the counter module in the status byte, bit 5 (counter 1 set). The status byte has the following bits:

Statusbyte								
Input bit	B7	B6	B5	B4	B3	B2	B1	B0
Value	X	X	1	X	X	X	X	X

25. Delete bit 5 (setting counter 1) in the control byte in order to finish the Handshake. The bits in the control byte read as follows:

Steuerbyte								
Output bit	B7	B6	B5	B4	B3	B2	B1	B0
Value	0	X	0	X	X	X	X	X

26. The set counter reading then appears in the input data with the following data bytes D0 to D3:

Data bytes				
Input data	D3	D2	D1	D0
Value	0x00	0x00	0x00	0x64

## 48 • 750-404/000-005 [2 Up Counter/16 Bit/5 kHz]

## Example

27. Wait for the first and further count pulses.

During counting, the data bytes D0 to D3 of the input data appear as follows:

Remark	Data bytes			
	D3	D2	D1	D0
no count pulse received	0x00	0x00	0x00	0x64
1st count pulse received	0x00	0x00	0x00	0x65
2nd count pulse received	0x00	0x00	0x00	0x66
Further count pulses	.....	.....	.....	.....
Max. counter reading reached	0x00	0x00	0xFF	0xFF
the next count pulse causes a number overflow	0x00	0x00	0x00	0x00
One further count pulse received	0x00	0x00	0x00	0x01

X is used if a value is not relevant.





WAGO Kontakttechnik GmbH & Co. KG  
Postfach 2880 • G-32385 Minden  
Hansastraße 27 • G-32423 Minden  
Phone: 05 71/8 87 – 0  
Fax: 05 71/8 87 – 1 69  
E-Mail: [info@wago.com](mailto:info@wago.com)

Internet: <http://www.wago.com>



**SCATTERGOOD  
& JOHNSON LTD**  
ELECTRICAL ENGINEERING & FLUID CONTROL DISTRIBUTORS

Est.1899

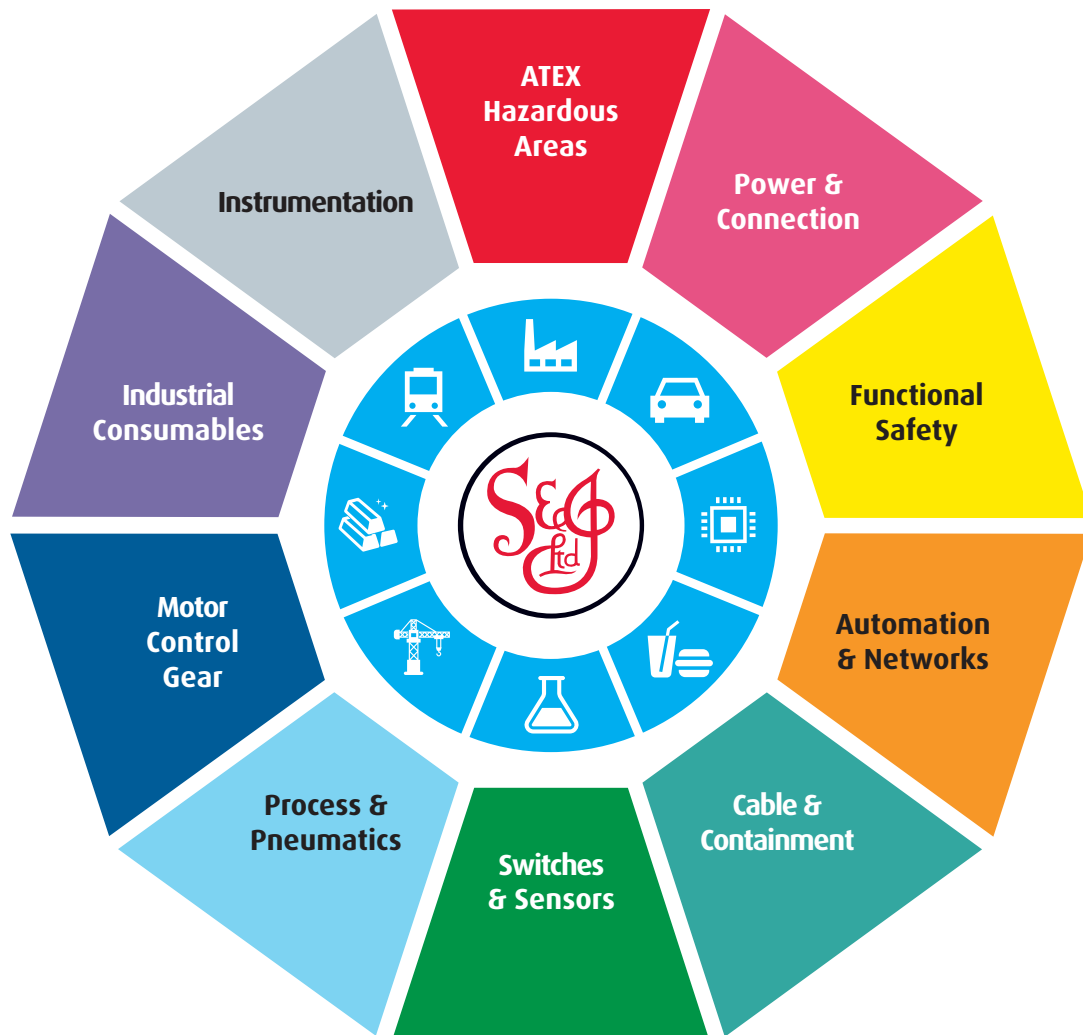
At Scattergood & Johnson Ltd, we pride ourselves on being a technical distributor to specialist industries.

Working with a range of quality product manufacturers across a number of specialist markets, we are not your average 'box shifter' - we are your technical and supply chain partner.

We fully support every product we sell - for free! Our internal team and external sales engineers can answer any product or application question, no matter the complexity.

Backing up this technical ability is a range of 50,000+ products available from stock for nationwide next day delivery (same day if required!), or you can collect what you need from any of our trade counters around the UK.

Select your specialist interest below to learn more about how we can help.



Online, In Branch and On the Road - Scattergood & Johnson Ltd, there when you need us.

**[www.scatts.co.uk](http://www.scatts.co.uk)**